


Mission Water Distribution System

Recent Water Quality Results

Updated: 1-Oct-20



Sample Locations

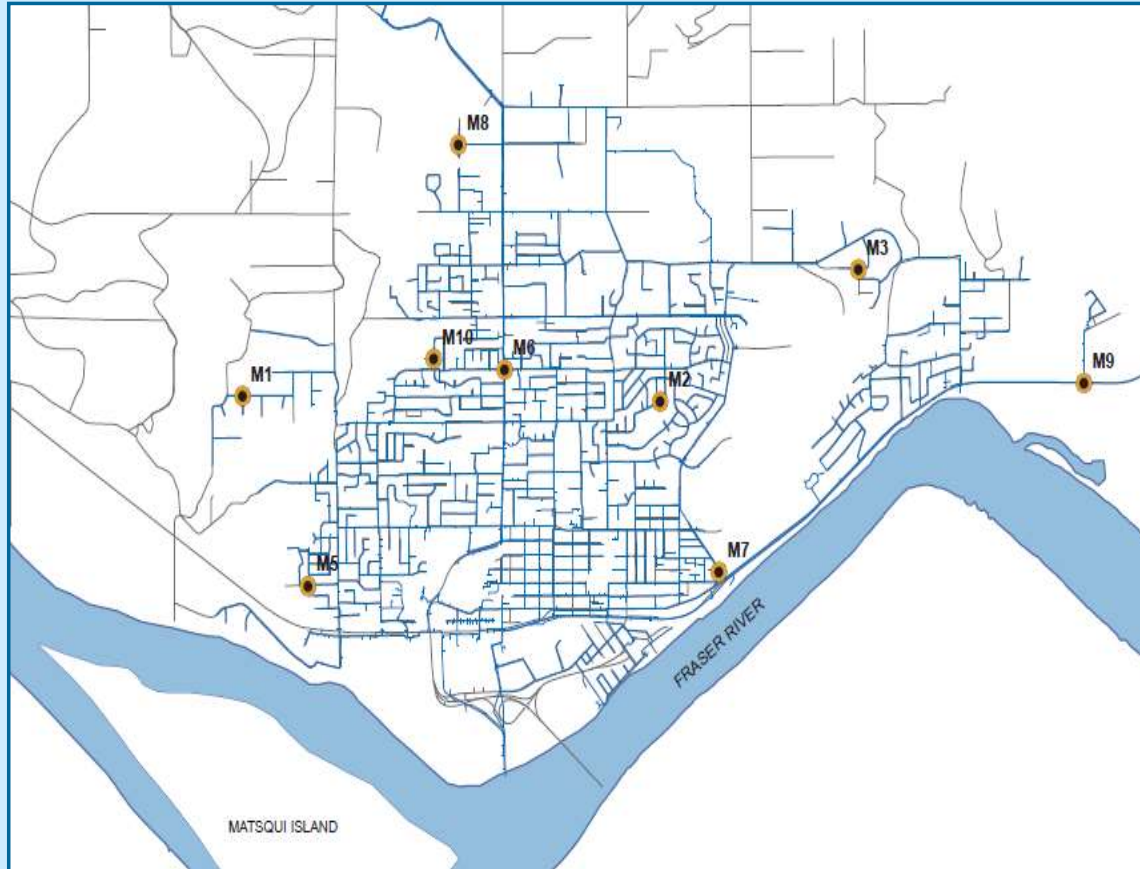

- Refer to following pages
- Water quality parameter descriptions on last

Questions?

Paul Algra
District of Mission Public Works
604-820-3769
palgra@mission.ca

Mission Water Distribution System

Recent Water Quality Results

Updated: 1-Oct-20



M1	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	< 10	0
SEP				
SEP 1				
SEP 9	0.28	1.26	0	0
SEP 15	0.21	1.17	0	0
SEP 22	0.59	1.32	0	0
SEP 29	0.44	0.91	0	0
AUG				
AUG 5	0.28	1.35	0	0
AUG 11	0.49	2.14	0	0
AUG 18	0.38	1.79	0	0
AUG 25	0.56	1.15	0	0
JUL				
JUL 7	0.35	1.27	0	0
JUL 14	0.40	1.27	0	0
JUL 21	0.22	1.38	0	0
JUL 28	0.14	1.26	0	0


Blank Cell = No Data Collected

M2	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	< 10	0
SEP				
SEP 1	0.35	1.44	0	0
SEP 9	0.44	1.70	0	0
SEP 15	0.43	1.68	0	0
SEP 22	0.11	1.65	0	0
SEP 29	0.45	1.47	0	0
AUG				
AUG 5	0.43	1.68	0	0
AUG 11	0.42	1.78	0	0
AUG 18	0.51	1.83	0	0
AUG 25	0.36	1.63	0	0
JUL				
JUL 7	0.34	1.53	0	0
JUL 14	0.47	1.30	0	0
JUL 21	0.26	0.73	0	0
JUL 28	0.41	1.76	0	0

Blank Cell = No Data Collected

M3	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	< 10	0
SEP				
SEP 1	0.34	1.68	0	0
SEP 9	0.43	1.80	0	0
SEP 15	0.41	1.71	0	0
SEP 22	0.15	1.72	0	0
SEP 29	0.36	1.59	0	0
AUG				
AUG 5	0.40	1.90	0	0
AUG 11	0.39	1.78	0	0
AUG 18	0.40	1.73	0	0
AUG 25	0.32	1.70	0	0
JUL				
JUL 7	0.37	1.87	0	0
JUL 14	0.42	1.70	0	0
JUL 21	0.38	1.89	0	0
JUL 28	0.41	1.94	0	0

Blank Cell = No Data Collected

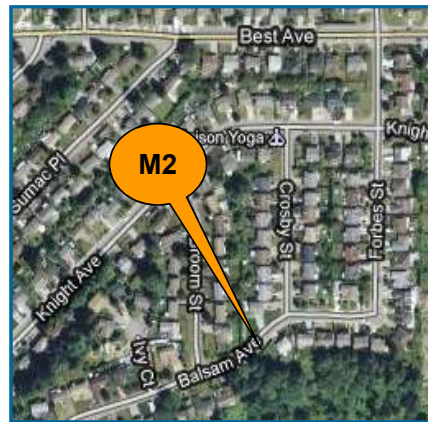

Mission Water Distribution System

Recent Water Quality Results

Updated: 1-Oct-20



M5	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	< 10	0
SEP				
SEP 1	0.27	1.03	0	0
SEP 9	0.35	1.10	0	0
SEP 15	0.27	1.01	0	0
SEP 22	0.49	1.65	0	0
SEP 29	0.41	1.05	0	0
AUG				
AUG 5	0.26	1.03	0	0
AUG 11	0.65	2.04	0	0
AUG 12				
AUG 13	0.43	2.00	0	0
AUG 16	0.39	1.81	0	0
AUG 18	0.38	1.74	0	0
AUG 19				
AUG 25	0.27	1.01	0	0
JUL				
JUL 7	0.24	1.21	0	0
JUL 14	0.47	1.17	0	0
JUL 21	0.18	1.21	0	0
JUL 28	1.45**	1.07	0	0


Blank Cell = No Data Collected

M6	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	< 10	0
SEP				
SEP 1	0.39	1.58	0	0
SEP 9	0.57	1.72	0	0
SEP 15	0.39	1.63	0	0
SEP 22	0.18	1.80	0	0
SEP 29	0.44	1.51	0	0
AUG				
AUG 5	0.67	1.86	0	0
AUG 11	0.43	2.31	11*	0
AUG 12	0.60	2.14	2*	0
AUG 13	0.47	1.98	2*	0
AUG 16		1.87	3*	0
AUG 18	0.63	1.93	0	0
AUG 19	0.46	1.95	>200*	0
AUG 25	0.56	0.90	0	0
JUL				
JUL 7	0.37	1.80	0	0
JUL 14	2.63**	1.37	0	0
JUL 21	0.65	2.06	0	0
JUL 28	0.61	1.95	0	0

Blank Cell = No Data Collected

M7	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	< 10	0
SEP				
SEP 1	0.13	1.28	0	0
SEP 9	0.37	1.16	0	0
SEP 15	0.13	1.18	0	0
SEP 22	0.16	0.77	0	0
SEP 29	0.13	1.12	0	0
AUG				
AUG 5	0.25	1.38	0	0
AUG 11	0.49	2.27	0	0
AUG 12				
AUG 13	0.16	0.89	0	0
AUG 16	0.34	1.20	0	0
AUG 18	0.25	1.30	0	0
AUG 25	0.18	1.23	0	0
JUL				
JUL 7	0.18	1.37	0	0
JUL 14	0.25	1.14	0	0
JUL 21	0.16	1.24	0	0
JUL 28	0.21	1.30	0	0

Blank Cell = No Data Collected

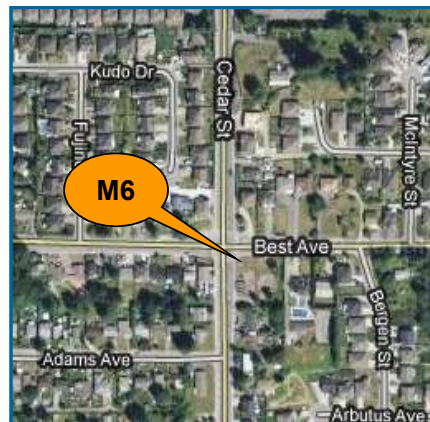

Mission Water Distribution System

Recent Water Quality Results

Updated: 1-Oct-20



M8	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	< 10	0
SEP				
SEP 1	0.43	2.08	0	0
SEP 9	0.53	1.96	0	0
SEP 15	0.39	2.04	0	0
SEP 22	0.50	1.99	0	0
SEP 29	0.51	1.79	0	0
AUG				
AUG 5	0.43	1.95	0	0
AUG 11	0.60	2.07	0	0
AUG 18	0.36	2.03	0	0
AUG 25	0.43	1.98	0	0
JUL				
JUL 7	0.54	1.94	0	0
JUL 14	0.36	2.00	0	0
JUL 21	0.61	1.93	0	0
JUL 28	0.13	1.96	0	0

Blank Cell = No Data Collected

M9	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	< 10	0
SEP				
SEP 1	0.14	1.32	0	0
SEP 9	0.16	1.32	0	0
SEP 15	0.12	1.16	0	0
SEP 22	0.19	0.82	0	0
SEP 29	0.14	1.20	0	0
AUG				
AUG 5	0.22	1.49	0	0
AUG 11	0.50	2.21	0	0
AUG 18	0.30	1.46	0	0
AUG 25	0.18	1.22	0	0
JUL				
JUL 7	0.19	1.56	0	0
JUL 14	0.46	1.46	0	0
JUL 21	0.11	1.26	0	0
JUL 28	0.17	1.40	0	0

Blank Cell = No Data Collected

M10	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	< 10	0
SEP				
SEP 1	0.37	1.04	0	0
SEP 9	0.37	1.33	0	0
SEP 15	0.40	1.23	0	0
SEP 22	0.41	1.09	0	0
SEP 29	0.43	1.14	0	0
AUG				
AUG 5	0.46	1.33	0	0
AUG 11	0.49	1.87	0	0
AUG 18	0.37	1.39	0	0
AUG 25	0.32	1.11	0	0
JUL				
JUL 7	0.53	0.94	0	0
JUL 14	0.30	0.93	0	0
JUL 21	0.19	0.10***	0	0
JUL 28	0.14	0.08***	0	0
		0.17***		

Blank Cell = No Data Collected



Mission Water Distribution System

Recent Water Quality Results

Updated: 1-Oct-20



Parameter	Description	Acceptable Range
Turbidity	Suspended matter that interferes with the clarity of the water. While not a health concern itself, turbidity is an indicator of possible contamination.	There are no regulations for distribution system turbidity; water system operators aim for less than 1.0 NTU.
Total Chlorine	Used to monitor the level of disinfectant used to inactivate microorganisms such as bacteria and viruses.	There are no regulations for distribution system total chlorine; system operators aim to maintain 0.2 - 2.2 ppm. As long as there are no total coliforms, lower values are not a concern. Higher values are not deemed a health concern unless they exceed the World Health Organization's recommended limit of 5ppm.
Total Coliforms	A group of bacteria that generally do not cause human disease, but their presence in water may indicate possible contamination.	The BC Drinking Water Act stipulates that no more than 10% of samples during a 30-day period may be positive for Total Coliforms and that no single sample may contain more than 10 counts.
E. Coli	A member of the Total Coliform group and its presence in water indicates contamination.	The BC Drinking Water Act stipulates that no E.Coli should be detected in drinking water.

Note: Turbidity and Total Chlorine are measured with field instruments. Result trends are used as indicators of significant water quality changes; specific values are not necessarily accurate.

*Total Coliforms were detected in the Cannell transmission main and at M6 in mid-August. Samples were taken regularly until they were non-detect and no *E. coli* was detected. Staff were in regular communication with Fraser Health and treatment was adjusted to reflect the changes in the raw water quality.

**Turbidity reading above 1.0 NTU due to nearby flushing.

***Due to operational changes, total chlorine results were lower than normal. Total Coliform and *E. coli* counts were non-detect.