


# Abbotsford Water Distribution System

## Recent Water Quality Results

Updated: 22-Nov-18



### Sample Locations

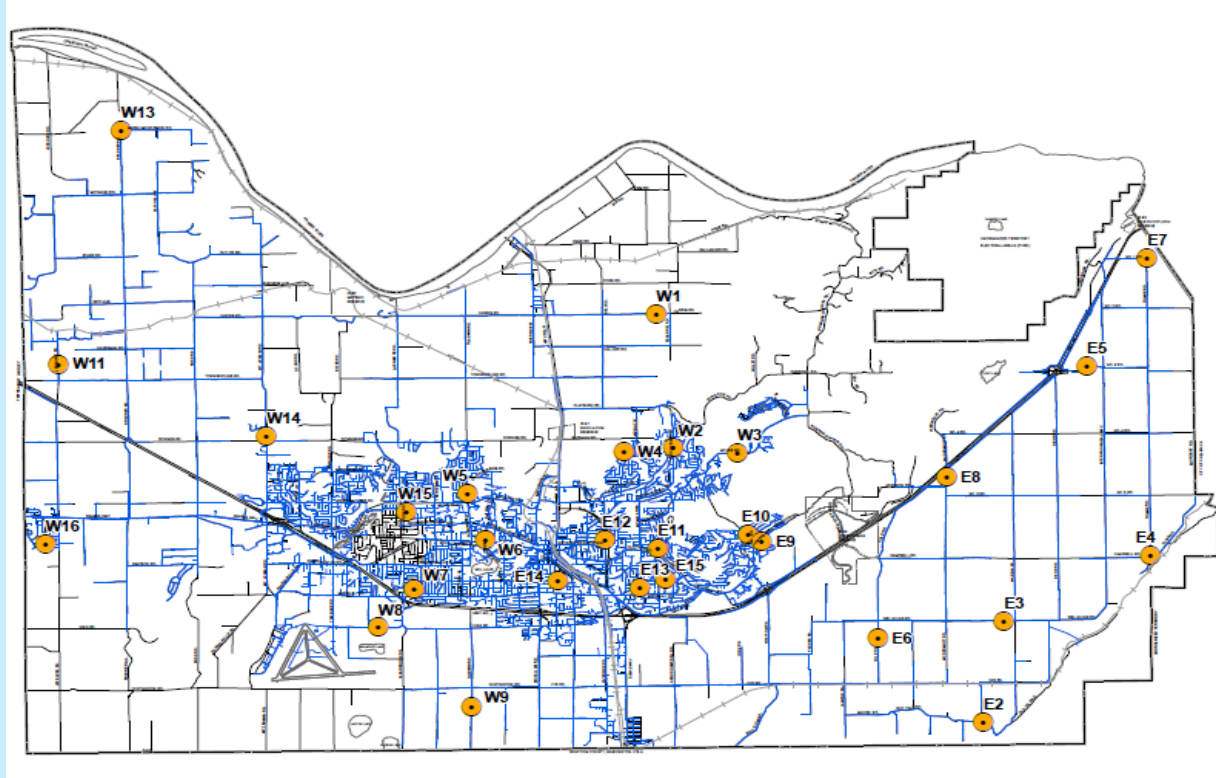

- Refer to following pages for results.
- Water quality parameter descriptions on last page.

### Questions?

Engineering  
604-864-5514  
eng-info@abbotsford.ca

# Abbotsford Water Distribution System

## Recent Water Quality Results


Updated: 22-Nov-18



<b>E2</b>	Turbidity	Total Chlorine	Total Coliforms	E.Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.11	0.93	0	0
OCT 10	0.16	1.25	0	0
OCT 16	0.08	1.26	0	0
OCT 23	0.24	1.18	0	0
OCT 30	0.19	0.69	0	0
<b>SEP</b>				
SEP 5	0.25	1.06	0	0
SEP 11	0.16	0.89	0	0
SEP 18	0.14	0.81	0	0
SEP 25	0.16	1.00	0	0
<b>AUG</b>				
AUG 8	0.14	1.03	0	0
AUG 14	0.27	0.06	0	0
AUG 21	0.17	1.02	0	0
AUG 28	0.29	1.03	0	0
Blank Cell = No Data Collected				

<b>E3</b>	Turbidity	Total Chlorine	Total Coliforms	E.Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.10	0.83	0	0
OCT 10	0.13	1.17	0	0
OCT 16	0.14	1.21	0	0
OCT 23	0.26	1.26	0	0
OCT 30	0.20	0.82	0	0
<b>SEP</b>				
SEP 5	0.28	1.08	0	0
SEP 11	0.14	0.95	0	0
SEP 18	0.11	0.77	0	0
SEP 25	0.13	1.01	0	0
<b>AUG</b>				
AUG 8	0.14	0.92	0	0
AUG 14	0.22	0.30	0	0
AUG 21	0.16	1.03	0	0
AUG 28	0.31	1.02	0	0
Blank Cell = No Data Collected				

<b>E4</b>	Turbidity	Total Chlorine	Total Coliforms	E.Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.12	0.69	0	0
OCT 10	0.15	0.72	0	0
OCT 16	0.18	1.09	0	0
OCT 23	0.14	0.72	0	0
OCT 30	0.20	0.76	0	0
<b>SEP</b>				
SEP 5	0.17	0.58	0	0
SEP 11	0.08	0.59	0	0
SEP 18	0.21	0.53	0	0
SEP 25	0.10	0.57	0	0
<b>AUG</b>				
AUG 8	0.10	0.69	0	0
AUG 14	0.27	0.13	0	0
AUG 21	0.15	0.35	0	0
AUG 28	0.29	0.37	0	0
Blank Cell = No Data Collected				

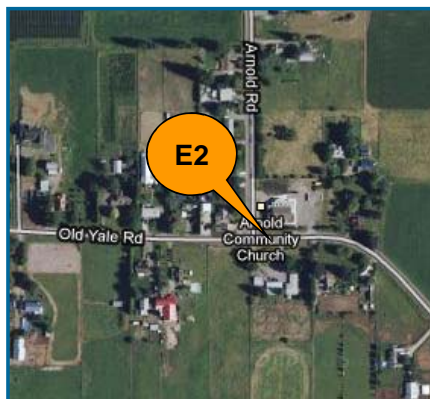

# Abbotsford Water Distribution System

## Recent Water Quality Results



Updated: 22-Nov-18



<b>E5</b>	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.15	0.25	0	0
OCT 10	0.15	0.17	0	0
OCT 16	0.16	0.40	0	0
OCT 23	0.22	0.21	0	0
OCT 30	0.11	0.36	0	0
<b>SEP</b>				
SEP 5	0.14	0.29	0	0
SEP 11	0.13	0.29	0	0
SEP 18	0.12	0.12	0	0
SEP 25	0.15	0.17	0	0
<b>AUG</b>				
AUG 8	0.13	0.43	0	0
AUG 14	0.18	0.16	0	0
AUG 21	0.20	0.13	0	0
AUG 28	0.28	0.24	0	0
Blank Cell = No Data Collected				

<b>E6</b>	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.14	0.90	0	0
OCT 10	0.16	1.33	0	0
OCT 16	0.13	1.29	0	0
OCT 23	0.27	1.16	0	0
OCT 30	0.18	0.70	0	0
<b>SEP</b>				
SEP 5	0.21	1.15	0	0
SEP 11	0.17	0.90	0	0
SEP 18	0.13	0.83	0	0
SEP 25	0.13	0.62	0	0
<b>AUG</b>				
AUG 8	0.21	1.02	0	0
AUG 14	0.25	0.10	0	0
AUG 21	0.24	1.09	0	0
AUG 28	0.22	1.09	0	0
Blank Cell = No Data Collected				

<b>E7</b>	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.14	0.56	0	0
OCT 10	0.17	0.10	0	0
OCT 16	0.15	0.48	0	0
OCT 23	0.21	0.22	0	0
OCT 30	0.18	0.14	0	0
<b>SEP</b>				
SEP 5	0.05	0.33	0	0
SEP 11	0.19	0.11	0	0
SEP 18	0.13	0.08	0	0
SEP 25	0.13	0.16	0	0
<b>AUG</b>				
AUG 8	0.12	0.34	0	0
AUG 14	0.21	0.07	0	0
AUG 21	0.14	0.10	0	0
AUG 28	0.31	0.03	0	0
Blank Cell = No Data Collected				

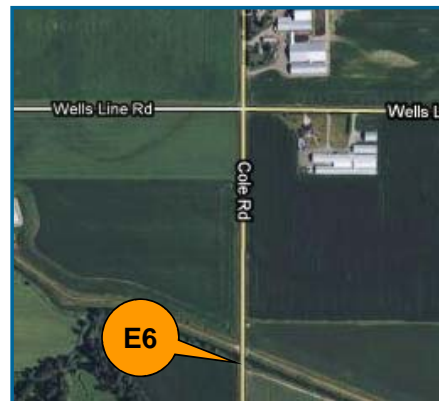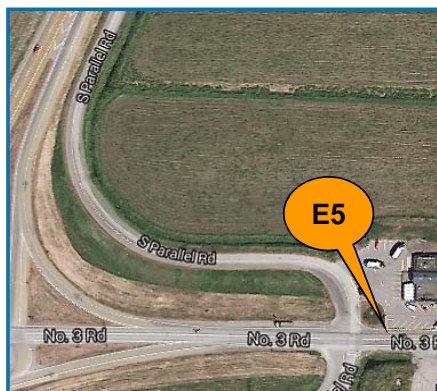

# Abbotsford Water Distribution System

## Recent Water Quality Results


Updated: 22-Nov-18



<b>E8</b>	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.13	0.85	0	0
OCT 10	0.14	0.38	0	0
OCT 16	0.13	1.08	0	0
OCT 23	0.25	0.77	0	0
OCT 30	0.16	0.88	0	0
<b>SEP</b>				
SEP 5	0.21	0.48	0	0
SEP 11	0.15	0.74	0	0
SEP 18	0.18	0.75	0	0
SEP 25	0.13	0.78	0	0
<b>AUG</b>				
AUG 8	0.12	1.05	0	0
AUG 14	0.37	0.06	0	0
AUG 21	0.23	0.98	0	0
AUG 28	0.19	1.02	0	0
Blank Cell = No Data Collected				

<b>E9</b>	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.15	0.94	0	0
OCT 10	0.15	1.01	0	0
OCT 16	0.16	1.21	0	0
OCT 23	0.17	1.21	0	0
OCT 30	0.16	1.13	0	0
<b>SEP</b>				
SEP 5	0.24	1.37	0	0
SEP 11	0.18	1.05	0	0
SEP 18	0.21	1.07	0	0
SEP 25	0.11	0.80	0	0
<b>AUG</b>				
AUG 8	0.17	1.27	0	0
AUG 14	0.29	1.14	0	0
AUG 21	0.20	1.27	0	0
AUG 28	0.31	1.19	0	0
Blank Cell = No Data Collected				

<b>E10</b>	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.10	1.17	0	0
OCT 10	0.14	1.43	0	0
OCT 16	0.11	1.33	0	0
OCT 23	0.12	1.38	0	0
OCT 30	0.19	1.14	0	0
<b>SEP</b>				
SEP 5	0.30	1.47	0	0
SEP 11	0.19	1.14	0	0
SEP 18	0.16	1.07	0	0
SEP 25	0.13	1.16	0	0
<b>AUG</b>				
AUG 8	0.13	1.27	0	0
AUG 14	0.18	1.25	0	0
AUG 21	0.17	1.34	0	0
AUG 28	0.21	1.38	0	0
Blank Cell = No Data Collected				

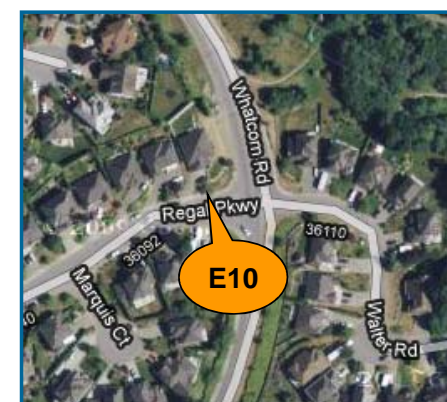

# Abbotsford Water Distribution System

## Recent Water Quality Results

Updated: 22-Nov-18



<b>E11</b>	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.12	1.07	0	0
OCT 10	0.15	1.22	0	0
OCT 16	0.18	1.50		
OCT 23	0.11	1.42	0	0
OCT 30	0.27	1.10	0	0
<b>SEP</b>				
SEP 5	0.26	1.21	0	0
SEP 11	0.19	1.02	0	0
SEP 18	0.15	1.07	0	0
SEP 25	0.14	1.10	0	0
<b>AUG</b>				
AUG 8	0.13	1.26	0	0
AUG 14	0.23	1.31	0	0
AUG 21	0.28	1.42	0	0
AUG 28	0.30	1.35	0	0
Blank Cell = No Data Collected				

<b>E12</b>	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.08	1.11	0	0
OCT 10	0.13	1.42	0	0
OCT 16	0.19	1.47	0	0
OCT 23	0.27	1.43	0	0
OCT 30	0.19	1.31	0	0
<b>SEP</b>				
SEP 5	0.25	1.48	0	0
SEP 11	0.18	1.22	0	0
SEP 18	0.13	1.05	0	0
SEP 25	0.12	1.36	0	0
<b>AUG</b>				
AUG 8	0.14	1.43	0	0
AUG 14	0.28	1.36	0	0
AUG 21	0.27	1.37	0	0
AUG 28	0.23	1.20	0	0
Blank Cell = No Data Collected				

<b>E13</b>	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.12	1.11	0	0
OCT 10	0.12	1.42	0	0
OCT 16	0.16	1.24	0	0
OCT 23	0.19	1.35	0	0
OCT 30	0.18	1.18	0	0
<b>SEP</b>				
SEP 5	0.26	1.36	0	0
SEP 11	0.07	1.00	0	0
SEP 18	0.28	0.91	0	0
SEP 25	0.09	0.92	0	0
<b>AUG</b>				
AUG 8	0.12	1.36	0	0
AUG 14	0.19	0.94	0	0
AUG 21	0.19	1.02	0	0
AUG 28	0.27	1.38	0	0
Blank Cell = No Data Collected				



# Abbotsford Water Distribution System

## Recent Water Quality Results

Updated: 22-Nov-18



<b>E14</b>	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.09	1.00	0	0
OCT 10	0.14	1.48	0	0
OCT 16	0.17	1.33	0	0
OCT 23	0.29	1.43	0	0
OCT 30	0.15	0.42	0	0
<b>SEP</b>				
SEP 5	0.28	0.35	0	0
SEP 11	0.16	0.52	0	0
SEP 18	0.22	0.91	0	0
SEP 25	0.18	1.26	0	0
<b>AUG</b>				
AUG 8	0.08	0.46	0	0
AUG 14	0.13	0.25	0	0
AUG 21	0.43	0.30	0	0
AUG 28	0.25	0.65	0	0


Blank Cell = No Data Collected

<b>E15</b>	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.07	1.07	0	0
OCT 10	0.14	1.01	0	0
OCT 16	0.15	1.17	0	0
OCT 23	0.21	1.37	0	0
OCT 30	0.15	0.96	0	0
<b>SEP</b>				
SEP 5	0.24	1.34	0	0
SEP 11	0.13	0.88	0	0
SEP 18	0.15	0.95	0	0
SEP 25	0.19	1.13	0	0
<b>AUG</b>				
AUG 8	0.15	1.27	0	0
AUG 14	0.17	1.24	0	0
AUG 21	0.29	1.39	0	0
AUG 28	0.28	1.26	0	0

Blank Cell = No Data Collected

<b>W1</b>	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.16	0.89	0	0
OCT 10	0.17	1.29	0	0
OCT 16	0.18	1.24	0	0
OCT 23	0.12	1.32	0	0
OCT 30	0.28	1.11	0	0
<b>SEP</b>				
SEP 5	0.28	1.08	0	0
SEP 11	0.16	1.01	0	0
SEP 18	0.13	0.74	0	0
SEP 25	0.21	0.87	0	0
<b>AUG</b>				
AUG 8	0.19	1.09	0	0
AUG 14	0.13	1.28	0	0
AUG 21	0.00	1.05	0	0
AUG 28	0.15	1.36	0	0

Blank Cell = No Data Collected

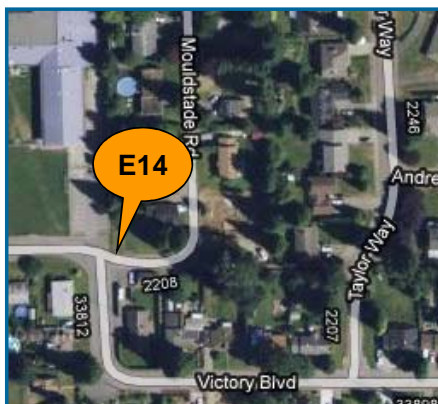

# Abbotsford Water Distribution System

## Recent Water Quality Results

Updated: 22-Nov-18



W2	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.22	1.00	0	0
OCT 10	0.24	1.28	0	0
OCT 16	0.14	1.32	0	0
OCT 23	0.11	1.33	0	0
OCT 30	0.17	1.12	0	0
<b>SEP</b>				
SEP 5	0.28	1.30	0	0
SEP 11	0.26	1.00	0	0
SEP 18	0.13	0.94	0	0
SEP 25	0.13	1.04	0	0
<b>AUG</b>				
AUG 8	0.22	1.36	0	0
AUG 14	0.17	1.23	0	0
AUG 21	0.19	1.27	0	0
AUG 28	0.13	1.27	0	0




Blank Cell = No Data Collected

W3	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.28	1.08	0	0
OCT 10	0.17	1.38	0	0
OCT 16	0.22	1.34	0	0
OCT 23	0.12	1.59	0	0
OCT 30	0.24	1.18	0	0
<b>SEP</b>				
SEP 5	0.29	1.34	0	0
SEP 11	0.16	1.06	0	0
SEP 18	0.14	1.09	0	0
SEP 25	0.18	1.26	0	0
<b>AUG</b>				
AUG 8	0.02	1.36	0	0
AUG 14	0.18	1.35	0	0
AUG 21	0.18	1.39	0	0
AUG 28	0.17	1.33	0	0

Blank Cell = No Data Collected

W4	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.09	0.97	0	0
OCT 10	0.18	1.36	0	0
OCT 16	0.16	1.27	0	0
OCT 23	0.18	1.36	0	0
OCT 30	0.21	0.87	0	0
<b>SEP</b>				
SEP 5	0.23	0.81	0	0
SEP 11	0.22	0.87	0	0
SEP 18	0.17	0.87	0	0
SEP 25	0.21	1.09	0	0
<b>AUG</b>				
AUG 8	0.14	0.68	0	0
AUG 14	0.19	0.85	0	0
AUG 21	0.18	0.60	0	0
AUG 28	0.18	0.96	0	0

Blank Cell = No Data Collected

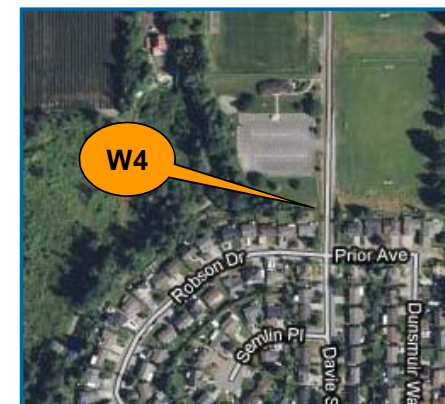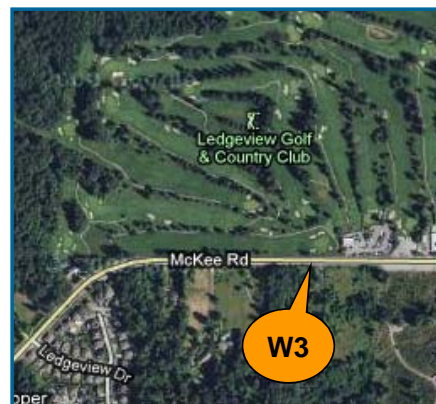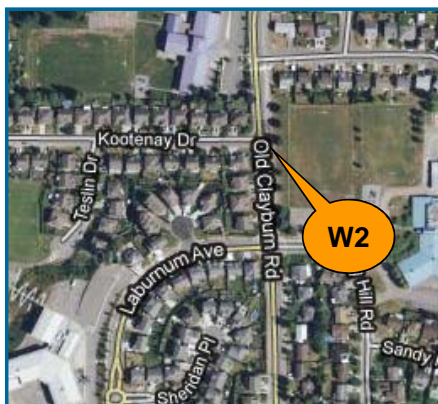

# Abbotsford Water Distribution System

## Recent Water Quality Results

Updated: 22-Nov-18



W5	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
OCT				
OCT 2	0.19	1.34	0	0
OCT 10	0.22	1.47	0	0
OCT 16	0.26	1.55	0	0
OCT 23	0.07	1.68	0	0
OCT 30	0.14	1.23	0	0
SEP				
SEP 5	0.22	1.44	0	0
SEP 11	0.39	1.18	0	0
SEP 18	0.12	1.20	0	0
SEP 25	0.09	1.38	0	0
AUG				
AUG 8	0.25	1.34	0	0
AUG 14	0.19	1.42	0	0
AUG 21	0.09	1.40	0	0
AUG 28	0.22	1.34	0	0



Blank Cell = No Data Collected

W6	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
OCT				
OCT 2	0.16	1.07	0	0
OCT 10	0.20	1.42	0	0
OCT 16	0.24	1.97	0	0
OCT 23	0.13	1.56	0	0
OCT 30	0.23	1.05	0	0
SEP				
SEP 5	0.28	1.25	0	0
SEP 11	0.22	1.10	0	0
SEP 18	0.16	1.12	0	0
SEP 25	0.21	1.33	0	0
AUG				
AUG 8	0.24	0.99	0	0
AUG 14	0.19	1.31	0	0
AUG 21	0.15	1.42	0	0
AUG 28	0.13	1.39	0	0

Blank Cell = No Data Collected

W7	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
OCT				
OCT 2	0.32	1.03	0	0
OCT 10	0.21	1.13	0	0
OCT 16	0.20	1.54	0	0
OCT 23	0.16	1.16	0	0
OCT 30	0.19	0.41	0	0
SEP				
SEP 5	0.28	0.50	0	0
SEP 11	0.15	0.54	0	0
SEP 18	0.11	0.84	0	0
SEP 25	0.19	1.10	0	0
AUG				
AUG 8	0.22	0.48	0	0
AUG 14	0.16	0.59	0	0
AUG 21	0.13	0.50	0	0
AUG 28	0.16	0.45	0	0

Blank Cell = No Data Collected

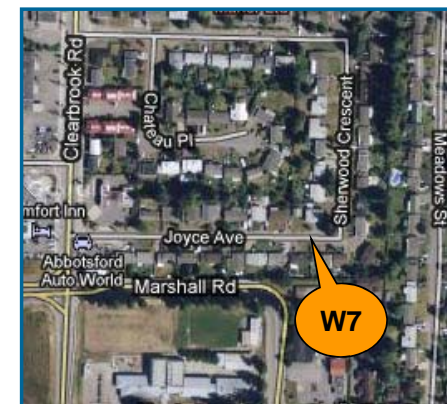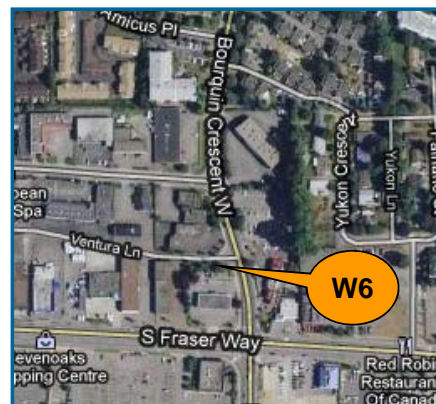



# Abbotsford Water Distribution System

## Recent Water Quality Results

Updated: 22-Nov-18



W8	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.22	0.43	0	0
OCT 10	0.22	0.53	0	0
OCT 16	0.15	1.07	0	0
OCT 23	0.13	0.61	0	0
OCT 30	0.38	0.20	0	0
<b>SEP</b>				
SEP 5	0.14	0.23	0	0
SEP 11	0.27	0.12	0	0
SEP 18	0.32	0.10	0	0
SEP 25	0.29	0.41	0	0
<b>AUG</b>				
AUG 8	0.20	0.35	0	0
AUG 14	0.21	0.69	0	0
AUG 21	0.11	0.38	0	0
AUG 28	0.10	0.26	0	0
Blank Cell = No Data Collected				

W9	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.19	0.74	0	0
OCT 10	0.20	0.77	0	0
OCT 16	0.25	1.60	0	0
OCT 23	0.10	0.89	0	0
OCT 30	0.11	0.40	0	0
<b>SEP</b>				
SEP 5	0.22	0.42	0	0
SEP 11	0.14	0.41	0	0
SEP 18	0.27	0.26	0	0
SEP 25	0.35	0.45	0	0
<b>AUG</b>				
AUG 8	0.23	0.43	0	0
AUG 14	0.19	0.31	0	0
AUG 21	0.19	0.43	0	0
AUG 28	0.19	0.36	0	0
Blank Cell = No Data Collected				

W11	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.23	1.08	0	0
OCT 10	0.23	1.33	0	0
OCT 16	0.19	1.33	0	0
OCT 23	0.22	1.30	0	0
OCT 30	0.21	1.11	0	0
<b>SEP</b>				
SEP 5	0.24	0.99	0	0
SEP 11	0.28	1.00	0	0
SEP 18	0.16	0.96	0	0
SEP 25	0.20	0.76	0	0
<b>AUG</b>				
AUG 8	0.25	0.75	0	0
AUG 14	0.15	1.01	0	0
AUG 21	0.19	0.97	0	0
AUG 28	0.24	0.87	0	0
Blank Cell = No Data Collected				



# Abbotsford Water Distribution System

## Recent Water Quality Results

Updated: 22-Nov-18



W13	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
OCT				
OCT 2	0.21	0.36	0	0
OCT 10	0.22	0.93	0	0
OCT 16	0.19	0.91	0	0
OCT 23	0.18	0.52	0	0
OCT 30	0.24	0.48	0	0
SEP				
SEP 5	0.19	1.16	0	0
SEP 11	0.25	0.55	0	0
SEP 18	0.17	0.39	0	0
SEP 25	0.18	0.32	0	0
AUG				
AUG 8	0.26	0.84	0	0
AUG 14	0.16	0.79	0	0
AUG 21	0.15	0.98	0	0
AUG 28	0.26	0.44	0	0

Blank Cell = No Data Collected

W14	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
OCT				
OCT 2	0.45	0.47	0	0
OCT 10	0.15	0.44	0	0
OCT 16	0.22	0.55	0	0
OCT 23	0.18	0.58	0	0
OCT 30	0.37	0.51	0	0
SEP				
SEP 5	0.18	0.37	0	0
SEP 11	0.18	0.40	0	0
SEP 18	0.18	0.36	0	0
SEP 25	0.37	0.59	0	0
AUG				
AUG 8	0.16	0.62	0	0
AUG 14	0.13	0.45	0	0
AUG 21	0.17	0.90	0	0
AUG 28	0.19	0.35	0	0

Blank Cell = No Data Collected

W15	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
OCT				
OCT 2	0.19	1.16	0	0
OCT 10	0.15	1.46	0	0
OCT 16	0.23	1.50	0	0
OCT 23	0.08	1.45	0	0
OCT 30	0.21	1.18	0	0
SEP				
SEP 5	0.17	1.40	0	0
SEP 11	0.26	1.05	0	0
SEP 18	0.16	1.08	0	0
SEP 25	0.23	1.26	0	0
AUG				
AUG 8	0.11	1.21	0	0
AUG 14	0.16	1.30	0	0
AUG 21	0.05	1.40	0	0
AUG 28	0.03	1.30	0	0

Blank Cell = No Data Collected



# Abbotsford Water Distribution System

## Recent Water Quality Results

Updated: 22-Nov-18



<b>W16</b>	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 1.2	< 10	0
<b>OCT</b>				
OCT 2	0.18	0.99	0	0
OCT 10	0.22	1.12	0	0
OCT 16	0.23	1.24	0	0
OCT 23	0.29	1.19	0	0
OCT 30	0.32	1.12	0	0
<b>SEP</b>				
SEP 5	0.24	0.95	0	0
SEP 11	0.38	0.83	0	0
SEP 18	0.18	0.74	0	0
SEP 25	0.21	0.67	0	0
<b>AUG</b>				
AUG 8	0.22	0.73	0	0
AUG 14	0.15	0.90	0	0
AUG 21	0.16	0.95	0	0
AUG 28	0.20	0.45	0	0

Blank Cell = No Data Collected



# Abbotsford Water Distribution System

## Recent Water Quality Results

Updated: 22-Nov-18



Parameter	Description	Acceptable Range
<b>Turbidity</b>	Suspended matter that interferes with the clarity of the water. While not a health concern itself, turbidity is an indicator of possible contamination.	There are no regulations for distribution system turbidity; water system operators aim for less than 1.0 NTU.
<b>Total Chlorine</b>	Used to monitor the level of disinfectant used to inactivate microorganisms such as bacteria and viruses.	There are no regulations for distribution system total chlorine; system operators aim to maintain 0.2 - 1.2 ppm. As long as there are no total coliforms, lower values are not a concern. Higher values are not deemed a health concern unless they exceed the World Health Organization's recommended limit of 5 ppm.
<b>Total Coliforms</b>	A group of bacteria that generally do not cause human disease, but their presence in water may indicate possible contamination.	The BC Drinking Water Act stipulates that no more than 10% of samples during a 30-day period may be positive for Total Coliforms and that no single sample may contain more than 10 counts.
<b>E. Coli</b>	A member of the Total Coliform group and its presence in water indicates contamination.	The BC Drinking Water Act stipulates that no E.Coli should be detected in drinking water.

**Note: Turbidity and Total Chlorine are measured with field instruments. Result trends are used as indicators of significant water quality changes; specific values are not necessarily accurate.**