


# Mission Water Distribution System

## Recent Water Quality Results

Updated: 1-Jul-21



### Sample Locations

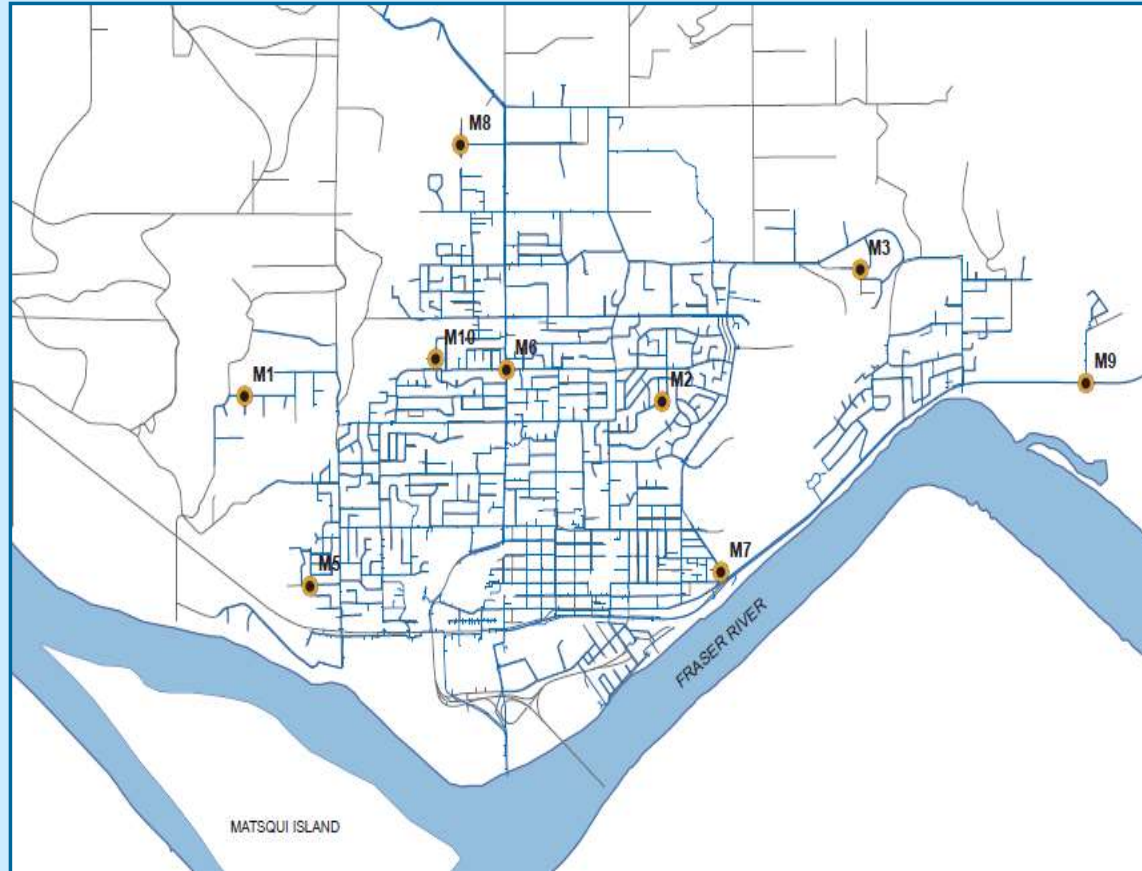

- Refer to following pages
- Water quality parameter descriptions on last

### Questions?

Paul Algra  
District of Mission Public Works  
604-820-3769  
palgra@mission.ca

# Mission Water Distribution System

## Recent Water Quality Results


Updated: 1-Jul-21



M1	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	ND	ND
JUN				
JUN 1	0.22	1.31	ND	ND
JUN 8	0.13	1.32	ND	ND
JUN 15	0.12	1.28	ND	ND
JUN 22	0.12	1.27	ND	ND
JUN 29	0.25	1.24	ND	ND
ND = Non-Detect Blank Cell = No Data Collected				

M2	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	ND	ND
JUN				
JUN 1	0.35	1.37	ND	ND
JUN 8	0.33	1.48	ND	ND
JUN 15	0.36	1.40	ND	ND
JUN 22	0.43	1.41	ND	ND
JUN 29	0.68	1.27	ND	ND
ND = Non-Detect Blank Cell = No Data Collected				

M3	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	ND	ND
JUN				
JUN 1	0.39	1.59	ND	ND
JUN 8	0.32	1.78	ND	ND
JUN 15	0.33	1.52	ND	ND
JUN 22	0.50	1.46	ND	ND
JUN 29	0.47	1.47	ND	ND
ND = Non-Detect Blank Cell = No Data Collected				

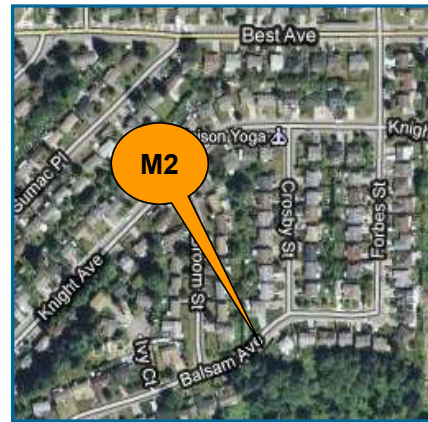

# Mission Water Distribution System

## Recent Water Quality Results

Updated: 1-Jul-21



<b>M5</b>	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	ND	ND
<b>JUN</b>				
JUN 1	0.26	1.02	ND	ND
JUN 8	0.31	0.75	ND	ND
JUN 15	0.08	1.14	ND	ND
JUN 22	0.12	1.02	ND	ND
JUN 29	0.27	0.88	ND	ND
ND = Non-Detect Blank Cell = No Data Collected				

<b>M6</b>	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	ND	ND
<b>JUN</b>				
JUN 1	0.43	1.68	ND	ND
JUN 8	0.36	1.77	ND	ND
JUN 15	0.37	1.68	ND	ND
JUN 22	0.55	1.52	ND	ND
JUN 29	0.48	1.63	ND	ND
ND = Non-Detect Blank Cell = No Data Collected				

<b>M7</b>	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	ND	ND
<b>JUN</b>				
JUN 1	0.27	1.40	ND	ND
JUN 8	0.16	1.35	ND	ND
JUN 15	0.13	1.34	ND	ND
JUN 22	0.35	1.39	ND	ND
JUN 29	0.46	1.33	ND	ND
ND = Non-Detect Blank Cell = No Data Collected				





# Mission Water Distribution System

## Recent Water Quality Results

Updated: 1-Jul-21



M8	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	ND	ND
JUN				
JUN 1	0.30	2.08	ND	ND
JUN 8	0.58	1.87	ND	ND
JUN 15	0.47	1.55	ND	ND
JUN 22	0.46	1.57	ND	ND
JUN 29	0.38	1.64	ND	ND
ND = Non-Detect Blank Cell = No Data Collected				

M9	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	ND	ND
JUN				
JUN 1	0.27	1.54	ND	ND
JUN 8	0.19	1.42	ND	ND
JUN 15	0.11	1.40	ND	ND
JUN 22	0.12	1.45	ND	ND
JUN 29	0.11	1.54	ND	ND
ND = Non-Detect Blank Cell = No Data Collected				

M10	Turbidity	Total Chlorine	Total Coliforms	E. Coli
Units	NTU	ppm	counts	counts
Target	< 1.0	0.2 - 2.2	ND	ND
JUN				
JUN 1	0.37	0.97	ND	ND
JUN 8	0.48	1.17	ND	ND
JUN 15	0.35	1.12	ND	ND
JUN 22	0.41	1.13	ND	ND
JUN 29	0.60	1.09	ND	ND
ND = Non-Detect Blank Cell = No Data Collected				



# Mission Water Distribution System

## Recent Water Quality Results

Updated: 1-Jul-21



Parameter	Description	Acceptable Range
<b>Turbidity</b>	Suspended matter that interferes with the clarity of the water. While not a health concern itself, turbidity is an indicator of possible contamination.	There are no regulations for distribution system turbidity; water system operators aim for less than 1.0 NTU.
<b>Total Chlorine</b>	Used to monitor the level of disinfectant used to inactivate microorganisms such as bacteria and viruses.	There are no regulations for distribution system total chlorine; system operators aim to maintain 0.2 - 2.2 ppm. As long as there are no total coliforms, lower values are not a concern. Higher values are not deemed a health concern unless they exceed the World Health Organization's recommended limit of 5ppm.
<b>Total Coliforms</b>	A group of bacteria that generally do not cause human disease, but their presence in water may indicate possible contamination.	The BC Drinking Water Act stipulates that no more than 10% of samples during a 30-day period may be positive for Total Coliforms and that no single sample may contain more than 10 counts.
<b>E. Coli</b>	A member of the Total Coliform group and its presence in water indicates contamination.	The BC Drinking Water Act stipulates that no E.Coli should be detected in drinking water.

**Note: Turbidity and Total Chlorine are measured with field instruments. Result trends are used as indicators of significant water quality changes; specific values are not necessarily accurate.**