


City of Mission Water Distribution System

Recent Water Quality Results

Updated: 2023-05-03 12:14

Sample Locations

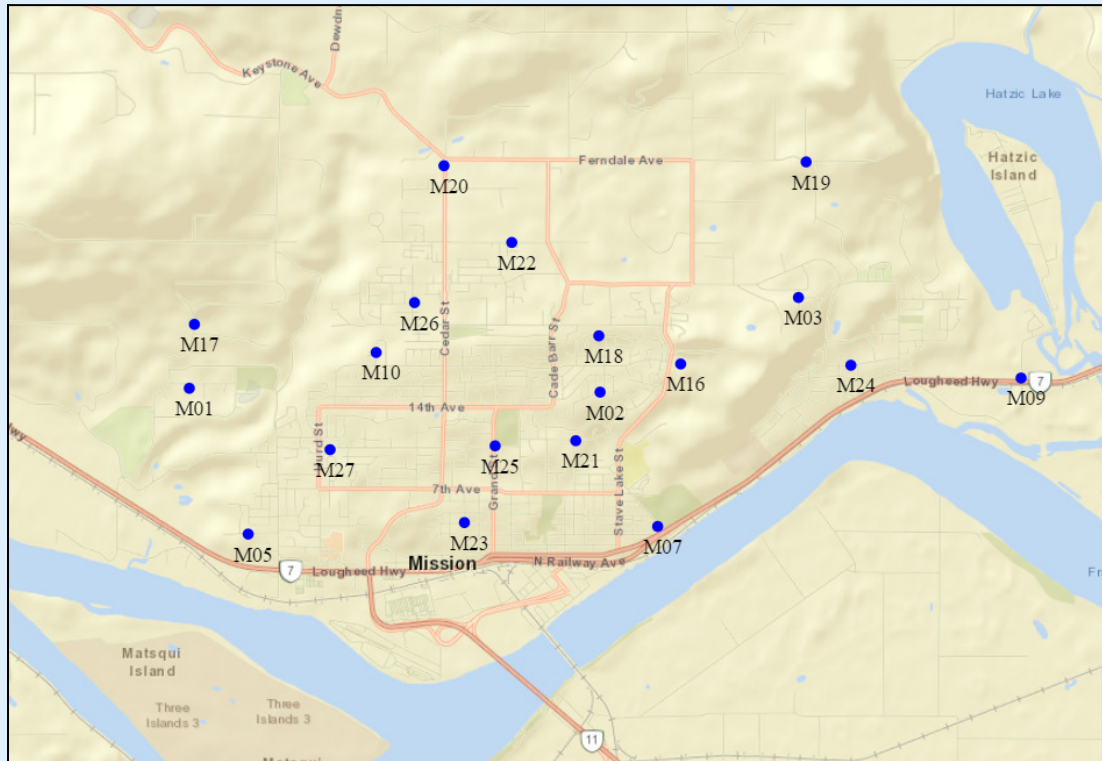

- Refer to following pages for results.
- Water quality parameter descriptions on last page.

Route A - M1, M16, M19, M21, M22, M23, M24, M26, M27

Route B - M2, M3, M4, M5, M7, M9, M17, M18, M20, M25

Each route is tested biweekly.

Questions?

District of Mission Public Works

604-820-3769

City of Mission Water Distribution System

Recent Water Quality Results

Updated: 2023-05-03 12:14



	Turbidity	Total Chlorine	Total Coliforms (counts)	E.coli (counts)
Units	NTU	mg/L	CFU/100mL	CFU/100mL
M01 - Israel				
March 14	0.11	1.98	0	0
March 28	0.14	1.92	0	0
M02 - Balsam				
March 7	0.30	1.90	0	0
March 21	0.27	2.13	0	0
M03 - Penner				
March 7	0.32	2.31	0	0
March 21	0.48	2.17	0	0
M05 - Hillcrest				
March 7	0.30	2.53	0	0
March 21	0.09	1.98	0	0
M07 - 4th & Mary				
March 7	0.38	3.16	0	0
March 21	0.10	2.00	0	0
M09 - Shook				
March 7	0.34	3.15	0	0
March 14	0.06	2.11	0	0
March 21	0.16	2.13	0	0
March 28	0.13	2.09	0	0
M10 - Miller				
March 7	0.30	2.70	0	0
March 21	0.15	1.87	0	0
M16 - Best @ Barker				
March 14	0.24	2.26	0	0
March 28	0.33	1.99	0	0
M17 - TH Booster				
March 7	0.10	1.85	0	0
March 21	0.09	1.74	0	0
M18 - Blueberry				
March 7	0.27	3.01	0	0
March 21	0.29	2.35	0	0
M19 - Ferndale @ Erikson				
March 14	0.27	2.66	0	0
March 28	0.29	2.66	0	0

City of Mission Water Distribution System

Recent Water Quality Results

Updated: 2023-05-03 12:14



	Turbidity	Total Chlorine	Total Coliforms (counts)	E.coli (counts)
Units	NTU	mg/L	CFU/100mL	CFU/100mL
M20 - DTR & Cedar				
March 7	0.38	2.84	0	0
March 21	0.25	2.59	0	0
M21 - 11th & Dunsmuir				
March 14	0.08	2.21	0	0
March 28	0.13	2.08	0	0
M22 - Tunbridge @ DTR				
March 14	0.26	2.68	0	0
March 28	0.29	2.59	0	0
M23 - 4th @ Alder				
March 14	0.09	2.15	0	0
March 28	0.10	2.06	0	0
M24 - Moffat				
March 14	<0.10	2.15	0	0
March 28	0.11	2.03	4.0*	0
March 31			0	0
M25 - 11th & Grand				
March 7	0.28	3.05	0	0
March 21	0.14	2.01	0	0
M26 - Fennel				
March 14	0.30	2.66	0	0
March 28	0.51	2.53	0	0
M27 - McRae & Hurd				
March 14	0.09	2.18	0	0
March 28	0.12	2.01	0	0
Blank Cell = No Data Collected				

City of Mission Water Distribution System

Recent Water Quality Results

Updated: 2023-05-03 12:14



Parameter	Description	Acceptable Range
Turbidity	Suspended matter that interferes with the clarity of the water. While not a health concern itself, turbidity is an indicator of possible contamination.	There are no regulations for distribution system turbidity; water system operators aim for less than 1.0 NTU.
Total Chlorine	Used to monitor the level of disinfectant used to inactivate microorganisms such as bacteria and viruses.	There are no regulations for distribution system total chlorine; system operators aim to maintain a detectable residual. As long as there are no total coliforms, lower values are not a concern. Higher values are not deemed a health concern unless they exceed the World Health Organization's recommended limit of 5ppm.
Total Coliforms	A group of bacteria that generally do not cause human disease, but their presence in water may indicate possible contamination.	The BC Drinking Water Act stipulates that no more than 10% of samples during a 30-day period may be positive for Total Coliforms and that no single sample may contain more than 10 counts.
E. Coli	A member of the Total Coliform group and its presence in water indicates contamination.	The BC Drinking Water Act stipulates that no E.Coli should be detected in drinking water.

Note: Turbidity and Total Chlorine are measured with field instruments. Result trends are used as indicators of significant water quality changes; specific values are not necessarily accurate.

***Low TC count detected. FH is informed of all adverse results.**