


City of Mission Water Distribution System

Recent Water Quality Results

Updated: 2023-09-06 15:26

Sample Locations

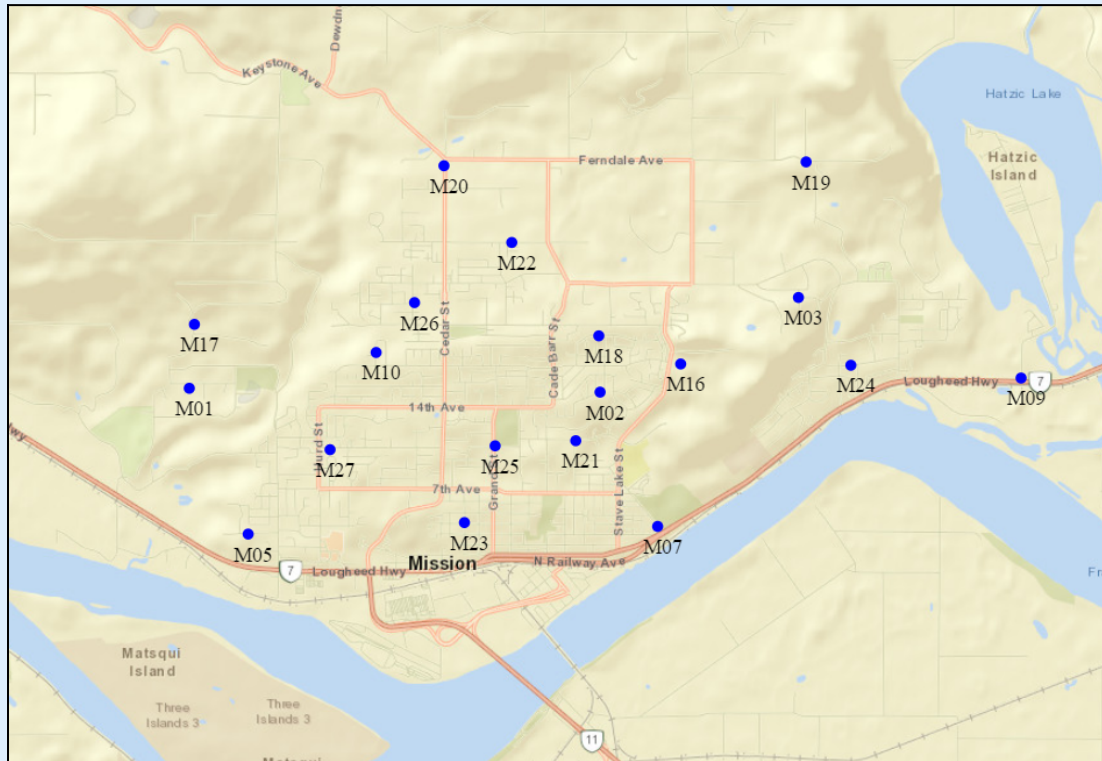

- Refer to following pages for results.
- Water quality parameter descriptions on last page.

Route A - M1, M16, M19, M21, M22, M23, M24, M26, M27

Route B - M2, M3, M4, M5, M7, M9, M17, M18, M20, M25

Each route is tested biweekly.

Questions?

District of Mission Public Works

604-820-3769

City of Mission Water Distribution System

Recent Water Quality Results

Updated: 2023-09-06 15:26



	Turbidity	Total Chlorine	Total Coliforms (counts)	E.coli (counts)
Units	NTU	mg/L	CFU/100mL	CFU/100mL
M01 - Israel				
August 1	0.28	2.08	0	0
August 15	0.28	1.76	0	0
August 29	0.17	1.47	0	0
M02 - Balsam				
August 9	0.45	2.02	0	0
August 22	0.28	1.95	0	0
M03 - Penner				
August 9	0.31	2.09	0	0
August 22	0.29	2.16	0	0
M05 - Hillcrest				
August 9	0.18	1.85	0	0
August 22	0.11	1.60	0	0
M07 - 4th & Mary				
August 9	0.15	1.93	0	0
August 22	0.13	1.74	0	0
M09 - Shook				
August 1	0.09	2.09	0	0
August 9	0.11	2.00	0	0
August 15	0.12	2.00	0	0
August 22	0.10	1.99	0	0
August 29	0.09	1.86	0	0
M10 - Miller				
August 9	0.29	1.93	0	0
August 22	0.28	1.89	0	0
M16 - Best @ Barker				
August 1	0.12	2.14	0	0
August 15	0.33	2.10	0	0
August 29	0.29	2.05	0	0
M17 - TH Booster				
August 9	0.20	1.92	0	0
August 22	0.13	1.58	0	0
M18 - Blueberry				
August 9	0.27	2.21	0	0
August 22	0.25	2.10	0	0

City of Mission Water Distribution System

Recent Water Quality Results

Updated: 2023-09-06 15:26



	Turbidity	Total Chlorine	Total Coliforms (counts)	E.coli (counts)
Units	NTU	mg/L	CFU/100mL	CFU/100mL
M19 - Ferndale @ Erikson				
August 1	0.31	2.14	0	0
August 15	0.26	1.93	0	0
August 29	0.31	1.97	0	0
M20 - DTR & Cedar				
August 9	0.31	2.38	0	0
August 22	0.33	2.25	0	0
M21 - 11th & Dunsmuir				
August 1	0.10	1.89	0	0
August 15	0.13	1.90	0	0
August 29	0.15	1.77	0	0
M22 - Tunbridge @ DTR				
August 1	0.35	2.24	0	0
August 15	0.32	2.20	0	0
August 29	0.31	2.16	0	0
M23 - 4th @ Alder				
August 1	0.09	1.95	0	0
August 15	0.10	1.90	0	0
August 29	0.12	1.74	0	0
M24 - Moffat				
August 1	0.11	1.91	0	0
August 15	0.13	1.78	0	0
August 29	0.14	1.81	0	0
M25 - 11th & Grand				
August 9	0.10	1.83	0	0
August 22	0.08	1.67	0	0
M26 - Fennel				
August 1	0.40	2.38	0	0
August 15	0.30	2.20	0	0
August 29	0.41	2.22	0	0
M27 - McRae & Hurd				
August 1	0.12	1.96	0	0
August 15	0.14	1.90	0	0
August 29	0.10	1.67	0	0
Blank Cell = No Data Collected				

City of Mission Water Distribution System

Recent Water Quality Results

Updated: 2023-09-06 15:26



Parameter	Description	Acceptable Range
Turbidity	Suspended matter that interferes with the clarity of the water. While not a health concern itself, turbidity is an indicator of possible contamination.	There are no regulations for distribution system turbidity; water system operators aim for less than 1.0 NTU.
Total Chlorine	Used to monitor the level of disinfectant used to inactivate microorganisms such as bacteria and viruses.	There are no regulations for distribution system total chlorine; system operators aim to maintain a detectable residual. As long as there are no total coliforms, lower values are not a concern. Higher values are not deemed a health concern unless they exceed the World Health Organization's recommended limit of 5ppm.
Total Coliforms	A group of bacteria that generally do not cause human disease, but their presence in water may indicate possible contamination.	The BC Drinking Water Act stipulates that no more than 10% of samples during a 30-day period may be positive for Total Coliforms and that no single sample may contain more than 10 counts.
E. Coli	A member of the Total Coliform group and its presence in water indicates contamination.	The BC Drinking Water Act stipulates that no E.Coli should be detected in drinking water.

Note: Turbidity and Total Chlorine are measured with field instruments. Result trends are used as indicators of significant water quality changes; specific values are not necessarily accurate.