


# City of Abbotsford Water Distribution System

Recent Water Quality Results

Updated: 2024-04-03 06:25

## Sample Locations

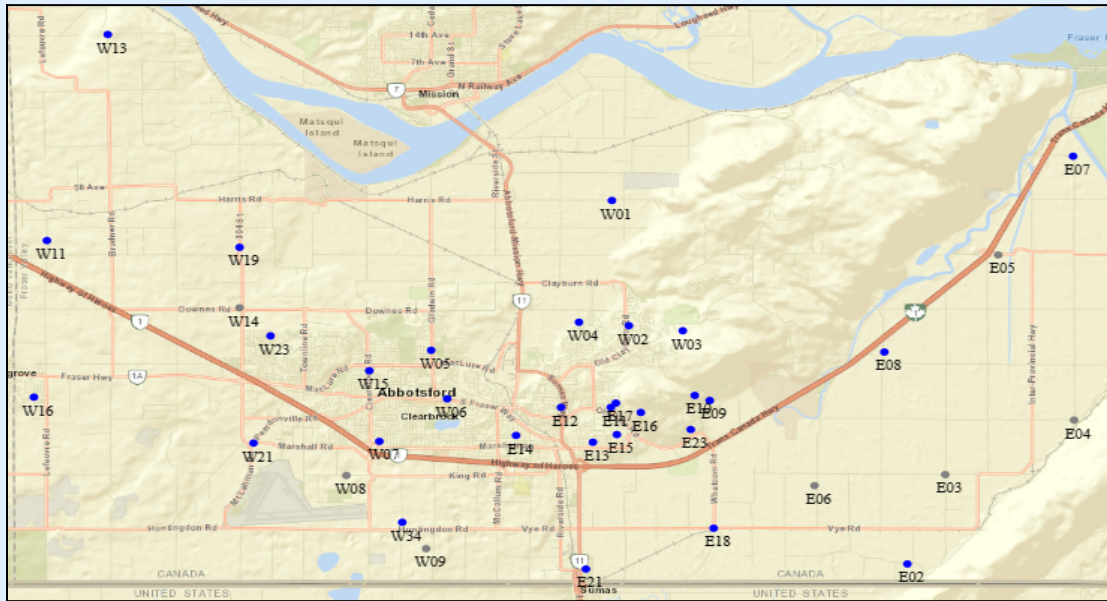

- Refer to following pages for results.
- Water quality parameter descriptions on last page.

### Week A

Southeast Route - E02, E07, E09, E10, E11, E12, E13, E14, E17, E18, W02, W03

Northwest Route - W01, W04, W05, W07, W11, W13, W15, W16, W19, W21, W23, W34

### Week B

Southeast Route - E07, E08, E09, E12, E13, E15, E16, E18, E21, E23, W02, W03

Northwest Route - W01, W04, W06, W07, W11, W13, W15, W16, W19, W21, W23, W34

Each week is tested biweekly.

**Note:** Sites E3, E4, E5, E6, W8, W9, and W14 still exist but are not used.

### Questions?

City of Abbotsford Engineering

604-864-5511

[eng-info@abbotsford.ca](mailto:eng-info@abbotsford.ca)

# City of Abbotsford Water Distribution System

Recent Water Quality Results

Updated: 2024-04-03 06:25



	Turbidity	Total Chlorine	Total Coliforms (counts)	E.coli (counts)
Units	NTU	mg/L	CFU/100mL	CFU/100mL
<b>E02 - 310 Arnold Road</b>				
February 13	0.21	1.67	0	0
February 27	0.39	1.51	0	0
<b>E07 - 6230 Tolmie Road</b>				
February 6	0.14	1.24	0	0
February 13	0.22	0.96	0	0
February 21	0.23	1.03	0	0
February 27	0.31	0.56	0	0
<b>E08 - 3434 McDermott Road</b>				
February 6	0.15	1.32	0	0
February 21	0.38	1.44	0	0
<b>E09 - 36232 Lower Sumas Mountain Road</b>				
February 6	0.15	1.75	0	0
February 13	0.20	1.95	0	0
February 21	0.23	1.94	0	0
February 27	0.25	1.57	0	0
<b>E10 - 36101 Regal Parkway</b>				
February 13	0.17	2.05	0	0
February 27	0.24	1.56	0	0
<b>E11 - 2598 St. Moritz Way</b>				
February 13	0.20	1.78	0	0
<b>E12 - 2691 Beck Road</b>				
February 6	0.11	1.95	0	0
February 13	0.34	2.11	0	0
February 21	0.24	1.96	0	0
<b>E13 - 2087 McMillan Road</b>				
February 6	0.16	1.85	0	0
February 13	0.19	1.97	0	0
February 21	0.19	1.78	0	0
<b>E14 - 2211 Mouldstade Road</b>				
February 13	0.32	1.34	0	0
<b>E15 - 2215 Orchard Drive</b>				
February 6	0.11	1.92	0	0
February 21	0.18	1.77	0	0

# City of Abbotsford Water Distribution System

Recent Water Quality Results

Updated: 2024-04-03 06:25



	Turbidity	Total Chlorine	Total Coliforms (counts)	E.coli (counts)
Units	NTU	mg/L	CFU/100mL	CFU/100mL
<b>E16 - 2540 Eagle Mountain Drive</b>				
February 6	0.22	1.67	0	0
February 21	0.34	1.79	0	0
<b>E17 - 2720 St. Moritz Way</b>				
February 13	0.16	1.86	0	0
<b>E18 - 36321 Vye Road</b>				
February 6	0.19	1.53	0	0
February 13	0.28	1.56	0	0
February 21	0.40	1.60	0	0
February 27	0.25	1.54	0	0
<b>E21 - 34694 5th Avenue</b>				
February 6	0.34	1.26	0	0
February 21	0.37	1.52	0	0
<b>E23 - 36026 Village Knoll</b>				
February 6	0.16	1.69	0	0
February 21	0.34	1.75	0	0
<b>W01 - 35041 Harris Road</b>				
February 6	0.51	1.75	0	0
February 13	0.26	2.04	0	0
February 21	0.31	1.72	0	0
February 27	0.15	1.46	0	0
<b>W02 - 3836 Old Clayburn Road</b>				
February 6	0.15	1.94	0	0
February 13	0.19	2.08	0	0
February 21	0.17	1.67	0	0
February 27	0.22	1.55	0	0
<b>W03 - 35944 McKee Road</b>				
February 6	0.17	1.80	0	0
February 13	0.18	1.84	0	0
February 21	0.13	1.92	0	0
February 27	0.26	1.53	0	0
<b>W04 - 34638 Bateman Road</b>				
February 6	0.25	1.26	0	0
February 13	0.21	1.68	0	0
February 21	0.33	1.71	0	0

# City of Abbotsford Water Distribution System

Recent Water Quality Results

Updated: 2024-04-03 06:25



	Turbidity	Total Chlorine	Total Coliforms (counts)	E.coli (counts)
Units	NTU	mg/L	CFU/100mL	CFU/100mL
<b>W05 - 3315 Gladwin Road</b>				
February 13	0.40	2.30	0	0
February 27	0.14	1.51	0	0
<b>W06 - 32961 South Fraser Way</b>				
February 6	0.22	1.82	0	0
February 21	0.20	1.81	0	0
<b>W07 - 32111 Joyce Avenue</b>				
February 6	0.67	1.25	0	0
February 13	0.17	1.38	0	0
February 21	0.26	1.73	0	0
February 27	0.20	1.55	0	0
<b>W11 - 5030 Lefevre Road</b>				
February 6	0.28	1.37	0	0
February 13	0.18	1.78	0	0
February 21	0.39	1.55	0	0
February 27	0.15	1.30	0	0
<b>W13 - 7942 Bradner Road</b>				
February 6	0.45	1.65	0	0
February 13	0.19	1.42	0	0
February 21	0.27	1.62	0	0
February 27	0.21	1.19	0	0
<b>W15 - 3154 Clearbrook Road</b>				
February 6	0.32	1.66	0	0
February 13	0.25	2.01	0	0
February 21	0.22	1.86	0	0
February 27	0.13	1.50	0	0
<b>W16 - 27875 Swensson Avenue</b>				
February 6	0.37	1.54	0	0
February 13	0.26	1.86	0	0
February 21	0.35	1.65	0	0
February 27	0.12	1.57	0	0
<b>W19 - 4945 Mt. Lehman Road</b>				
February 6	0.69	1.86	0	0
February 13	0.40	2.15	0	0
February 21	0.36	1.85	0	0

# City of Abbotsford Water Distribution System

Recent Water Quality Results

Updated: 2024-04-03 06:25



	Turbidity	Total Chlorine	Total Coliforms (counts)	E.coli (counts)
Units	NTU	mg/L	CFU/100mL	CFU/100mL
<b>W21 - 2059 Peardonville Road</b>				
February 6	0.26	1.47	0	0
February 13	0.19	1.37	0	0
February 21	0.33	1.62	0	0
February 27	0.15	1.50	0	0
<b>W23 - 3612 Blue Jay Street</b>				
February 6	0.25	1.70	0	0
February 13	0.14	2.04	0	0
February 21	0.17	1.81	0	0
<b>W34 - 926 Columbia Street</b>				
February 6	0.28	1.40	0	0
February 13	0.15	1.38	0	0
February 21	0.37	1.43	0	0
February 27	0.42	1.43	0	0
<b>Blank Cell = No Data Collected</b>				

# City of Abbotsford Water Distribution System

Recent Water Quality Results

Updated: 2024-04-03 06:25



Parameter	Description	Acceptable Range
<b>Turbidity</b>	Suspended matter that interferes with the clarity of the water. While not a health concern itself, turbidity is an indicator of possible contamination.	There are no regulations for distribution system turbidity; water system operators aim for less than 1.0 NTU.
<b>Total Chlorine</b>	Used to monitor the level of disinfectant used to inactivate microorganisms such as bacteria and viruses.	There are no regulations for distribution system total chlorine; system operators aim to maintain a detectable residual. As long as there are no total coliforms, lower values are not a concern. Higher values are not deemed a health concern unless they exceed the World Health Organization's recommended limit of 5ppm.
<b>Total Coliforms</b>	A group of bacteria that generally do not cause human disease, but their presence in water may indicate possible contamination.	The BC Drinking Water Act stipulates that no more than 10% of samples during a 30-day period may be positive for Total Coliforms and that no single sample may contain more than 10 counts.
<b>E. Coli</b>	A member of the Total Coliform group and its presence in water indicates contamination.	The BC Drinking Water Act stipulates that no E.Coli should be detected in drinking water.

**Note: Turbidity and Total Chlorine are measured with field instruments. Result trends are used as indicators of significant water quality changes; specific values are not necessarily accurate.**