


# Annual Water Quality Report 2025



Norrish Creek Surface Source  
New Coanda

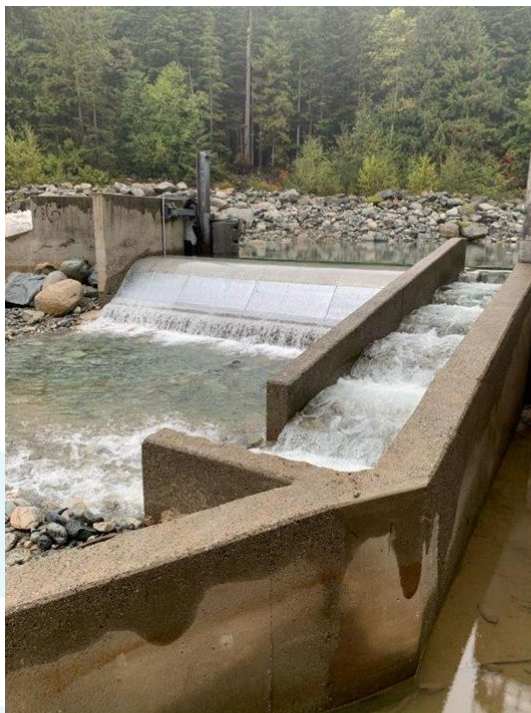

Bevan Wellfield - Groundwater  
Source

## EXECUTIVE SUMMARY

The regional water system delivers drinking water to the municipalities of Abbotsford and Mission, home to a population of over 200,000. The water supply is primarily drawn from Norrish Creek, which is treated by filtration and disinfection. The supply is augmented by secondary sources drawing from Cannell Lake and the Abbotsford-Sumas Aquifer which are treated by disinfection. Finished (i.e., treated) drinking water is conveyed through 95 km of transmission pipe and delivered within Abbotsford and Mission through distribution pipe networks of 850 km and 185 km of total pipe length, respectively. The water system is managed and operated by qualified and certified personnel to ensure that drinking water quality standards consistently meet or exceed applicable requirements.

A rigorous water quality monitoring program is in place to meet or exceed the requirements of British Columbia's *Drinking Water Protection Act* and *Drinking Water Protection Regulation*. Grab samples of finished water are collected from 64 dedicated sample stations throughout the transmission and distribution network of both municipalities to verify water quality compliance with Provincial regulatory requirements and the Guidelines for Canadian Drinking Water Quality (GCDWQ). Raw water samples from the surface and groundwater sources are also subjected to regular sampling and analysis. In addition to verification monitoring, continuous operational monitoring by online instrumentation is provided for key parameters to ensure that system performance remains within acceptable limits. A summary of verification and operational monitoring during 2024 is as follows:

### Surface Water Source (Norrish Creek and Cannell Lake)

- ✓ Raw water physical and chemical parameters routinely analyzed two times per year for each surface water source. All parameters were within applicable GCDWQ health-based limits.
- ✓ Continuous online monitoring of chlorine concentration (free and total) and pH of the treated water near the point of chlorine addition at the Cannell Lake and Norrish Creek water treatment plants (WTPs) as well as at the downstream points of ammonia addition at Cannon Pit and Bell Road stations, respectively.
- ✓ Continuous online turbidity monitoring of the raw, filtered, and finished water at multiple locations for water supplied by Norrish Creek and Cannell Lake, including downstream point of Bell Road and Cannon Pit.

### Groundwater Source (11 Active Production Wells)

- ✓ Raw water physical and chemical parameters analyzed for the production wells. All parameters met the GCDWQ (where applicable), with the exception of manganese concentration for 4

production wells exceeding aesthetic objective (AO) of 0.02 mg/L, but not exceeding the health-based Maximum Acceptable Concentration (MAC) of 0.12 mg/L.

- ✓ Raw water samples tested from 11 production wells prior to disinfection, 212 out of 237 (89.5%) yielded negative results for total coliforms and 100% yielded negative for *Escherichia coli* (*E. coli*).
- ✓ Annual testing of all production wells for pesticides and herbicides yielded results below the detection limits for all parameters analyzed.
- ✓ PFAS testing conducted at all water sources yielded no detectable results except at five production wells (Bevan 1 to 4 and Townline 2), resulting in follow-up testing and operational changes to minimize exposure to below the new Health Canada Objective Value of 30 ng/L.

### **Transmission & Distribution (64 Designated Sample Stations)**

- ✓ 2,643 routine weekly grab samples of finished water subjected to bacteriological testing, all but six samples (99.7%) yielded negative for total coliforms and all samples tested negative for *E. coli*, in compliance with Provincial regulatory requirements specified in Schedule A of the *Drinking Water Protection Regulation*.
- ✓ 2,782 routine weekly grab samples of finished water tested for turbidity; results indicate consistently low turbidity (i.e. < 1 NTU).
- ✓ 2,738 routine weekly grab samples of finished water tested for disinfectant residual (free chlorine or total chlorine); results indicate that under normal operation a measurable residual is consistently maintained throughout the water system (i.e. > 0.5 mg/L).
- ✓ Of the 21 grab samples of finished water tested for disinfection by-products (trihalomethanes, haloacetic acids, and N-nitrosodimethylamine), all results were within applicable GCDWQ limits.
- ✓ Of 39 grab samples of the finished water tested for metals, all results were within applicable GCDWQ health-based limits.



**Table of Contents**

**EXECUTIVE SUMMARY ..... i**

**1 Introduction ..... 1**

**2 Description of Water Systems ..... 1**

    2.1 Regional Supply System – Source, Treatment, and Transmission .....1

    2.2 City Systems – Distribution .....6

    2.3 Volume of Water Produced by Source .....8

**3 Water Quality monitoring program ..... 10**

    3.1 Overview .....10

    3.2 Source Water Quality Monitoring .....11

    3.3 Cannel Filtration Exemption Monitoring .....14

    3.4 Distribution Water Quality Monitoring .....16

    3.5 PFAS Monitoring .....21

**4 System Maintenance ..... 23**

    4.1 Overview .....23

    4.2 Staff Certification & Training .....25

    4.3 Capital Improvements and Operational Highlights for 2025 .....26

    4.4 Works Planned for 2026 .....27

    4.5 Emergency Response Planning .....29

**5 Conclusions ..... 30**

**Appendix A – Message preventing water-borne infections ..... 32**

**Appendix B – Metals in Drinking Water ..... 33**

**Appendix C – Raw Water Quality - Surface Water ..... 34**

**Appendix D – Raw Water Quality – Selected Parameters - Groundwater ..... 35**

**Appendix E – Microbiology - Raw Groundwater ..... 39**

**Appendix F – Microbiology - Treated Water ..... 40**

**Appendix G – Pesticides and Herbicides - Raw Groundwater ..... 41**

**Appendix H – Treated Water Quality Results – Metals (Distribution Systems) ..... 44**

**Appendix I – Disinfection By-Products (DBP) - Treated Water ..... 45**

**Appendix J – PFAS Test Results ..... 46**

## 1 INTRODUCTION

The City of Abbotsford and the City of Mission jointly own the regional water system (Joint System) that supplies potable water to the two communities. Under agreement, Abbotsford is the appointed Operator tasked with the operation and management of the Joint System. Internally, within each community, the distribution of potable water to customers is the responsibility of the respective municipality and its associated infrastructure (City Systems).

The Joint System and the City Systems are managed and operated by qualified personnel, including Environmental Operators Certification Program (EOCP) certified operators, to ensure that safe and reliable potable water is delivered to customers, as required by regulation and verified by routine water quality monitoring. Water supply systems in British Columbia are regulated under the Drinking Water Protection Act (DWPA) and the Drinking Water Protection Regulation (DWPR), which sets requirements and responsibilities to ensure that the water supplied is potable and meets all requirements specified in regulations or in the systems operating permits.

Section 15 of the DWPA requires a water supplier to make public the monitoring results required under the regulation, and Section 10 of the DWPR requires that this be done by publishing an annual report of such monitoring results within 6 months of the end of each calendar year. This Annual Water Quality Report fulfills this requirement for the Joint and City Systems of Abbotsford and Mission and is made available to the public by posting on Our Water Matters website: <https://www.ourwatermatters.ca/water-quality>.

The remainder of this report includes a description of the systems (Section 2), an overview of the water sampling and testing program (Section 3), and a summary of system maintenance work completed in 2025 and planned for 2026 (Section 4). Appendices include additional relevant information, including water quality test results (Appendices C through J).

## 2 DESCRIPTION OF WATER SYSTEMS

### 2.1 Regional Supply System – Source, Treatment, and Transmission

The Regional Supply System abstracts raw water from the environment, processes it to potable water standards in treatment facilities, and delivers it to the Cities Systems for distribution via its transmission pipelines and finished water storage facilities, supplying approximately 200,000 people. The Regional Supply System consists of the following critical infrastructure:

- Norrish Creek intake and water treatment plant facilities
- Dickson Lake Reservoir, including dam and control structure
- Approximately 95 km of large diameter transmission pipeline, including two river crossings
- Two finished water storage facilities: Maclure (Abbotsford) and Mount Mary Ann (Mission)
- Two ammonia addition stations at Bell Road (Norrish water) and Cannons Pit (Cannell water)
- Eleven production wells across five wellfields, extracting groundwater from the Abbotsford-Sumas Aquifer, and associated chlorine and ammonia addition facilities

## Norrish Creek

The Norrish Creek Watershed, located northeast of Mission, provides the bulk of Abbotsford and Mission's drinking water. Norrish Creek water is filtered by slow sand or ultrafiltration membranes at the Norrish Creek Water Treatment Plant (NCWTP). Filtered water is chlorinated at the plant outlet using chlorine gas before entering the transmission pipeline, flowing 7.5 km to the Bell Road Ammonia Station, where aqueous ammonia is added to form monochloramine as a residual disinfectant that will persist throughout the distribution system.



Norrish Creek Water Treatment Plant

## Cannell Lake

Cannell Lake, located within northern Mission, supplies water to consumers located in the higher elevations of Mission. It also supplements lower parts of Mission and Abbotsford when the demand is high or when the Norrish supply is off-line or curtailed. Raw Cannell Lake water is conveyed 1 km downstream of the intake to the Cannell Lake Water Treatment Plant (CLWTP) where it is disinfected by ultraviolet light (UV) and sodium hypochlorite, which is generated on-site. Water then travels 7 km by transmission pipeline to the Cannons Pit Ammonia Station to form monochloramine before continuing to the distribution system.



Cannell Lake

## Groundwater Wells

The Regional Supply System supplements surface water supply with groundwater extracted by several production wells that draw from the Abbotsford-Sumas Aquifer (**Figure 2-2**). Chlorine and ammonia are added to extracted water to form monochloramine and facilitates blending of water from different sources. Chlorine and ammonia are added at disinfection stations located at the Bevan, Marshall, Townline, and Farmer wellfields.



Production Well

As a transboundary aquifer with an approximate area of 161 km<sup>2</sup>, the Abbotsford-Sumas aquifer extends across the Fraser Valley from southern Abbotsford and Langley on the Canadian side to northern Whatcom

County in Washington State. The aquifer is classified by the Province of BC as an unconfined aquifer comprising sand and gravel sediments (glaciofluvial outwash), formed towards the end of the last glaciation (Fraser Glaciation). There are areas where the aquifer is confined (e.g., areas where the Bevan and Marshall wellfields are located). The aquifer is considered highly productive.

The Regional Supply System configuration is illustrated in **Figure 2-1**. Groundwater sources supply Abbotsford's City system directly. For surface sources, the transition from Regional to City systems occurs at metered take-off points co-located at pressure reducing valve (PRV) stations or the outlet of the finished water storage facilities of Maclure (28.6 ML) in Abbotsford and Mount Mary Ann (6.8 ML) in Mission.

During recent years (2021-2025), the annual contribution of the three sources to the volume of water supplied has been 64% (Norrish), 12% (Cannell), and 24% (Aquifer). While the contribution of Norrish tends to be consistent year-round, Cannell Lake and the Abbotsford-Sumas Aquifer provide seasonal supply augmentation and their contributions are seasonally dependent. The contribution from Cannell may decrease to about 10% during summer months and increase to 25% during winter, while the contribution from the aquifer may increase to nearly 30% in the summer months and decrease to less than 10% during the winter.

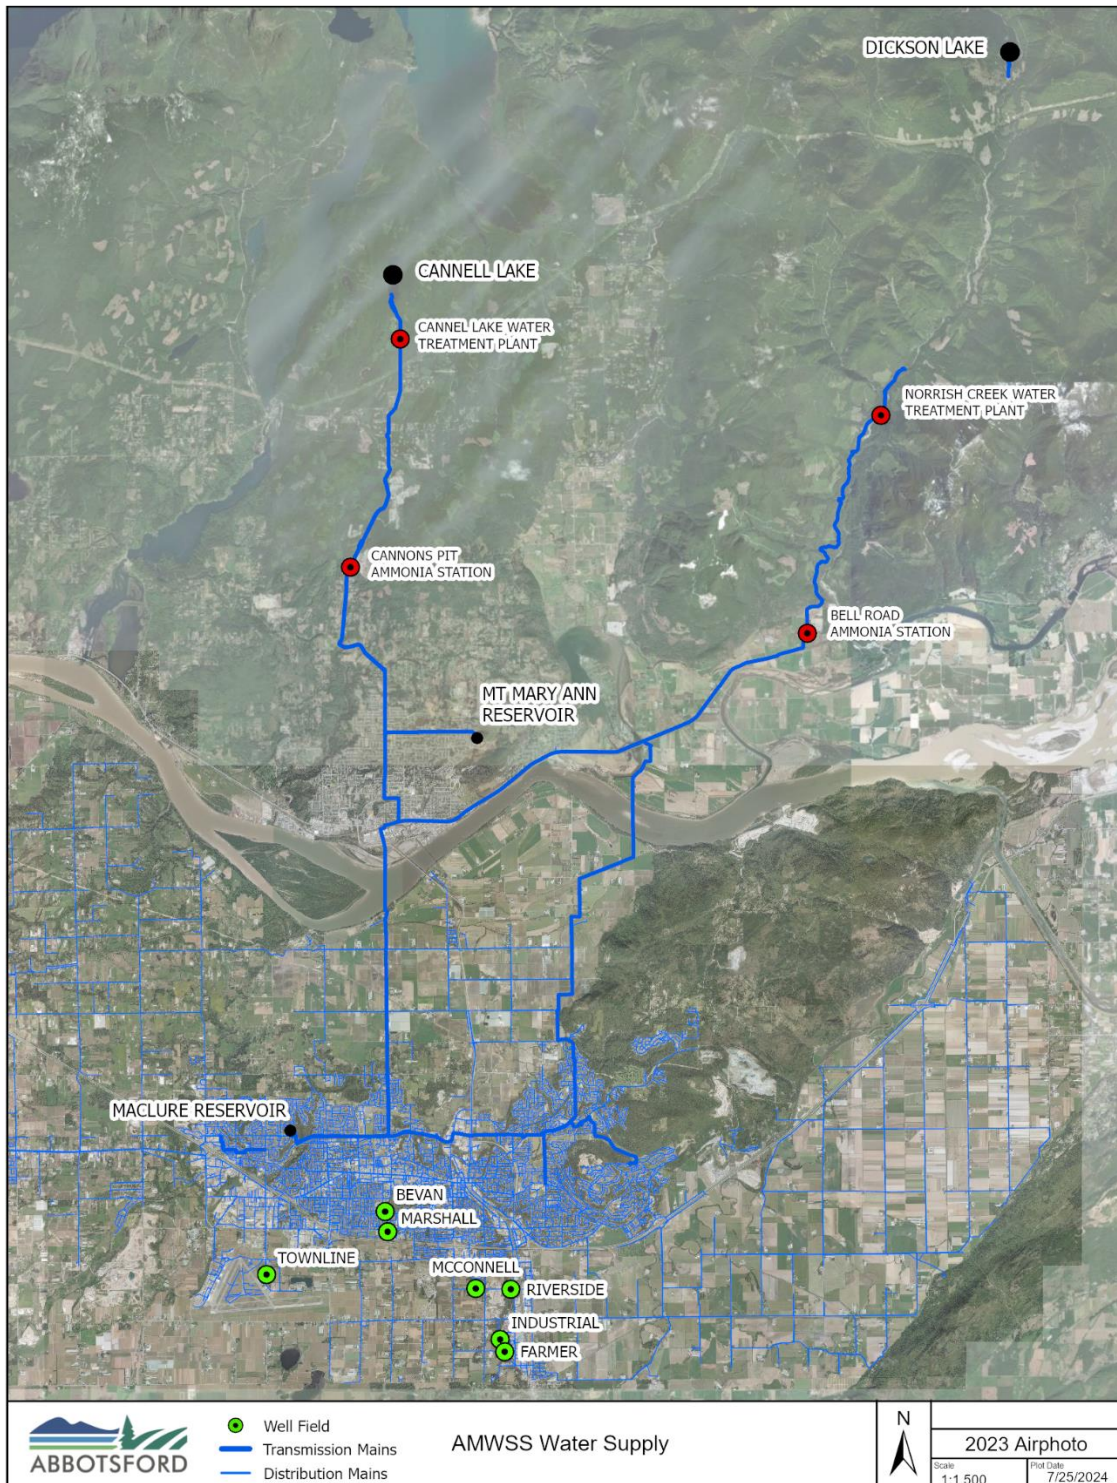


Figure 2-1: The Joint System serving water to Abbotsford and Mission.

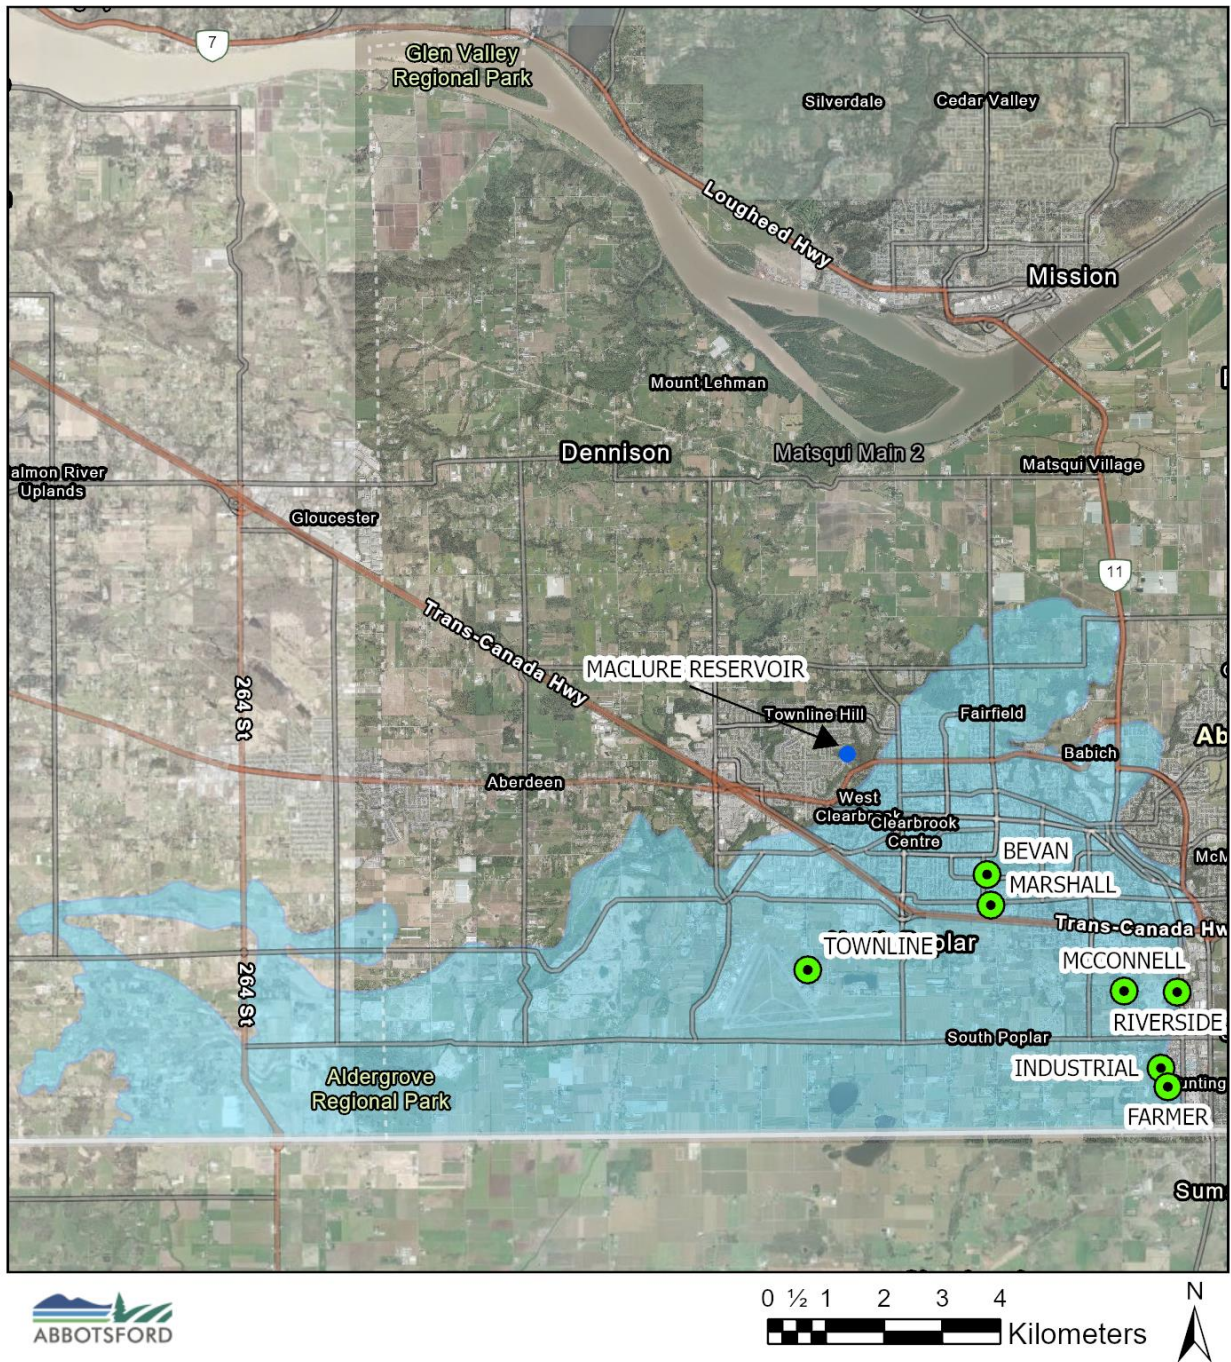


Figure 2-2. The approximate delineation of the Canadian portion of the Abbotsford – Sumas Aquifer (blue shaded area) and the wellfields.

## 2.2 City Systems – Distribution

The City of Abbotsford water distribution system consists of 25 pressure zones and approximately 850 km of pipe network, including 10 finished water storage facilities, 13 pump stations, 27 pressure reducing valve stations, and serves approximately 30,000 residential and non-residential customer connections. **Figure 2-3** show the City of Abbotsford Distribution System.

The City of Mission water distribution system consists of 9 pressure zones and approximately 235 km of pipe network, including 1 booster pump station, 27 pressure reducing valve stations, 2 pressure sustaining valve stations, and serves approximately 11,000 residential and non-residential customer connections. **Figure 2-4** show the City of Mission Distribution System.



VICARRO PUMP STATION,

*Completed in 2022, located near the inter section of Wells Gray Avenue and McKinley Drive.*



WATER MAIN – 150 MM DIAMETER,

*The water main is exposed following the repair of a leak in 2024 (South Fraser Way).*

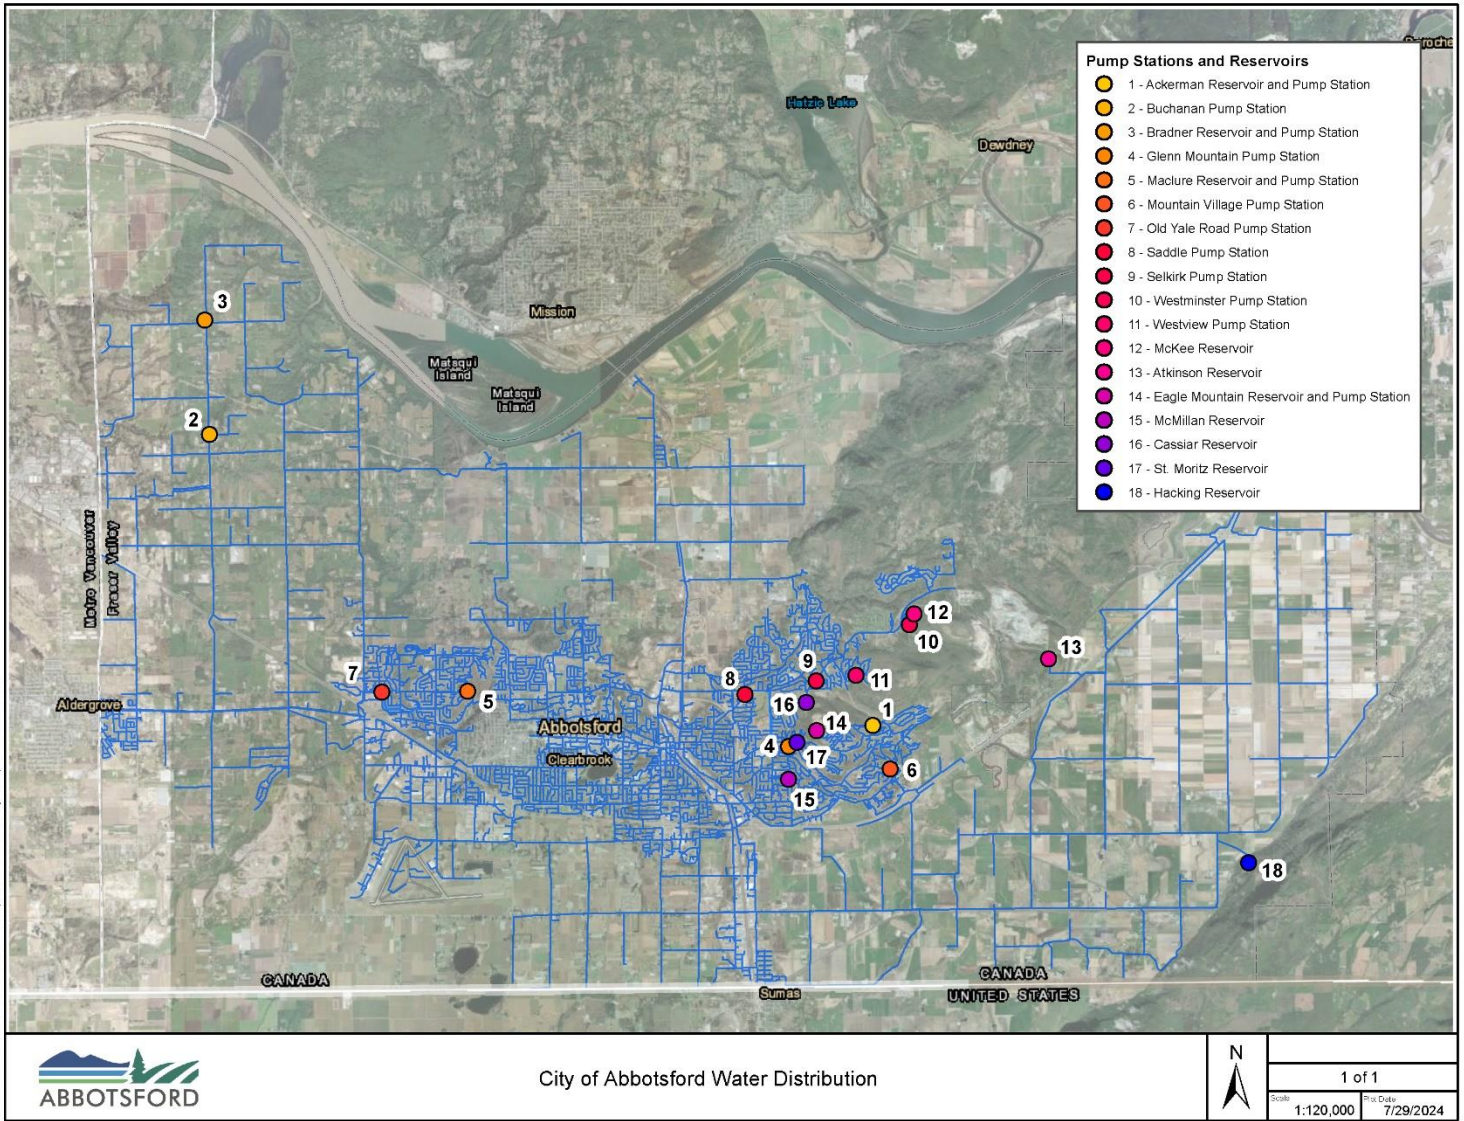


Figure 2-3: City of Abbotsford Water Distribution System

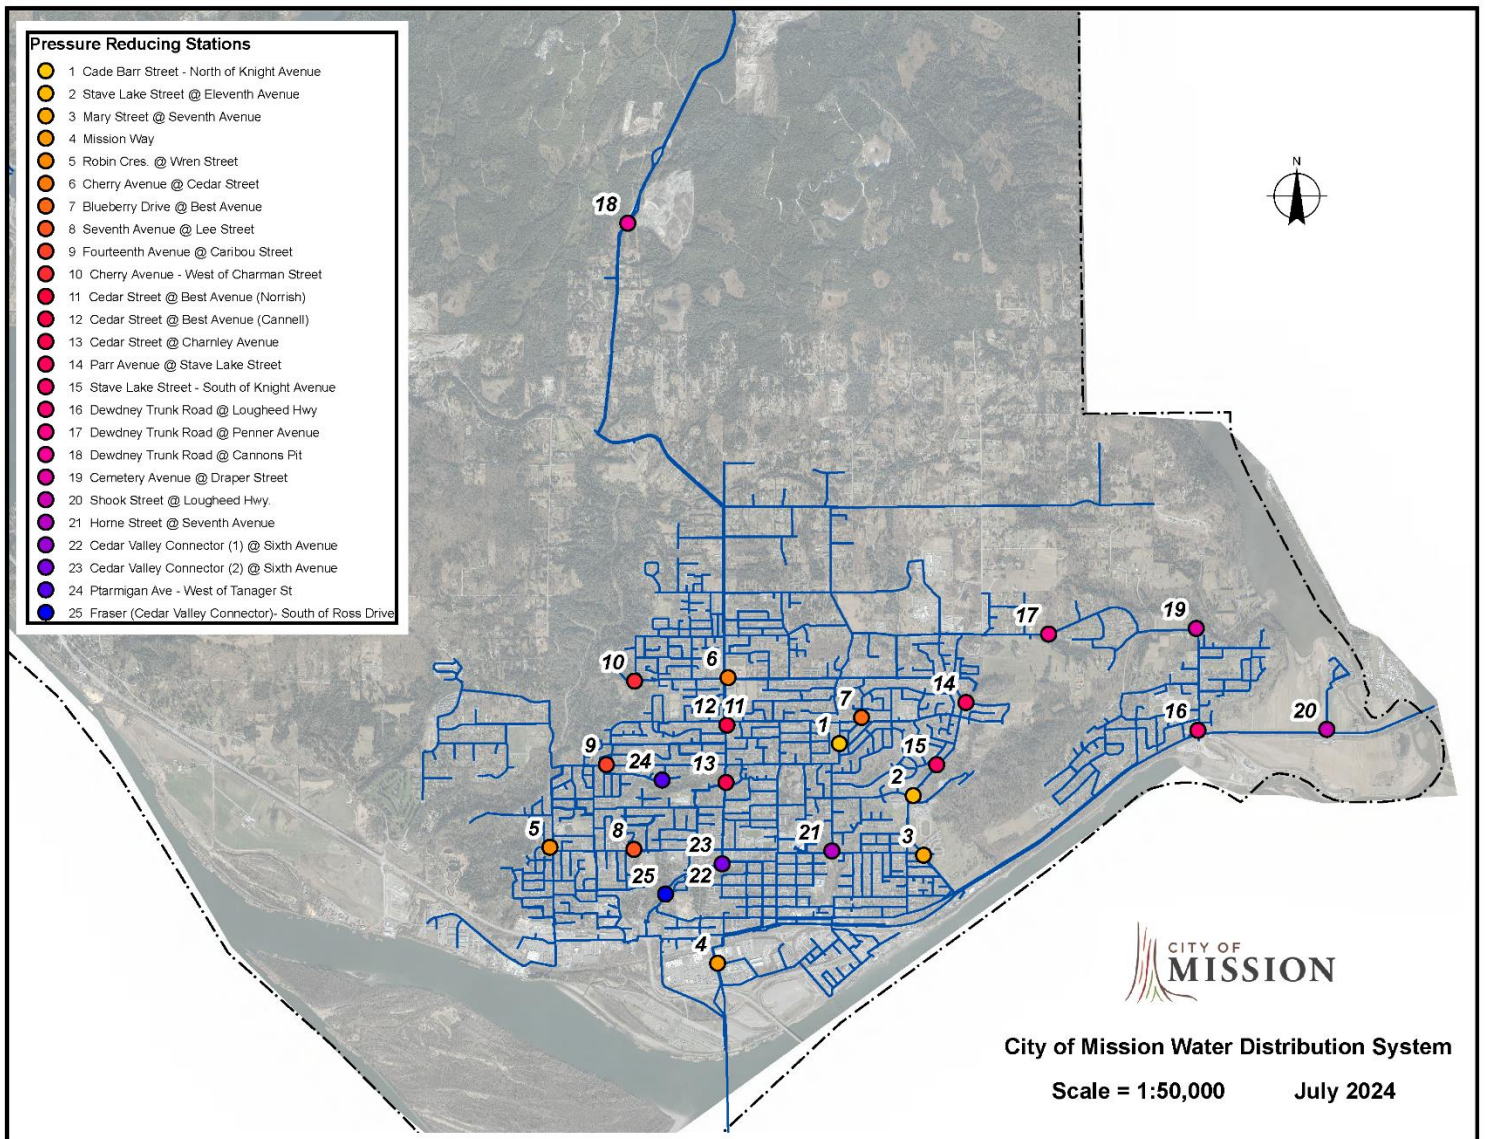


Figure 2-4: City of Mission Water Distribution System.

### 2.3 Volume of Water Produced by Source

The volumes of water supplied from all sources from 2021 to 2025 are summarized in **Table 2.1**. Total water production in 2025 was 26,627 ML, an increase of 1.4% relative to the five-year average (2021 to 2025) of approximately 26,244 ML and well below the population growth over this period. The contributions from surface water and groundwater sources in 2025, were 71% and 29%, respectively, comparable to the five-year average (2021 – 2025) of 76% and 24%.

Source <sup>1</sup>	2021	2022	2023	2024	2025
	Total	Total	Total	Total	Total
Norrish Creek	16,530	16,892	16,480	18,015	15,999
Cannell Lake	4,575	3,556	2,984	2,152	2,976
Farmer #1 Well	278	1,056	980	738	792
Farmer #3 Well	145	0	158	584	837
Industrial A Well	183	18	0	0	0
Industrial B Well	259	205	13	0	0
Industrial C Well	468	486	100	323	902
Marshall #1 Well	360	547	523	416	220
Marshall #3 Well	1,412	1,118	1,093	1,469	1,153
McConnell Well	2	0	0	0	0
Riverside #1 Well	9	1	1	0	0
Townline #1 Well	0	0	236	985	152
Townline #2 Well	434	514	573	600	407
Bevan #1 Well	294	324	600	208	641
Bevan #2 Well	294	236	1,102	328	785
Bevan #3 Well	342	430	1,172	278	909
Bevan #4 Well	464	358	517	152	853
<b>Total Production</b>	<b>26,051</b>	<b>25,744</b>	<b>26,553</b>	<b>26,248</b>	<b>26,627</b>
<b>Total Surface Water</b>	<b>21,105</b>	<b>20,447</b>	<b>19,463</b>	<b>20,167</b>	<b>18,974</b>
<b>Total Groundwater</b>	<b>4,945</b>	<b>5,292</b>	<b>7,088</b>	<b>6,081</b>	<b>7,652</b>

<sup>1</sup> Note: Industrial 'A', Industrial 'B', McConnell, and Riverside #1 were not in production in 2025.

**Table 2-1: Annual Water Production in Megaliters (ML)**

### 3 WATER QUALITY MONITORING PROGRAM

#### 3.1 Overview

Abbotsford and Mission staff work in their respective roles to monitor drinking water quality according to regulatory requirements and drinking water industry best practice. The purpose of routine monitoring of water quality is to confirm that drinking water delivered to customers complies with the quality standards and guidelines for potable water (compliance monitoring) and to verify the system as a whole is functioning safely and within normal limits (verification monitoring).

Routine monitoring practices are based on the requirements of the Drinking Water Protection Act and Drinking Water Protection Regulation and consist of discreet grab samples taken at various sampling locations throughout the system, including sources, transmission and distribution systems. Parameters analyzed and associated sampling frequencies are summarized in Table 3-1.

Parameter		Raw Water		Finished Water
		Surface Sources	Wells	
Chemical	Metals	3 x per year	~Monthly	~Quarterly
	Herbicides & Pesticides	-	Annually	-
	Disinfection By-Products	-	-	3 x per year
Microbiological	Total Coliform & <i>E. coli</i>	Weekly	Monthly	Weekly

**Table 3-1: Verification Water Quality Monitoring**

The acceptable limits for chemical parameters in finished water are generally interpreted as the applicable health-based maximum acceptable concentrations (MAC) published by Health Canada in the GCDWQ, available at:

<https://www.canada.ca/en/health-canada/services/environmental-workplace-health/reports-publications/water-quality/guidelines-canadian-drinking-water-quality-summary-table.html>.

Acceptable limits for microbiological parameters in finished water are specified in the Drinking Water Protection Regulation. The GCDWQ also provides non-health-based limits of aesthetic objectives (AO).

Analysis of samples for compliance monitoring are conducted at certified laboratories and typically require a period of days to weeks to receive results. In addition, operational monitoring is conducted of parameters that may be analyzed rapidly in the field, typically in seconds to minutes. Operational monitoring is performed either using discrete grab samples using handheld or portable instruments or continuously using automated online instrumentation. Operational monitoring allows for rapid detection of any deviations from normal operation and the timely use of corrective actions to restore system control or the activation of emergency response procedures. Water quality parameters typically used for operational monitoring include physical parameters (e.g. turbidity, temperature, conductivity, pH, UV transmittance etc.) and chemical parameters (e.g. chlorine residual, ammonia, nitrite).

**Appendices C - J** includes results for relevant water quality results. For additional water quality results and/or questions, please contact the City of Abbotsford Engineering Department (604-864-5514).

Presented water quality results:

- ✓ **Appendix C** – Raw Water Quality - Surface Water
- ✓ **Appendix D** – Raw Water Quality – Selected Parameters - Groundwater
- ✓ **Appendix E** – Microbiology - Raw Groundwater
- ✓ **Appendix F** – Microbiology - Treated Water
- ✓ **Appendix G** – Pesticides and Herbicides - Raw Groundwater.
- ✓ **Appendix H** – Treated Water Quality Results - Metals (Distribution Systems).
- ✓ **Appendix I** – Disinfection By-Products - Treated Water
- ✓ **Appendix J** – PFAS – Raw Water

## 3.2 Source Water Quality Monitoring

### 3.2.1 Surface Water

The quality of raw source water may influence the level of treatment required to produce potable water satisfying all applicable standards. Both Norrish Creek and Cannell Lake raw water are tested annually for various physical and chemical parameters. In general, the water quality of the surface sources has remained consistent over the years. Cannell Lake raw water monitoring includes additional parameters related to the filtration exemption discussed in Section 3.3.

### 3.2.2 Groundwater

Raw groundwater quality results for 2025 are provided in **Appendices D & E**. Parameters of note are further discussed below.

#### Arsenic

Arsenic can be found naturally occurring in both surface water and groundwater sources, with levels generally higher in groundwater. Most provinces and territories across Canada report some areas where arsenic can be detected in drinking water sources. Although levels are generally below the guideline, elevated arsenic concentrations have been found in areas with natural sources.<sup>1</sup> The MAC is currently 10 µg/L, and as low as reasonably achievable (ALARA); although Health Canada recently has proposed lowering the MAC to 5 µg/L.

Production wells Industrial B (not in service) and Industrial C (in service) are the only two wells that have historically elevated total arsenic concentration in the groundwater that has been at or above the MAC. In 2025, production wells with elevated arsenic concentrations in the groundwater (*but below MAC*) are Farmer 3 (5.08 – 5.17 µg/L) and Marshall 1 (4.08 – 4.55 µg/L), shown in **Appendix D**.

#### Iron

Iron in water is typically mainly attributed to the weathering of rocks and minerals, but can also originate as a consequence of acid mine drainage, landfill leachates, sewage effluents and iron-related industries<sup>2</sup>. Elevated iron can lead to aesthetic issues such as coloured water, objectionable taste, and the staining of plumbing. The GCDWQ originally specified an AO for total iron of 300 µg/L but was reduced to 100 µg/L in 2025. The results of analysis of samples collected from the production wells suggest that the raw extracted water meets the newly established AO, with the exception of Bevan 2 (128 µg/L) and Bevan 4 (104 µg/L).

#### Manganese

Manganese is naturally occurring in most water sources. Moderate levels of manganese may cause plumbing and laundry staining; while high levels of prolonged exposure have been correlated to adverse neurological effects in young children<sup>3</sup>. The GCDWQ specifies an AO of 20 µg/L for manganese and a health-based MAC of 120 µg/L. In 2025, raw water from four (4) production wells (Farmer 1, Industrial C, Townline 1 and Townline 2) exceeded the AO but not the MAC, with maximum values ranging from 23.3 µg/L (Townline 2) to 99.5 µg/L (Farmer 1).

#### Nitrate & Nitrite

---

<sup>1</sup> Health Canada, May 2006. Guidelines for Canadian Drinking Water Quality: Guideline Technical Document – Arsenic Retrieved from: <http://healthycanadians.gc.ca/publications/healthy-living-vie-saine/water-arsenic-eau/index-eng.php>

<sup>2</sup> Health Canada, December, 1978. Guidelines for Canadian Drinking Water Quality: Guideline Technical Document – Iron Retrieved from: <http://healthycanadians.gc.ca/publications/healthy-living-vie-saine/water-iron-fer-eau/index-eng.php>

<sup>3</sup> Health Canada, May, 2019. Guidelines for Canadian Drinking Water Quality: Guideline Technical Document – Manganese Retrieved from: [pub-manganese-0212-2019-eng.pdf](http://pub-manganese-0212-2019-eng.pdf) ([canada.ca](http://canada.ca))

Nitrate itself is a relatively non-toxic substance. However, bacteria can convert nitrate to nitrite in the environment, in foods and in the human body. Nitrite can then interfere with the ability of red blood cells to carry oxygen to the tissues of the body, producing a condition called methemoglobinemia. It is of greatest concern in infants.

Water naturally contains less than 1 milligram of nitrate-nitrogen<sup>1</sup>; higher levels may indicate anthropogenic influences (but not necessarily exceeding MAC). Selected areas “hotspots” of the Abbotsford-Sumas Aquifer contain elevated levels of nitrate likely due to agricultural activities, thus nitrate and nitrite are monitored at the wells. Results meet the MACs for nitrate and nitrite, of 10 and 1 mg/L, respectively (**Appendix D**).

### **Pesticides & Herbicides**

Historically, pesticides and herbicides have been tested annually based on raw water samples collected from the production wells. The pesticides and herbicides include 162 parameters, summarized in **Appendix G**. No concentrations above the detection limit were reported for any parameter (for any tested well) which is consistent with historical results for the tested wells. Moving forward the analysis will be completed every third year, with the next instances to be scheduled for 2027.

---

<sup>4</sup> Health Canada, June, 2013. Guidelines for Canadian Drinking Water Quality: Guideline Technical Document – Nitrate and Nitrite Retrieved from: <https://www.canada.ca/en/health-canada/services/publications/healthy-living/guidelines-canadian-drinking-water-quality-guideline-technical-document-nitrate-nitrite/page-2-guidelines-canadian-drinking-water-quality-guideline-technical-document-nitrate-nitrite.html#a2>

### 3.3 Cannel Filtration Exemption Monitoring

In 2005, Fraser Health adopted the Ministry of Health’s “Drinking Water Treatment Objectives (Microbiological) for Surface Water Supplies in British Columbia”. These guidelines generally require filtration for drinking water supplied from surface water sources. However, authorities may exempt such sources from filtration conditional upon compliance with four (4) specific criteria:

1. *Overall inactivation is met using a minimum of two disinfection processes, providing 4-log reduction of viruses and 3-log reduction of Cryptosporidium and Giardia.*
2. *The number of E. coli in raw water does not exceed 20 counts/100 mL (or if E. coli data are not available, less than 100 counts/100 mL of Total Coliform) in at least 90% of the weekly samples from the previous six months. The treatment target for all water systems is to contain no detectable E. coli or Fecal Coliform per 100 ml. Total Coliform objectives are also zero based on one sample in a 30-day period. For more than one sample in a 30-day period, at least 90% of the samples should have no detectable Total Coliform bacteria per 100 ml and no sample should have more than 10 total coliform bacteria per 100 ml.*
3. *Average daily turbidity levels measured at equal intervals (at least every four hours) immediately before the disinfectant is applied are around 1 NTU, but do not exceed 5 NTU for more than two days in a 12-month period.*
4. *A watershed control program is maintained that minimizes the potential for fecal contamination in the source water.*

Fraser Health granted such ‘filtration exemption’ for Cannell Lake in 2013, under the conditions that: (i) UV-disinfection be added to the treatment process to comply with Criterion #1; (ii) raw water quality continues to satisfy Criteria #2 & #3; and (iii) a watershed control program is maintained as per Criterion #4.

**In 2025, the requirements continued to be followed and opportunities for improvements identified:**

1. Turbidity of the raw water is continuously monitored (at the WTP - SCADA).
2. Weekly raw water E. coli monitoring (at the WTP – 52 samples).
3. Through the watershed control program, the risk of lake fecal contamination is monitored and mitigated or prevented. The program includes: (i) completing weekly visual checks at the lake shore area for any signs of possible watershed contamination (e.g. human trespass); (ii) maintain gated access and signs to prohibit public access (**Figure 3-1**); and (iii) completing an annual helicopter inspection of the watershed.

In 2024, regular Cryptosporidium and Giardia analysis was discontinued due to the lack of sufficient sensitivity and specificity of the analytical methods commercially available to reliably detect oocysts and cysts in the water with such low levels. Efforts were instead focused on monitoring the performance of disinfection barriers to ensure they consistently provide sufficient inactivation.



Figure 3-1: Cannell Lake Watershed Delineation; restrictive access signs are placed at the gate to Cannell Lake.

## 3.4 Distribution Water Quality Monitoring

### 3.4.1 Overview

Abbotsford and Mission City distribution systems monitoring includes weekly testing of *E. coli*, total coliforms, chlorine residuals, turbidity, temperature and pH at selected sampling locations using dedicated sample stations. These parameters are also monitored along the Regional Water Supply System pipelines. The list of sample locations used in 2025 are provided in **Table 3-2** (next page).

Schedule B of the Drinking Water Protection Regulation establishes the minimum frequency of monitoring for bacteriological indicators total coliform and *E. coli*. For water utilities serving a population of 5,000 to 90,000 people, a monthly minimum of one sample per 1,000 people served is required. For systems serving more than 90,000 people, a monthly minimum of 90 samples plus one sample for every additional 10,000 persons is required. Based on a population of 175,000 people in Abbotsford and 40,000 people in Mission, this would require 99 samples per month (1,188 samples per year) for Abbotsford and 40 samples per month (480 samples per year) for Mission. In 2025, 1,493 and 512 samples of finished water were analysed for bacteriological indicators in Abbotsford and Mission respectively, exceeding the minimum sampling requirements.

CITY OF ABBOTSFORD DISTRIBUTION			
<b>E02</b>	310 Arnold Road	<b>W02</b>	3836 Old Clayburn Road
<b>E07</b>	6230 Tolmie Road	<b>W03</b>	35944 McKee Road
<b>E08</b>	3434 McDermott Road	<b>W04</b>	34638 Bateman Road
<b>E09</b>	36232 Lower Sumas Mountain Road	<b>W05</b>	3315 Gladwin Road
<b>E10</b>	36101 Regal Parkway	<b>W06</b>	32961 South Fraser Way
<b>E11</b>	2598 St. Moritz Way	<b>W07</b>	32111 Joyce Avenue
<b>E12</b>	2691 Beck Road	<b>W11</b>	5030 Lefeuve Road
<b>E13</b>	2087 McMillian Road	<b>W13</b>	7942 Bradner Road
<b>E14</b>	2211 Mouldstade Road	<b>W15</b>	3154 Clearbrook Road
<b>E15</b>	2215 Orchard Drive	<b>W16</b>	27875 Swensson Avenue
<b>E16</b>	2540 Eagle Mountain Drive	<b>W17</b>	31792 Harris Road
<b>E17</b>	2720 St. Moritz Way	<b>W20</b>	33435 Hawthorne Avenue
<b>E19</b>	3020 Cassiar Avenue	<b>W21</b>	2059 Peardonville Road
<b>E20</b>	2350 Guildford Drive	<b>W22</b>	3997 Brighton Place
<b>E21</b>	34694 5 <sup>th</sup> Avenue	<b>W23</b>	3612 Blue Jay Street
<b>E22</b>	33850 Elm Street	<b>W24</b>	3799 Lethbridge Drive
<b>E23</b>	36026 Village Knoll	<b>W26</b>	3119 Gardner Avenue
<b>E24</b>	355440 Delair Road	<b>W27</b>	33989 Townshipline Road
<b>W01</b>	35041 Harris Road	<b>W28</b>	2379 Chardonnay Lane
		<b>W34</b>	926 Columbia Street
CITY OF MISSION DISTRIBUTION			
<b>M01</b>	31565 Israel Avenue	<b>M19</b>	9181 Draper Street
<b>M02</b>	8072 Crosby Street	<b>M20</b>	9155 Cedar Street
<b>M03</b>	8504 Ireland Avenue	<b>M21</b>	7816 Dunsmuir Street
<b>M05</b>	31860 Hillcrest Avenue	<b>M22</b>	33133 Tunbridge Avenue
<b>M07</b>	7439 Mary Street	<b>M23</b>	7457 Alder Street
<b>M09</b>	35471 Lougheed Highway	<b>M24</b>	34757 Moffat Avenue
<b>M10</b>	32463 Hashizume Terrace	<b>M25</b>	7990 Grand Street

<b>M16</b>	33945 Best Avenue	<b>M26</b>	8512 Fennel Street
<b>M17</b>	8430 Nelson Street	<b>M27</b>	32252 McRae Avenue
<b>M18</b>	33549 Blueberry Avenue		
<b>REGIONAL WATER SUPPLY SYSTEM</b>			
<b>T01b</b>	Bell Road (post NH3)	<b>T05b</b>	Cannons Pit 400 (post NH3)
<b>T03b</b>	Maclure Reservoir Outlet	<b>T06b</b>	Cannons Pit 600 (post NH3)
<b>T04</b>	Ainsworth Street	<b>T09b</b>	Mt. Mary Ann Reservoir Outlet

**Table 3-2 Water Supply and Distribution Sample Stations**

### 3.4.2 Total Coliform and *E. coli*

Schedule A of the Drinking Water Protection Regulation specifies standards for the bacteriological quality of potable water in the Province:

- No detectible *E. coli* per 100 millilitres (mL).
- At least 90 percent (%) of samples have no detectable total coliform bacteria per 100 mL and no sample has more than 10 total coliform bacteria per 100 mL.

Total coliforms are a group of bacteria that are naturally found on plants, in soils and water in the environment, as well as in the intestines of humans and warm-blooded animals and in water contaminated with human and animal faeces. Total coliform bacteria generally do not cause human disease, but their presence in a water distribution system may indicate that the system is vulnerable to contamination or is experiencing bacterial re-growth.

*E. coli* is a member of the total coliform group and is found exclusively in the faeces of humans and other animals. Its presence in water indicates relatively recent faecal contamination has occurred and suggests the potential presence of infectious bacteria, viruses, and protozoa. The detection of *E. coli* triggers emergency procedures, immediate notification of health and municipal officials, re-sampling, and a thorough investigation into the possible causes.

In combination, the Regional and City systems tested 2,355 finished water samples (from 64 sample stations) for bacteriological indicators in 2025 as part of compliance monitoring. While all samples returned negative for *E coli*, detectable levels of total coliforms were observed in 7 out of 2,355 samples or 0.3% in the distribution network (**Table 3-3**). In all cases total coliform levels were well below the acceptability threshold of 10% in any given 30-day period and all subsequent follow up samples returned non-detectable. This suggests positive detections may have been either due to sampling errors (i.e. contamination) or due to a brief and temporary event.

DATE	LOCATION ID	LOCATION	TOTAL COLIFORMS
			CFU/100ml
<b>CITY OF ABBOTSFORD DISTRIBUTION</b>			
12-Nov-2025	E11	2598 St. Moritz Way	1
28-Jan-2025	E13	2087 McMillian Road	1
27-May-2025	E20	2350 Guildford Drive	1
12-Nov-2025	E21	34694 5 <sup>th</sup> Avenue	1
13-May-2025	E24	355440 Delair Road	1
22-Apr-2025	W23	3612 Blue Jay Street	1
02-Jul-2025	W26	3119 Gardner Avenue	1
<b>CITY OF MISSION DISTRIBUTION</b>			
N/A	N/A	N/A	N/A

**Table 3-3 – Detectable Coliform Results in Weekly Monitoring (Distribution)**

**3.4.3 Disinfection Residuals**

Disinfection is the most important treatment process used to produce potable water, providing a barrier to pathogenic or disease-causing microorganisms that may be present in the source water. Chlorine-based disinfectants are the most widely used disinfecting agents. After chlorine is added to water and has had sufficient time to inactivate microorganisms, any remaining or residual chlorine may persist in the distribution system to provide additional benefits. While it may provide limited protection against contaminant intrusion and suppression of bacterial growth on internal pipe and storage facility surfaces, its main benefit is as an easily measurable parameter for operational monitoring. Monitoring of a chlorine residual is rapid and can be performed in the field for grab samples or continuously at key locations using online instrumentation. The absence of a measurable disinfectant residual indicates a potential breach in system integrity and allows rapid corrective actions to be taken. As chlorine residuals decay with time, their concentrations may be depleted below measurable levels at the furthest ends of the distribution system or in larger storage facilities. Ammonia may be added to water downstream of the chlorine addition point such that it reacts with the remaining chlorine to form monochloramine, a more persistent disinfectant residual. Monochloramine is the disinfectant residual used in Abbotsford and Mission.

Health Canada’s proposed guideline states that *“it is not considered necessary to establish a guideline for chloramines in drinking water based on low toxicity of monochloramine at concentrations found in drinking water, but most Canadian drinking water supplies maintain a chloramine residual below 4 mg/L*

*in the distribution system.*"<sup>1</sup> Monochloramine also decays with time, albeit at a much lower rate relative to chlorine alone. In the Abbotsford-Mission water system, chlorine and ammonia are typically dosed to produce an initial concentration of 1.5 and 2.5 mg/L, measured as total chlorine with 70% or more typically composed of monochloramine and the remainder consisting largely of other chloramines. Such initial concentrations generally ensure that there are measurable levels of disinfectant at the far reaches of the system.

Furthermore, for verification monitoring, 2,738 routine weekly grab samples of finished water tested for disinfectant residual (free chlorine, total chlorine, monochloramine). Results indicate that under normal operation a measurable residual is consistently maintained throughout the water system (transmission and distribution).

#### **3.4.4 Turbidity**

Turbidity is a key physical characteristic of water quality of system status due to the ease and sensitivity of its measurement. It is caused by suspended particulates that impede the light passage or clarity of water. While excessive turbidity in drinking water is aesthetically unappealing, the particulates causing the observed turbidity may or may not pose a direct health hazard. The value of turbidity as a water quality parameter is in its use for operational monitoring, including the monitoring of source water conditions, treatment process performance, and distribution system integrity. A sudden increase in observed turbidity may represent an abnormal condition such as challenging source water quality that could overwhelm treatment barriers, poor or inadequate treatment system performance, or potential distribution system failures resulting in contaminant intrusion. Generally, under normal operation the turbidity of finished water across the system will be consistently below 1.0 NTU.

While operational monitoring of finished water turbidity is performed continuously by online analyzers at the treatment facilities, turbidity is also measured in grab samples taken during routine monitoring. The turbidity was measured in the field for approximately 2,782 compliance monitoring samples and the results confirm consistently low turbidity in the distribution systems with an average value of 0.30 NTU. In only two (2) instances did turbidity reach the threshold at sample station W22 (7.6 NTU) on August 19, 2025 and at sample station M26 (1.21 NTU) on January 14, 2025.

#### **3.4.5 pH**

The finished water pH is measured by online analyzers at the Bell Road and Cannell Lake locations. Additionally, field testing (at the 64 sample stations) for pH occurs weekly at each transmission main and distribution system sample location. The average pH of treated water is 7.2.

---

<sup>1</sup> Health Canada, January, 2019. Guidelines for Canadian Drinking Water Quality - Chloramines. Retrieved from: <https://www.canada.ca/content/dam/hc-sc/documents/programs/consultation-chloramines-drinking-water/chloramines-drinking-water-2018-eng.pdf>

### 3.4.6 Metals

In 2025, the Abbotsford and Mission distribution systems were tested approximately quarterly for metals. **Appendix G** summarizes the results. All samples met the GCDWQ health-based requirements. The Abbotsford sample station E07 experienced exceedances of the aesthetic objective for manganese in one or more samples.

### 3.4.7 Disinfection By-Products (DBPs)

Trihalomethanes (THMs) and Haloacetic Acids (HAAs) are by-products of chlorination formed following the addition of chlorine to water and its reaction with naturally occurring dissolved organic matter. The GCDWQ specifies MACs of 0.1 mg/L (100 µg/L) for THMs and 0.08 mg/L (80 µg/L) for HAAs are based on locational running annual averages of at least quarterly samples taken in the distribution system <sup>1</sup>.

The water samples for DBP analysis were taken from selected sample stations of the Regional Supply and City distribution systems.

Results are presented in **Appendix H** and all results were well below the respective MAC, predominantly below detection limits.

N-Nitrosodimethylamine (NDMA) is a by-product often associated with the use of monochloramine. NDMA is considered likely to be carcinogenic to humans. The GCDWQ has established a MAC of 0.000,04 mg/L (0.04 µg/L). All results for 2025 were below the detection limit (0.002 µg/L) except 1 sample results which were below 0.003 µg/L. All samples were compliant under the MAC established by CGDWQ.

## 3.5 PFAS Monitoring

### 3.5.1 Background

Per- and Polyfluoroalkyl Substances (PFAS) are a large class of thousands of synthetic compounds that have been widely used for decades in industrial processes and consumer products, including firefighting foams, non-stick cookware, cosmetics and paper food packaging. Due to historic widespread use and persistence, PFAS can often be found in the environment, including drinking water sources.

In 2018, Health Canada established drinking water guidelines for the two compounds perfluorooctane sulfonate (PFOS) and perfluorooctanoic acid (PFAS) of 600 and 200 ng/L, respectively and in 2019 screening values were released for nine others PFAS compounds. In 2020, the BC Ministry of Environment and Climate Change Strategy released Source Drinking Water Quality Guidelines for PFOS and PFAS based on Health Canada's guideline values.

Establishing health-based limits involves a rigorous scientific process typically requiring several years. In the interim, objectives may be established based on the precautionary principle. In 2024, Health Canada moved to treat PFAS compounds as a group rather than as individual compounds and the drinking water guidelines and screening values were superseded by a single objective value for the sum of 25 select PFAS compounds. The objective of 30 ng/L (i.e. 30 parts per trillion) is intended to serve as a goal or

---

<sup>1</sup> Health Canada, July 2008. [Guidelines for Canadian Drinking Water](https://www.canada.ca/en/health-canada/services/publications/healthy-living/guidelines-canadian-drinking-water-quality-guideline-technical-document-haloacetic-acids.html). Retrieved from: <https://www.canada.ca/en/health-canada/services/publications/healthy-living/guidelines-canadian-drinking-water-quality-guideline-technical-document-haloacetic-acids.html>

benchmark to strive towards, recognizing that its attainment may take time due to technical and financial complexity. Note that unlike drinking water guidelines, objective values are not health-based limits and are not based on any defined adverse health outcome. The objective value is based primarily on the reliability of measurement limits at trace levels (i.e. at the level of parts per trillion) using commercially available instrumentation and approved methods or accredited laboratory services.

### 3.5.2 PFAS Monitoring and Summary Statement

In 2025, all water sources serving the Abbotsford Mission regional water supply system were sampled and tested for PFAS. The initial round of tests yielded no detections from either surface water sources (Norrish Creek and Cannell Lake) and no detection from the Industrial, Farmer, and Marshal well fields. Detectable levels were found initially in five wells, including the four Bevan wells and the Townline 2 well, though all results were below the objective value. To confirm the low levels involved and to better understand data variability three additional rounds of samples were taken in 2025 at these five wells. Subsequent results revealed higher levels than the initial test, including several apparent isolated exceedances of the objective value. The source of the PFAS and the cause of the apparent variability is unknown. The sum of the detectable results are summarized in Table 1. The full test results are tabulated in Appendix J. Note that the water delivered to individual customers in Abbotsford typically involves different sources at any given time or a blend of sources depending on operating conditions and demands.

Testing of these wells continued into 2026. In response to results from Bevan 1 and Townline 2 above the objective, Fraser Health’s Drinking Water Officer recommended the removal of these wells from service on February 20, 2026. In response, the City immediately turned off Bevan 1 and Townline 2 from service and as an additional precaution also turned off Bevan 2, 3, and 4 while the situation was further assessed.

Well	Sum of 25 PFAS (ng/L)			
	9/25/2025	10/30/2025	11/6/2025	11/26/2025
<b>Bevan 1</b>	12	98	19	101
<b>Bevan 2</b>	12	81	17	13
<b>Bevan 3</b>	15	23	13	18
<b>Bevan 4</b>	13	20	85	15
<b>Townline 2</b>	11	29	25	31

**Table 2 - Summary of PFAS Test Results**

Testing continued with additional quality control checks, while a temporary plan was developed to ensure sufficient capacity remains available to deploy during the peak demand season, including fire-fighting capabilities. The proposed plan was received by Fraser Health with no objections. The plan consists of continued monitoring and the operation of wells based on a rolling average of PFAS results.

As of June 3, 2026, the rolling average of PFAS from the four Bevan wells over the previous six sampling events was 51, 14, 17, and 17 ng/L, respectively. Bevan 1 and Townline 2 wells have remained out of service since February 20, while Bevan 2, 3, and 4 were returned to service at the end of April.

Longer-term efforts to address PFAS in the long term include

- Investigating potential treatment options and cost estimates
- Advancing test well drilling of new production wells
- Examining alternative supply augmentation during master planning
- Developing a groundwater source protection strategy

### **3.5.3 Operational Plan**

Given the PFAS test results, the impacted wells are now operated in a manner intended to reduce the levels of PFAS as low as reasonably achievable without compromising the ability of the system to meet the required level of service, including augmenting the supply to meet peak demand days and provide adequate firefighting capabilities.

The operating plan is based on the routine sampling and testing of individual impacted wells on an at least monthly basis, the development of data acceptance and rejection criteria, and the comparison of a six-monthly rolling average of the sum of 25 PFAS concentrations against the objective value of 30 ng/L. Should the rolling average remain below the objective, the respective well may be put into service to augment the supply as demands require. Should the rolling average be exceeded, the wells will remain out of service during normal operation. If an urgent supply condition arises, such wells may be placed back into service temporarily with the notification of Fraser Health. Note that PFAS levels from such wells may be partially mitigated by blending with other sources.

As part of ongoing water master planning activities, longer-term solutions will be investigated.

All health-based inquiries regarding PFAS should kindly be directed to the attention of Fraser Health.

## **4 SYSTEM MAINTENANCE**

### **4.1 Overview**

Between the Joint and City Systems, there are more than 40 staff assigned to engineering, operations management, maintenance, and construction of the water utility system.

To maintain the quality of the water throughout the distribution system, Abbotsford and Mission utilize regular flushing programs. Flushing watermains is an integral part of a comprehensive water management program to prevent bacterial re-growth and stagnation in low circulation areas of the distribution system.



#### WATER MAIN FLUSHING THROUGH FIRE HYDRANTS

*The first image show flushing as part of a Unidirectional Flushing Program (UDF) and the second images shows regular water main flushing.*

Replacement of aging water pipes in Abbotsford and Mission is ongoing each year. Priority is given to pipes that are made of asbestos cement (AC), ductile iron in known corrosive soil, and those pipes that are approaching the end of their service life or have a history of problems. Abbotsford began using its new smart meters to identify potential leaks in its distribution system in 2010. Mission has developed and implements a leak detection program, which identifies system areas in need of repair, upgrades or replacement

## 4.2 Staff Certification & Training

The BC Environmental Operators Certification Program (EOCP) classifies water systems and certifies operators using ratings levels I through IV. Higher numbers correspond to systems of greater operational complexity and requirements of operators with more advanced training. The required level of operators needed corresponds to the classification of the facility level:

- ✓ The Norrish Water Treatment Plant is classified as **Level IV**
- ✓ The Cannell Lake Water Treatment Plant is classified as **Level III**
- ✓ Transmission system is classified as **Level IV**
- ✓ Well Supply System is classified as **Level 1**
- ✓ Abbotsford's water distribution system is classified as **Level IV**
- ✓ Mission's water distribution system is classified as **Level II**

The City of Abbotsford staff maintain and operate the Regional Water Supply System (sources, water treatment facilities, transmission system) and Abbotsford's City System (distribution system). The City of Mission operates Mission's City System (distribution system).

The Regional Water Supply System team includes nine (9) operators. Of these, all have completed their water treatment EOCP or WPI Certification<sup>1</sup> including 1 operator with Level IV certification, 5 operators with Level III certification, 2 operators with Level II certification, and 1 operator with Level 1 water treatment certification. All 9 operators also have water distribution certification (EOCP or WPI) including 2 operators with Level IV certification, 2 operators with Level III certification and 5 operators with Level II certification.

The City of Abbotsford water distribution System has 18 certified operators and 1 millwright, including 3 operators with Level IV certification, 3 operators with Level III certification, 2 operators with Level II certification, 8 operators with Level I certification, one operator-in-training, and one vacant.

---

<sup>1</sup> EOCP: Environmental Operators Certification Program ([www.eocp.ca](http://www.eocp.ca)) – has a certification program for Water Treatment (WT) and Water Distribution (WD) operators; WPI: Water Professional International ([www.professionaloperator.org](http://www.professionaloperator.org)) – has a certification program for water and waste water operators.

The City of Mission water distribution is operated by 16 certified operators, consisting of 2 operators with Level IV certification, 1 operator with Level III certification, 8 operators with Level II certification, and 5 operators with Level I certification.

### 4.3 Capital Improvements and Operational Highlights for 2025

In 2025, the Regional and City Systems completed the following improvements:

#### Regional Water Supply System

- ❖ Completion of membrane tank relining at Norrish Creek Water Treatment Plant (NCWTP)
- ❖ Completion of membrane replacement at NCWTP
- ❖ Completion of NCWTP chlorine rotameter replacement
- ❖ Bell road pipe storage yard
- ❖ NCWTP – Sea can storage
- ❖ NCWTP - Chlorine conversion
- ❖ Bevan Wells – Chlorine conversion from onsite generation to bulk hypochlorite
- ❖ Marshall Wells – Chlorine conversion from onsite generation to bulk hypochlorite
- ❖ Farmer Well – Chlorine conversion from onsite generation to bulk hypochlorite
- ❖ Well rehabilitation - Bevan 1, Bevan 2 and Industrial C wells

Farmer 1 - Hydraulic Performance Testing



Farmer 1 - Well Rehabilitation (Re-Development) using Water Jetting



WELL REHABILITATION PROGRAM FOR FARMER 1 COMPLETED IN 2024.

#### City of Abbotsford Distribution System

- ❖ Completed over 1000 hydrant servicing
- ❖ Unidirectional flushing (UDF)
- ❖ 125 dead ends flushed

- ❖ 5 PRV stations full rebuild completed
- ❖ SCADA installation completed at various PRV stations
- ❖ New water sampling strategy implemented
- ❖ Fire flow testing and remodeling with Engineering completed
- ❖ Remodel of SCADA main page
- ❖ Gen set battery replacement schedule completed
- ❖ AMI replacement of 3000+ units completed
- ❖ 6 tie-ins completed for new water main installation at Highway 1
- ❖ 90% of new tie-ins for water main done at Cooper Meadows for neighborhood development
- ❖ Mechanical workshop set up for various mechanical services
- ❖ Empress reservoir pump #3 rebuild
- ❖ Mountain Village booster pump station pump #2 refurbished
- ❖ Old Yale booster fire pump #4 bearing replacement done
- ❖ Atkinson bridge water main rehabilitation
- ❖ New equipment purchased – Hydro vac truck and guillotine saw for use with Asbestos-cement (AC) pipes

### **City of Mission Distribution System**

- ❖ Voluntary water meter installation project – 35 installed
- ❖ Unidirectional flushing (UDF) for water pressure zone 2&3 completed
- ❖ AC water main replacement – 700 meters replaced.
- ❖ 1122 fire hydrants serviced
- ❖ SCADA system upgrade – ongoing, scheduled for completion by Winter 2027
- ❖ 8 water main breaks repaired
- ❖ Human Machine Interface (HMI) screen boards replaced at two pressure reducing stations
- ❖ Radio repeater installed at Eagle Mountain
- ❖ Supplemental testing of Ruskin Water System
- ❖ PFAS water testing for Ruskin and Distribution systems

## **4.4 Works Planned for 2026**

Key water system projects and programs scheduled for 2025 include:

### **Regional Water Supply System**

- ❖ Generator replacement – Cannell Water Treatment Plant (WTP)
- ❖ Well sites door swipe and camera upgrades
- ❖ Fireguard – Cannell and Norrish WTP area
- ❖ Building envelop improvements – Roofs and exteriors – various sites
- ❖ Review and revamp of all mitigation well PLC programing and physical site improvement
- ❖ Maclure reservoir #1 & #2 cleaning

- ❖ Supply security audit – Norrish Creek
- ❖ Investigation of Cannell WTP chlorine conversion
- ❖ Valve chamber maintenance and inspection

### **City of Abbotsford Distribution System**

- ❖ Unidirectional Flushing (ongoing)
- ❖ Servicing hydrants
- ❖ Valve exercising
- ❖ Pump-motor condition monitoring
- ❖ PRV rehabilitation – Selkirk, Clayburn Village, Cranberry Ct
- ❖ Reservoir cleaning – Bradner, Cassiar and Empress
- ❖ Failed water meter replacement program
- ❖ Water meter replacement program
- ❖ Valve addition and replacement
- ❖ Vye Altitude Control Valve (ACV) above-ground replacement project
- ❖ Highway 1 widening project

### **City of Mission Distribution System**

- ❖ Water pressure zone 1 fire flow improvements.
- ❖ Water main replacements.
- ❖ Voluntary water meter installation project.

## 4.5 Emergency Response Planning

The City of Abbotsford completed an Emergency Response Procedures Manual in 2009. The Emergency Response Plan (ERP) has been developed to address potential hazards such as earthquakes, floods, severe storms, volcanic eruption, and pandemic/staff illnesses. The ERP outlines procedures regarding the effect of hazards, including loss of water supply, loss of power, contamination/turbidity in the water system, or damage to water infrastructure. The ERP is currently being updated to better reflect current potential hazards and its associated system risks and update the response procedures as needed. The ERP may be implemented as:

1. Part of a joint emergency between the City of Abbotsford and the City of Mission, where all engineering resources would be coordinated by the City's Emergency Operations Centre; the ERP is premised on Abbotsford staff taking the lead role on all emergencies related to the Joint System.
2. A stand-alone plan to deal with a water emergency, managed by water utility staff; or
3. In a limited response to a City-wide emergency, involving water utility staff as part of an emergency resource to address a specific situation.

Activation of the ERP occurs when information is received that an emergency exists, either through staff, public, media, or police/fire communications. Staff are directed to determine the location and nature of the event, eliminate the hazard, and ultimately restore normal operation. The ERP contains checklists to prioritize risks and responses, indicators of problems, and restoration plans.

In the unlikely event that **finished drinking water** tests positive for E. coli or evidence suggests potential system contamination has occurred, the City will isolate the affected section of the system if possible to reduce the impact and contact Fraser Health to advise them of the situation. The City and the Medical Health Officer (MHO) of Fraser Health will evaluate the need for a water quality advisory (i.e., *Boil Water, Do Not Consume, Do Not Use*). If a determination is made that such an advisory must be issued, the City will inform the public. The MHO determines when the advisory can be rescinded.

A summary of the ERPs is available to the public upon request at Abbotsford's Engineering Department Reception (City Hall, 4<sup>th</sup> floor) and Mission's City Hall Reception.

## 5 CONCLUSIONS

Results from 2025 water quality monitoring demonstrate that the drinking water supply system serving Abbotsford and Mission is potable under the definition of the Drinking Water Protection Act and Drinking Water Protection Regulation. Abbotsford and Mission engineers and operators continuously pursue water system improvements to provide high-quality potable water to customers. The Joint System and the City Systems have rigorous monitoring and maintenance programs in place to ensure the reliability and safety of the drinking water supply, protect public health, and meet all regulatory requirements.

## APPENDICES

## **Appendix A – Message preventing water-borne infections**



## Preventing Water-Borne Infections For People with Weakened Immune Systems

### Who is at higher risk from water-borne infections?

People with very weak immune systems who are at higher risk of certain water-borne diseases include those with:

- HIV infection who have a CD4+ count of less than 100 cells/mm<sup>3</sup>;
- lymphoma or leukemia (hematological malignancies) who are being actively treated or have been in remission and off treatment for less than 1 year;
- hematopoietic stem cell transplant recipients; and
- people born with diseases that severely affect their immune systems.

Some people with weakened immune systems, such as those with certain types of cancers or taking certain medications, may not be at higher risk of severe water-borne diseases. These people do not need to take extra precautions with their drinking water.

Ask your doctor or nurse practitioner how weak your immune system is, and whether you need to take extra precautions.

### How can drinking water become contaminated?

Drinking water can contain different organisms, including bacteria, viruses and parasites, which can cause disease. These organisms can exist in the source water, such as lake water, and survive through treatment, or they can enter the water supply in the distribution system.

Well water can be contaminated if the well is located or constructed in a way that the groundwater it draws from is at risk of containing pathogens (germs) such as a shallow well or a well drilled in fractured rock.

Surface water, such as rivers, lakes and streams, can also contain disease-causing organisms from animal feces.

If you have a weak immune system, you should not drink water from surface sources or groundwater at risk of containing pathogens, unless the water has been treated to remove or inactivate at least 99.9 per cent of parasites (protozoa), 99.99 per cent of viruses and all harmful bacteria.

Most community water systems in B.C. have effective treatment, such as disinfection or chlorination, against bacteria and viruses. However, in many cases, treatment may not provide a 99.9 per cent reduction in infectious parasites. Some water systems and many private supplies have no treatment at all. If the water you drink has not been disinfected, please refer to [HealthLinkBC File #49b Disinfecting Drinking Water](#).

### How can I further treat disinfected water?

People with very weak immune systems should consult with their doctor or nurse practitioner and may need to take extra precautions with their drinking water.

**Boiling:** If your water supply has already been disinfected, bring the water to a full boil to inactivate any *Cryptosporidium* parasites - a major concern for people with weakened

immune systems. For more information, see [HealthLinkBC File #48 \*Cryptosporidium\* Infection](#).

If the water has not already been disinfected, bring the water to a full boil for at least 1 minute. This will kill or inactivate bacteria, viruses and parasites. At elevations over 2,000 meters (6,500 feet), boil water for at least 2 minutes to disinfect it.

Do not drink or use tap water to brush your teeth, rinse your mouth, mix drinks or make ice cubes without boiling it first.

Please note that boiling water will get rid of viruses, bacteria and parasites but not chemicals which may be found in the water.

**Reverse Osmosis (RO):** RO is effective against all disease-causing organisms and many chemical contaminants. Unless it has a high capacity, it will only produce small amounts of water and waste a large volume. Speak to a water treatment specialist to see if this is the best option for you.

**Ultraviolet (UV) Treatment:** UV light will kill many disease-causing organisms, and is effective against almost all parasites. UV will not kill some bacterial spores and some viruses, so it should not be used unless the water supply is at least disinfected. UV treatment units should meet NSF Standard #55A.

**Filters:** Filters do not remove bacteria and viruses and should not be used unless the water supply is disinfected first.

If you plan to install a drinking water filter in your home, you will need a system labeled as Absolute 1 micron or smaller, and labeled as meeting ANSI/NSF International Standard #53 for removal of parasites.

Jug-type filters, such as a Brita<sup>®</sup>, which sit in a jug and allow water to trickle through, and some tap-mounted and built-in devices are not an appropriate solution. The jug filter models are not effective in removing many disease-causing organisms.

### Can I drink bottled water?

Bottled water in B.C. may or may not have been treated. If you have a very weak immune system, check with the bottling company to find out what treatment, if any, it has had. Bottled water that has been properly treated using one of the methods listed above can be used for drinking, brushing teeth, making ice cubes and for recipes where water is used but not boiled, such as cold soups.

### For More Information

For more information, including the level of treatment in your local water system, contact your drinking water purveyor or supplier, or the local environmental health officer or drinking water officer. To find your health authority's drinking water contact visit [www2.gov.bc.ca/gov/content/environment/air-land-water/water/water-quality/drinking-water-quality/health-authority-contacts](http://www2.gov.bc.ca/gov/content/environment/air-land-water/water/water-quality/drinking-water-quality/health-authority-contacts).

For more information about water-borne infections and how to safely disinfect your drinking water, see the following HealthLinkBC Files:

- [HealthLinkBC File #49a Water-borne Infections in British Columbia](#)
- [HealthLinkBC File #49b Disinfecting Drinking Water](#)
- [HealthLinkBC File #69b Feeding Your Baby Formula: Safely Making and Storing Formula](#)

## Appendix B – Metals in Drinking Water



**fraserhealth**

Better health.  
Best in health care.

January 25, 2025

*Water System Operators*

**Re: Metals in Drinking Water – “Flush” Message in Annual Reports**

---

Anytime the water in a particular faucet has not been used for six hours or longer, “flush” your cold-water pipes by running the water until you notice a change in temperature. *(This could take as little as five to thirty seconds if there has been recent heavy water use such as showering or toilet flushing. Otherwise, it could take two minutes or longer.)* The more time water has been sitting in your home’s pipes, the more lead it may contain.

Use only water from the cold tap for drinking, cooking, and especially making baby formula. Hot water is likely to contain higher levels of lead.

The two actions recommended above are very important to the health of your family. They will probably be effective in reducing lead levels because most of the lead in household water usually comes from the plumbing in your house, not from the local water supply.

Conserving water is still important. Rather than just running the water down the drain you could use the water for things such as watering your plants.

If you have any questions, please contact our Drinking Water Program at 604-870-7903 or 1-866-749-7900.

Sincerely,

Alex Kwan  
Acting Manager, Drinking Water Program  
Fraser Health Authority  
[HPLand@fraserhealth.ca](mailto:HPLand@fraserhealth.ca)

## **Appendix C – Raw Water Quality - Surface Water**

Analyte	Units	GCDWQ	Guideline	Cannell WTP Inlet (RAW)		Norrish WTP Inlet (RAW)	
				6/19/2025	11/13/2025	6/19/2025	11/13/2025
Aluminum (total)	ug/L	2900	MAC	8.9	5.4	27	107
Ammonia (total, as N)	mg/L			<0.015	<0.015	<0.015	<0.015
Antimony (total)	ug/L	6	MAC	<0.50	<0.50	<0.50	<0.50
Arsenic (total)	ug/L	10	MAC	<0.10	0.1	0.25	0.13
Barium (total)	ug/L	2000	MAC	2.5	2.6	6.4	5.5
Beryllium (total)	ug/L			<0.10	<0.10	<0.10	<0.10
Bismuth (total)	ug/L			<1.0	<1.0	<1.0	<1.0
Boron (total)	ug/L	5000	MAC	<50	<50	<50	<50
Cadmium (total)	ug/L	7	MAC	<0.010	<0.010	<0.010	<0.010
Calcium (total)	mg/L			1.32	1.46	2.4	1.93
Chloride	mg/L	250	AO	<1.0	<1.0	<1.0	<1.0
Chromium (total)	ug/L	50	MAC	<1.0	<1.0	<1.0	<1.0
Cobalt (total)	ug/L			<0.20	<0.20	<0.20	<0.20
Dissolved Inorganic Carbon	mg/L			1.8	<1.0	2.5	<1.0
Copper (total)	ug/L	1000/2000	AO/MAC	1.47	1.91	<0.20	<0.20
Fluoride	mg/L	1500	MAC	<0.05	<0.05	<0.05	<0.05
Hardness (total, as CaCO3)	mg/L			4.01	4.44	7.21	5.82
Iron (total)	ug/L	100	AO	7.1	15.5	<5.0	29.7
Lead (total)	ug/L	5	MAC	<0.20	<0.20	<0.20	<0.20
Magnesium (total)	mg/L			0.174	0.19	0.297	0.242
Manganese (total)	ug/L	20/120	AO/MAC	4.4	4.1	<1.0	<1.0
Mercury (total)	ug/L	1	MAC	<0.0019	<0.0019	<0.0019	0.0023
Molybdenum (total)	ug/L			<1.0	<1.0	<1.0	<1.0
Nickel (total)	ug/L			<1.0	<1.0	<1.0	<1.0
Nitrate (as N)	mg/L	10	MAC	0.0113	0.0077	0.0972	0.0958
Nitrite (as N)	mg/L	1	MAC	<0.002	<0.002	<0.002	0.0022
Potassium (total)	mg/L			0.057	0.055	0.09	0.079
Selenium (total)	ug/L	50	MAC	<0.10	<0.10	<0.10	<0.10
Silicon (total, as Si)	ug/L			1380	1330	2760	2300
Silver (total)	ug/L			<0.020	<0.020	<0.020	<0.020
Sodium (total)	mg/L	200	AO	0.691	0.761	1.04	0.794
Strontium (total)	ug/L	7000	MAC	4.6	4.5	7.4	5.3
Sulfur (total)	mg/L			<3.0	<3.0	<3.0	<3.0
Thallium (total)	ug/L			<0.010	<0.010	<0.010	<0.010
Tin (total)	ug/L			<5.0	<5.0	<5.0	<5.0
Titanium (total)	ug/L			<5.0	<5.0	<5.0	<5.0
Total Organic Carbon	mg/L			0.87	1	0.73	2.3
Uranium (total)	ug/L	20	MAC	<0.10	<0.10	<0.10	<0.10
Vanadium (total)	ug/L			<5.0	<5.0	<5.0	<5.0
Zinc (total)	ug/L	5000	AO	<5.0	<5.0	<5.0	<5.0
Zirconium (total)	ug/L			<0.10	<0.10	<0.10	<0.10

<[value]: Below Detection Limit

## **Appendix D – Raw Water Quality – Selected Parameters - Groundwater**

Analyte	Total Iron	Total Manganese		Total Arsenic	Total Lead	Total Calcium	Chloride	Nitrate (as N)	Nitrite (as N)	Total Potassium	Total Sodium	Total Sulfur	pH	Turbidity	Total Dissolved Solids	Hardness (as CaCO <sub>3</sub> )	
Unit	µg/L	µg/L		µg/L	µg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	-	NTU	mg/L	mg/L	
<b>Guideline Limit (GCDWQ 2025)</b>																	
<b>Aesthetic Objective (AO)</b>	100	20		NA	NA	NA	250	NA	NA	NA	200	NA	NA	NA	500	NA	
<b>Maximum Acceptable Concentration (MAC)</b>	NA	120		10	5	NA	NA	10	1	NA	NA	NA	NA	NA	NA	NA	
<b>Operational Guidance Value (OG)</b>	NA	NA		NA	NA	NA	NA	NA	NA	NA	NA	NA	7.0 – 10.5	0.1	NA	200	
Water Source	Sample Size	Results (Raw Water Samples)		Sample Size	Results (Raw Water Samples)												
<b>Bevan 1</b>																	
Minimum	6	<10	<1	1	--	--	--	--	--	--	--	--	--	--	--	--	
Maximum		24	3.8		0.18	<0.20	28.2	39.0	2.87	0.002	1.24	8.91	5.30	7.61	0.74	180	101
Median		22.5	1.15		--	--	--	--	--	--	--	--	--	--	--	--	--
<b>Bevan 2</b>																	
Minimum	6	<10	<1	1	--	--	--	--	--	--	--	--	--	--	--	--	
Maximum		128	6.3		0.31	<0.20	26.6	33	2.74	<0.002	1.25	8.30	3.60	7.74	0.13	170	97.3
Median		<10	2.1		--	--	--	--	--	--	--	--	--	--	--	--	--
<b>Bevan 3</b>																	
Minimum	8	<10	<1	3	0.21	<0.20	25.6	39	2.00	<0.002	1.21	8.66	4.70	6.40	0.16	170	92.6
Maximum		75.6	1.2		0.25	<0.20	31.2	44	3.19	0.0035	1.26	9.55	7.00	7.77	1.9	200	110
Median		15.1	<1		0.24	<0.20	26.4	40	2.72	<0.002	1.24	9.18	5.00	6.85	0.66	190	95.8
<b>Bevan 4</b>																	
Minimum	8	<5	<1	3	0.15	<0.20	24.2	39	2.73	<0.002	1.14	9.09	3.4	6.36	<0.10	170	85.6
Maximum		104	2.4		0.18	<0.20	27.3	42	3.23	0.0024	1.18	9.31	4.2	7.67	0.18	180	95.1
Median		15.0	1.0		0.18	<0.20	26.0	40	2.76	<0.002	1.18	9.28	4.1	7.16	0.10	180	91.1

<[value] = below detection limit.

Selected results are presented; contact [eng-info@abbotsford.ca](mailto:eng-info@abbotsford.ca) to inquire about other results.

Analyte	Total Iron	Total Manganese		Total Arsenic	Total Lead	Total Calcium	Chloride	Nitrate (as N)	Nitrite (as N)	Total Potassium	Total Sodium	Total Sulfur	pH	Turbidity	Total Dissolved Solids	Hardness (as CaCO <sub>3</sub> )	
Unit	µg/L	µg/L		µg/L	µg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	-	NTU	mg/L	mg/L	
<b>Guideline Limit (GCDWQ 2025)</b>																	
<b>Aesthetic Objective (AO)</b>	100	20		NA	NA	NA	250	NA	NA	NA	200	NA	NA	NA	500	NA	
<b>Maximum Acceptable Concentration (MAC)</b>	NA	120		10	5	NA	NA	10	1	NA	NA	NA	NA	NA	NA	NA	
<b>Operational Guidance Value (OG)</b>	NA	NA		NA	NA	NA	NA	NA	NA	NA	NA	NA	7.0 – 10.5	0.1	NA	200	
Water Source	Sample Size	Results (Raw Water Samples)		Sample Size	Results (Raw Water Samples)												
<b>Farmer 1</b>																	
Minimum	6	<5	89.5	2	0.15	<0.20	33.2	13.0	5.68	<0.002	1.64	7.91	8.70	7.20	0.24	170	120
Maximum		<10	99.5		0.15	<0.20	34.0	15.0	5.80	<0.002	1.70	7.96	11.2	7.22	0.25	200	123
Median		<10	96.5		0.15	<0.20	33.6	14.0	5.74	<0.002	1.67	7.94	9.95	7.21	0.23	185	122
<b>Farmer 3</b>																	
Minimum	8	<5	2.40	3	5.08	<0.20	45.2	9.60	3.43	<0.002	1.90	5.70	13.6	7.85	<0.10	210	151
Maximum		<10	3.20		5.17	<0.20	46.4	11.0	3.54	0.0047	2.03	6.01	16.3	7.85	0.12	230	152
Median		<10	2.80		5.08	<0.20	45.3	10.0	3.46	<0.002	2.00	5.94	15.7	7.81	<0.10	210	151
<b>Industrial C</b>																	
Minimum	5	<10	56.9														
Maximum		<10	63.1														
Median		<10	59.5														
<b>Marshall 1</b>																	
Minimum	4	<5	16.8	2	4.08	<0.20	44.6	33.0	0.172	<0.002	3.10	17.8	11.7	7.94	0.11	220	150
Maximum		<10	19.7		4.55	<0.20	45.9	34.0	0.200	<0.002	3.24	18.8	13.2	8.20	0.12	240	156
Median		<10	19.1		4.32	<0.20	45.3	33.5	0.186	<0.002	3.17	18.3	15.5	8.07	0.115	230	153

<[value] = below detection limit.

Selected results are presented; contact [eng-info@abbotsford.ca](mailto:eng-info@abbotsford.ca) to inquire about other results.

Analyte	Total Iron	Total Manganese		Total Arsenic	Total Lead	Total Calcium	Chloride	Nitrate (as N)	Nitrite (as N)	Total Potassium	Total Sodium	Total Sulfur	pH	Turbidity	Total Dissolved Solids	Hardness (as CaCO <sub>3</sub> )	
Unit	µg/L	µg/L		µg/L	µg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	-	NTU	mg/L	mg/L	
<b>Guideline Limit (GCDWQ 2025)</b>																	
<b>Aesthetic Objective (AO)</b>	100	20		NA	NA	NA	250	NA	NA	NA	200	NA	NA	NA	500	NA	
<b>Maximum Acceptable Concentration (MAC)</b>	NA	120		10	5	NA	NA	10	1	NA	NA	NA	NA	NA	NA	NA	
<b>Operational Guidance Value (OG)</b>	NA	NA		NA	NA	NA	NA	NA	NA	NA	NA	NA	7.0 – 10.5	0.1	NA	200	
Water Source	Sample Size	Results (Raw Water Samples)		Sample Size	Results (Raw Water Samples)												
<b>Marshall 3</b>																	
Minimum	4	<5	11.6	1	--	--	--	--	--	--	--	--	--	--	--	--	
Maximum		10.0	12.4		2.11	<0.200	42.4	34.0	0.158	<0.002	2.45	15.7	12.2	7.47	0.120	190	146
Median		<10	12.1		--	--	--	--	--	--	--	--	--	--	--	--	--
<b>Townline 1</b>																	
Minimum	1	--	--	1	--	--	--	--	--	--	--	--	--	--	--	--	
Maximum		20.2	83.9		0.440	<0.200	23.0	26.0	3.41	<0.002	2.96	9.22	6.00	6.52	0.100	140	78.0
Median		--	--		--	--	--	--	--	--	--	--	--	--	--	--	--
<b>Townline 2</b>																	
Minimum	5	<5	18.4	2	0.630	<0.200	20.9	16.0	2.57	<0.002	1.18	7.85	4.50	6.43	0.110	110	70.8
Maximum		<20	24.8		0.640	0.650	21.8	19.0	2.61	<0.002	1.25	8.50	4.80	6.68	0.230	160	74.0
Median		<10	23.3		0.635	0.450	21.4	17.5	2.59	<0.002	1.22	8.18	4.65	6.56	0.170	135	72.4

<[value] = below detection limit.

Selected results are presented; contact [eng-info@abbotsford.ca](mailto:eng-info@abbotsford.ca) to inquire about other results.

## **Appendix E – Microbiology - Raw Groundwater**



















## Appendix F – Microbiology - Treated Water

Location Name	Sampling Date	Analyte	Result
E02 - 310 Arnold Road	1/7/2025	Escherichia coli / E. coli (counts)	0
E02 - 310 Arnold Road	1/7/2025	Total Coliforms (counts)	0
E02 - 310 Arnold Road	1/28/2025	Escherichia coli / E. coli (counts)	0
E02 - 310 Arnold Road	1/28/2025	Total Coliforms (counts)	0
E02 - 310 Arnold Road	2/11/2025	Escherichia coli / E. coli (counts)	0
E02 - 310 Arnold Road	2/11/2025	Total Coliforms (counts)	0
E02 - 310 Arnold Road	2/25/2025	Escherichia coli / E. coli (counts)	0
E02 - 310 Arnold Road	2/25/2025	Total Coliforms (counts)	0
E02 - 310 Arnold Road	3/4/2025	Escherichia coli / E. coli (counts)	0
E02 - 310 Arnold Road	3/4/2025	Total Coliforms (counts)	0
E02 - 310 Arnold Road	4/1/2025	Escherichia coli / E. coli (counts)	0
E02 - 310 Arnold Road	4/1/2025	Total Coliforms (counts)	0
E02 - 310 Arnold Road	4/29/2025	Escherichia coli / E. coli (counts)	0
E02 - 310 Arnold Road	4/29/2025	Total Coliforms (counts)	0
E02 - 310 Arnold Road	5/27/2025	Escherichia coli / E. coli (counts)	0
E02 - 310 Arnold Road	5/27/2025	Total Coliforms (counts)	0
E02 - 310 Arnold Road	6/24/2025	Escherichia coli / E. coli (counts)	0
E02 - 310 Arnold Road	6/24/2025	Total Coliforms (counts)	0
E02 - 310 Arnold Road	7/22/2025	Escherichia coli / E. coli (counts)	0
E02 - 310 Arnold Road	7/22/2025	Total Coliforms (counts)	0
E02 - 310 Arnold Road	8/19/2025	Escherichia coli / E. coli (counts)	0
E02 - 310 Arnold Road	8/19/2025	Total Coliforms (counts)	0
E02 - 310 Arnold Road	9/16/2025	Escherichia coli / E. coli (counts)	0
E02 - 310 Arnold Road	9/16/2025	Total Coliforms (counts)	0
E02 - 310 Arnold Road	10/14/2025	Escherichia coli / E. coli (counts)	0
E02 - 310 Arnold Road	10/14/2025	Total Coliforms (counts)	0
E02 - 310 Arnold Road	11/12/2025	Escherichia coli / E. coli (counts)	0
E02 - 310 Arnold Road	11/12/2025	Total Coliforms (counts)	0
E02 - 310 Arnold Road	12/9/2025	Escherichia coli / E. coli (counts)	0
E02 - 310 Arnold Road	12/9/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	1/7/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	1/7/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	1/13/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	1/13/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	1/21/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	1/21/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	1/28/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	1/28/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	2/4/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	2/4/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	2/11/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	2/11/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	2/19/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	2/19/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	2/25/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	2/25/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	3/25/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	3/25/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	4/22/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	4/22/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	5/20/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	5/20/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	6/17/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	6/17/2025	Total Coliforms (counts)	0

E07 - 6230 Tolmie Road	7/15/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	7/15/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	8/12/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	8/12/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	9/9/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	9/9/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	10/7/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	10/7/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	11/4/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	11/4/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	12/2/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	12/2/2025	Total Coliforms (counts)	0
E07 - 6230 Tolmie Road	12/29/2025	Escherichia coli / E. coli (counts)	0
E07 - 6230 Tolmie Road	12/29/2025	Total Coliforms (counts)	0
E08 - 3434 McDermott Road	1/13/2025	Escherichia coli / E. coli (counts)	0
E08 - 3434 McDermott Road	1/13/2025	Total Coliforms (counts)	0
E08 - 3434 McDermott Road	1/21/2025	Escherichia coli / E. coli (counts)	0
E08 - 3434 McDermott Road	1/21/2025	Total Coliforms (counts)	0
E08 - 3434 McDermott Road	2/4/2025	Escherichia coli / E. coli (counts)	0
E08 - 3434 McDermott Road	2/4/2025	Total Coliforms (counts)	0
E08 - 3434 McDermott Road	2/19/2025	Escherichia coli / E. coli (counts)	0
E08 - 3434 McDermott Road	2/19/2025	Total Coliforms (counts)	0
E08 - 3434 McDermott Road	3/18/2025	Escherichia coli / E. coli (counts)	0
E08 - 3434 McDermott Road	3/18/2025	Total Coliforms (counts)	0
E08 - 3434 McDermott Road	4/15/2025	Escherichia coli / E. coli (counts)	0
E08 - 3434 McDermott Road	4/15/2025	Total Coliforms (counts)	0
E08 - 3434 McDermott Road	5/13/2025	Escherichia coli / E. coli (counts)	0
E08 - 3434 McDermott Road	5/13/2025	Total Coliforms (counts)	0
E08 - 3434 McDermott Road	6/10/2025	Escherichia coli / E. coli (counts)	0
E08 - 3434 McDermott Road	6/10/2025	Total Coliforms (counts)	0
E08 - 3434 McDermott Road	7/8/2025	Escherichia coli / E. coli (counts)	0
E08 - 3434 McDermott Road	7/8/2025	Total Coliforms (counts)	0
E08 - 3434 McDermott Road	8/5/2025	Escherichia coli / E. coli (counts)	0
E08 - 3434 McDermott Road	8/5/2025	Total Coliforms (counts)	0
E08 - 3434 McDermott Road	9/2/2025	Escherichia coli / E. coli (counts)	0
E08 - 3434 McDermott Road	9/2/2025	Total Coliforms (counts)	0
E08 - 3434 McDermott Road	10/1/2025	Escherichia coli / E. coli (counts)	0
E08 - 3434 McDermott Road	10/1/2025	Total Coliforms (counts)	0
E08 - 3434 McDermott Road	10/28/2025	Escherichia coli / E. coli (counts)	0
E08 - 3434 McDermott Road	10/28/2025	Total Coliforms (counts)	0
E08 - 3434 McDermott Road	11/25/2025	Escherichia coli / E. coli (counts)	0
E08 - 3434 McDermott Road	11/25/2025	Total Coliforms (counts)	0
E08 - 3434 McDermott Road	12/23/2025	Escherichia coli / E. coli (counts)	0
E08 - 3434 McDermott Road	12/23/2025	Total Coliforms (counts)	0
E09 - 36232 Lower Sumas Mountain Road	1/7/2025	Escherichia coli / E. coli (counts)	0
E09 - 36232 Lower Sumas Mountain Road	1/7/2025	Total Coliforms (counts)	0
E09 - 36232 Lower Sumas Mountain Road	1/13/2025	Escherichia coli / E. coli (counts)	0
E09 - 36232 Lower Sumas Mountain Road	1/13/2025	Total Coliforms (counts)	0
E09 - 36232 Lower Sumas Mountain Road	1/21/2025	Escherichia coli / E. coli (counts)	0
E09 - 36232 Lower Sumas Mountain Road	1/21/2025	Total Coliforms (counts)	0
E09 - 36232 Lower Sumas Mountain Road	1/28/2025	Escherichia coli / E. coli (counts)	0
E09 - 36232 Lower Sumas Mountain Road	1/28/2025	Total Coliforms (counts)	0
E09 - 36232 Lower Sumas Mountain Road	2/4/2025	Escherichia coli / E. coli (counts)	0
E09 - 36232 Lower Sumas Mountain Road	2/4/2025	Total Coliforms (counts)	0
E09 - 36232 Lower Sumas Mountain Road	2/11/2025	Escherichia coli / E. coli (counts)	0













E12 - 2691 Beck Road	6/24/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	7/2/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	7/2/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	7/8/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	7/8/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	7/15/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	7/15/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	7/22/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	7/22/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	7/29/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	7/29/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	8/5/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	8/5/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	8/12/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	8/12/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	8/19/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	8/19/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	9/2/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	9/2/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	9/9/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	9/9/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	9/16/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	9/16/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	9/23/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	9/23/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	10/1/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	10/1/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	10/7/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	10/7/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	10/14/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	10/14/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	10/21/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	10/21/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	10/28/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	10/28/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	11/4/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	11/4/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	11/12/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	11/12/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	11/18/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	11/18/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	11/25/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	11/25/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	12/2/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	12/2/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	12/9/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	12/9/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	12/16/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	12/16/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	12/23/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	12/23/2025	Total Coliforms (counts)	0
E12 - 2691 Beck Road	12/29/2025	Escherichia coli / E. coli (counts)	0
E12 - 2691 Beck Road	12/29/2025	Total Coliforms (counts)	0
E13 - 2087 McMillan Road	1/7/2025	Escherichia coli / E. coli (counts)	0
E13 - 2087 McMillan Road	1/7/2025	Total Coliforms (counts)	0







































M01 - Israel	3/11/2025	Total Coliforms (counts)	0
M01 - Israel	3/25/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	3/25/2025	Total Coliforms (counts)	0
M01 - Israel	4/8/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	4/8/2025	Total Coliforms (counts)	0
M01 - Israel	4/23/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	4/23/2025	Total Coliforms (counts)	0
M01 - Israel	5/6/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	5/6/2025	Total Coliforms (counts)	0
M01 - Israel	5/21/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	5/21/2025	Total Coliforms (counts)	0
M01 - Israel	6/3/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	6/3/2025	Total Coliforms (counts)	0
M01 - Israel	6/17/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	6/17/2025	Total Coliforms (counts)	0
M01 - Israel	7/2/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	7/2/2025	Total Coliforms (counts)	0
M01 - Israel	7/15/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	7/15/2025	Total Coliforms (counts)	0
M01 - Israel	7/29/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	7/29/2025	Total Coliforms (counts)	0
M01 - Israel	8/12/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	8/12/2025	Total Coliforms (counts)	0
M01 - Israel	9/9/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	9/9/2025	Total Coliforms (counts)	0
M01 - Israel	9/23/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	9/23/2025	Total Coliforms (counts)	0
M01 - Israel	10/7/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	10/7/2025	Total Coliforms (counts)	0
M01 - Israel	10/21/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	10/21/2025	Total Coliforms (counts)	0
M01 - Israel	11/4/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	11/4/2025	Total Coliforms (counts)	0
M01 - Israel	11/18/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	11/18/2025	Total Coliforms (counts)	0
M01 - Israel	12/2/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	12/2/2025	Total Coliforms (counts)	0
M01 - Israel	12/16/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	12/16/2025	Total Coliforms (counts)	0
M01 - Israel	12/29/2025	Escherichia coli / E. coli (counts)	0
M01 - Israel	12/29/2025	Total Coliforms (counts)	0
M02 - Balsam	1/7/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	1/7/2025	Total Coliforms (counts)	0
M02 - Balsam	1/21/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	1/21/2025	Total Coliforms (counts)	0
M02 - Balsam	2/4/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	2/4/2025	Total Coliforms (counts)	0
M02 - Balsam	2/19/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	2/19/2025	Total Coliforms (counts)	0
M02 - Balsam	3/4/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	3/4/2025	Total Coliforms (counts)	0
M02 - Balsam	3/18/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	3/18/2025	Total Coliforms (counts)	0
M02 - Balsam	4/1/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	4/1/2025	Total Coliforms (counts)	0

M02 - Balsam	4/15/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	4/15/2025	Total Coliforms (counts)	0
M02 - Balsam	4/29/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	4/29/2025	Total Coliforms (counts)	0
M02 - Balsam	5/13/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	5/13/2025	Total Coliforms (counts)	0
M02 - Balsam	5/27/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	5/27/2025	Total Coliforms (counts)	0
M02 - Balsam	6/10/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	6/10/2025	Total Coliforms (counts)	0
M02 - Balsam	6/24/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	6/24/2025	Total Coliforms (counts)	0
M02 - Balsam	7/8/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	7/8/2025	Total Coliforms (counts)	0
M02 - Balsam	7/22/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	7/22/2025	Total Coliforms (counts)	0
M02 - Balsam	8/6/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	8/6/2025	Total Coliforms (counts)	0
M02 - Balsam	8/19/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	8/19/2025	Total Coliforms (counts)	0
M02 - Balsam	9/4/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	9/4/2025	Total Coliforms (counts)	0
M02 - Balsam	9/16/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	9/16/2025	Total Coliforms (counts)	0
M02 - Balsam	10/1/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	10/1/2025	Total Coliforms (counts)	0
M02 - Balsam	10/15/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	10/15/2025	Total Coliforms (counts)	0
M02 - Balsam	10/28/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	10/28/2025	Total Coliforms (counts)	0
M02 - Balsam	11/10/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	11/10/2025	Total Coliforms (counts)	0
M02 - Balsam	11/25/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	11/25/2025	Total Coliforms (counts)	0
M02 - Balsam	12/9/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	12/9/2025	Total Coliforms (counts)	0
M02 - Balsam	12/22/2025	Escherichia coli / E. coli (counts)	0
M02 - Balsam	12/22/2025	Total Coliforms (counts)	0
M03 - Penner	1/7/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	1/7/2025	Total Coliforms (counts)	0
M03 - Penner	1/21/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	1/21/2025	Total Coliforms (counts)	0
M03 - Penner	2/4/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	2/4/2025	Total Coliforms (counts)	0
M03 - Penner	2/19/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	2/19/2025	Total Coliforms (counts)	0
M03 - Penner	3/4/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	3/4/2025	Total Coliforms (counts)	0
M03 - Penner	3/18/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	3/18/2025	Total Coliforms (counts)	0
M03 - Penner	4/1/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	4/1/2025	Total Coliforms (counts)	0
M03 - Penner	4/15/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	4/15/2025	Total Coliforms (counts)	0
M03 - Penner	4/29/2025	Escherichia coli / E. coli (counts)	0

M03 - Penner	4/29/2025	Total Coliforms (counts)	0
M03 - Penner	5/13/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	5/13/2025	Total Coliforms (counts)	0
M03 - Penner	5/27/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	5/27/2025	Total Coliforms (counts)	0
M03 - Penner	6/10/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	6/10/2025	Total Coliforms (counts)	0
M03 - Penner	6/24/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	6/24/2025	Total Coliforms (counts)	0
M03 - Penner	7/8/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	7/8/2025	Total Coliforms (counts)	0
M03 - Penner	7/22/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	7/22/2025	Total Coliforms (counts)	0
M03 - Penner	8/6/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	8/6/2025	Total Coliforms (counts)	0
M03 - Penner	8/19/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	8/19/2025	Total Coliforms (counts)	0
M03 - Penner	9/4/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	9/4/2025	Total Coliforms (counts)	0
M03 - Penner	9/16/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	9/16/2025	Total Coliforms (counts)	0
M03 - Penner	10/1/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	10/1/2025	Total Coliforms (counts)	0
M03 - Penner	10/15/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	10/15/2025	Total Coliforms (counts)	0
M03 - Penner	10/28/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	10/28/2025	Total Coliforms (counts)	0
M03 - Penner	11/10/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	11/10/2025	Total Coliforms (counts)	0
M03 - Penner	11/25/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	11/25/2025	Total Coliforms (counts)	0
M03 - Penner	12/9/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	12/9/2025	Total Coliforms (counts)	0
M03 - Penner	12/22/2025	Escherichia coli / E. coli (counts)	0
M03 - Penner	12/22/2025	Total Coliforms (counts)	0
M05 - Hillcrest	1/7/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	1/7/2025	Total Coliforms (counts)	0
M05 - Hillcrest	1/21/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	1/21/2025	Total Coliforms (counts)	0
M05 - Hillcrest	2/4/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	2/4/2025	Total Coliforms (counts)	0
M05 - Hillcrest	2/19/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	2/19/2025	Total Coliforms (counts)	0
M05 - Hillcrest	3/4/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	3/4/2025	Total Coliforms (counts)	0
M05 - Hillcrest	3/18/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	3/18/2025	Total Coliforms (counts)	0
M05 - Hillcrest	4/1/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	4/1/2025	Total Coliforms (counts)	0
M05 - Hillcrest	4/15/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	4/15/2025	Total Coliforms (counts)	0
M05 - Hillcrest	4/29/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	4/29/2025	Total Coliforms (counts)	0
M05 - Hillcrest	5/13/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	5/13/2025	Total Coliforms (counts)	0

M05 - Hillcrest	5/27/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	5/27/2025	Total Coliforms (counts)	0
M05 - Hillcrest	6/10/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	6/10/2025	Total Coliforms (counts)	0
M05 - Hillcrest	6/24/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	6/24/2025	Total Coliforms (counts)	0
M05 - Hillcrest	7/8/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	7/8/2025	Total Coliforms (counts)	0
M05 - Hillcrest	7/22/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	7/22/2025	Total Coliforms (counts)	0
M05 - Hillcrest	8/6/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	8/6/2025	Total Coliforms (counts)	0
M05 - Hillcrest	8/19/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	8/19/2025	Total Coliforms (counts)	0
M05 - Hillcrest	9/4/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	9/4/2025	Total Coliforms (counts)	0
M05 - Hillcrest	9/16/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	9/16/2025	Total Coliforms (counts)	0
M05 - Hillcrest	10/1/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	10/1/2025	Total Coliforms (counts)	0
M05 - Hillcrest	10/15/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	10/15/2025	Total Coliforms (counts)	0
M05 - Hillcrest	10/28/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	10/28/2025	Total Coliforms (counts)	0
M05 - Hillcrest	11/10/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	11/10/2025	Total Coliforms (counts)	0
M05 - Hillcrest	11/25/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	11/25/2025	Total Coliforms (counts)	0
M05 - Hillcrest	12/9/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	12/9/2025	Total Coliforms (counts)	0
M05 - Hillcrest	12/22/2025	Escherichia coli / E. coli (counts)	0
M05 - Hillcrest	12/22/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	1/7/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	1/7/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	1/21/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	1/21/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	2/4/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	2/4/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	2/19/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	2/19/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	3/4/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	3/4/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	3/18/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	3/18/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	4/1/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	4/1/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	4/15/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	4/15/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	4/29/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	4/29/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	5/13/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	5/13/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	5/27/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	5/27/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	6/10/2025	Escherichia coli / E. coli (counts)	0

M07 - 4th & Mary	6/10/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	6/24/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	6/24/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	7/8/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	7/8/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	7/22/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	7/22/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	8/6/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	8/6/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	8/19/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	8/19/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	9/4/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	9/4/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	9/16/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	9/16/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	10/1/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	10/1/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	10/15/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	10/15/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	10/28/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	10/28/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	11/10/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	11/10/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	11/25/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	11/25/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	12/9/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	12/9/2025	Total Coliforms (counts)	0
M07 - 4th & Mary	12/22/2025	Escherichia coli / E. coli (counts)	0
M07 - 4th & Mary	12/22/2025	Total Coliforms (counts)	0
M09 - Shook	1/7/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	1/7/2025	Total Coliforms (counts)	0
M09 - Shook	1/14/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	1/14/2025	Total Coliforms (counts)	0
M09 - Shook	1/21/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	1/21/2025	Total Coliforms (counts)	0
M09 - Shook	1/28/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	1/28/2025	Total Coliforms (counts)	0
M09 - Shook	2/4/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	2/4/2025	Total Coliforms (counts)	0
M09 - Shook	2/11/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	2/11/2025	Total Coliforms (counts)	0
M09 - Shook	2/19/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	2/19/2025	Total Coliforms (counts)	0
M09 - Shook	2/25/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	2/25/2025	Total Coliforms (counts)	0
M09 - Shook	3/4/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	3/4/2025	Total Coliforms (counts)	0
M09 - Shook	3/11/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	3/11/2025	Total Coliforms (counts)	0
M09 - Shook	3/18/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	3/18/2025	Total Coliforms (counts)	0
M09 - Shook	3/25/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	3/25/2025	Total Coliforms (counts)	0
M09 - Shook	4/1/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	4/1/2025	Total Coliforms (counts)	0



M09 - Shook	10/21/2025	Total Coliforms (counts)	0
M09 - Shook	10/28/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	10/28/2025	Total Coliforms (counts)	0
M09 - Shook	11/4/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	11/4/2025	Total Coliforms (counts)	0
M09 - Shook	11/10/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	11/10/2025	Total Coliforms (counts)	0
M09 - Shook	11/18/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	11/18/2025	Total Coliforms (counts)	0
M09 - Shook	11/25/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	11/25/2025	Total Coliforms (counts)	0
M09 - Shook	12/2/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	12/2/2025	Total Coliforms (counts)	0
M09 - Shook	12/9/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	12/9/2025	Total Coliforms (counts)	0
M09 - Shook	12/16/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	12/16/2025	Total Coliforms (counts)	0
M09 - Shook	12/22/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	12/22/2025	Total Coliforms (counts)	0
M09 - Shook	12/29/2025	Escherichia coli / E. coli (counts)	0
M09 - Shook	12/29/2025	Total Coliforms (counts)	0
M10 - Miller	1/7/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	1/7/2025	Total Coliforms (counts)	0
M10 - Miller	1/21/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	1/21/2025	Total Coliforms (counts)	0
M10 - Miller	2/4/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	2/4/2025	Total Coliforms (counts)	0
M10 - Miller	2/19/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	2/19/2025	Total Coliforms (counts)	0
M10 - Miller	3/4/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	3/4/2025	Total Coliforms (counts)	0
M10 - Miller	3/18/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	3/18/2025	Total Coliforms (counts)	0
M10 - Miller	4/1/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	4/1/2025	Total Coliforms (counts)	0
M10 - Miller	4/15/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	4/15/2025	Total Coliforms (counts)	0
M10 - Miller	4/29/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	4/29/2025	Total Coliforms (counts)	0
M10 - Miller	5/13/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	5/13/2025	Total Coliforms (counts)	0
M10 - Miller	5/27/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	5/27/2025	Total Coliforms (counts)	0
M10 - Miller	6/10/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	6/10/2025	Total Coliforms (counts)	0
M10 - Miller	6/24/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	6/24/2025	Total Coliforms (counts)	0
M10 - Miller	7/8/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	7/8/2025	Total Coliforms (counts)	0
M10 - Miller	7/22/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	7/22/2025	Total Coliforms (counts)	0
M10 - Miller	8/6/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	8/6/2025	Total Coliforms (counts)	0
M10 - Miller	8/19/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	8/19/2025	Total Coliforms (counts)	0

M10 - Miller	9/4/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	9/4/2025	Total Coliforms (counts)	0
M10 - Miller	9/16/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	9/16/2025	Total Coliforms (counts)	0
M10 - Miller	10/1/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	10/1/2025	Total Coliforms (counts)	0
M10 - Miller	10/15/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	10/15/2025	Total Coliforms (counts)	0
M10 - Miller	10/28/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	10/28/2025	Total Coliforms (counts)	0
M10 - Miller	11/10/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	11/10/2025	Total Coliforms (counts)	0
M10 - Miller	11/25/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	11/25/2025	Total Coliforms (counts)	0
M10 - Miller	12/9/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	12/9/2025	Total Coliforms (counts)	0
M10 - Miller	12/22/2025	Escherichia coli / E. coli (counts)	0
M10 - Miller	12/22/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	1/13/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	1/13/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	1/14/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	1/14/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	1/28/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	1/28/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	2/11/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	2/11/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	2/25/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	2/25/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	3/11/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	3/11/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	3/25/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	3/25/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	4/8/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	4/8/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	4/23/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	4/23/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	5/6/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	5/6/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	5/21/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	5/21/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	6/3/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	6/3/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	6/17/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	6/17/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	7/2/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	7/2/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	7/15/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	7/15/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	7/29/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	7/29/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	8/12/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	8/12/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	9/9/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	9/9/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	9/23/2025	Escherichia coli / E. coli (counts)	0

M16 - Best @ Barker	9/23/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	10/7/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	10/7/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	10/21/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	10/21/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	11/4/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	11/4/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	11/18/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	11/18/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	12/2/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	12/2/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	12/16/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	12/16/2025	Total Coliforms (counts)	0
M16 - Best @ Barker	12/29/2025	Escherichia coli / E. coli (counts)	0
M16 - Best @ Barker	12/29/2025	Total Coliforms (counts)	0
M17 - TH Booster	1/7/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	1/7/2025	Total Coliforms (counts)	0
M17 - TH Booster	1/21/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	1/21/2025	Total Coliforms (counts)	0
M17 - TH Booster	2/4/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	2/4/2025	Total Coliforms (counts)	0
M17 - TH Booster	2/19/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	2/19/2025	Total Coliforms (counts)	0
M17 - TH Booster	3/4/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	3/4/2025	Total Coliforms (counts)	0
M17 - TH Booster	3/18/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	3/18/2025	Total Coliforms (counts)	0
M17 - TH Booster	4/1/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	4/1/2025	Total Coliforms (counts)	0
M17 - TH Booster	4/15/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	4/15/2025	Total Coliforms (counts)	0
M17 - TH Booster	4/29/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	4/29/2025	Total Coliforms (counts)	0
M17 - TH Booster	5/13/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	5/13/2025	Total Coliforms (counts)	0
M17 - TH Booster	5/27/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	5/27/2025	Total Coliforms (counts)	0
M17 - TH Booster	6/10/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	6/10/2025	Total Coliforms (counts)	0
M17 - TH Booster	6/24/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	6/24/2025	Total Coliforms (counts)	0
M17 - TH Booster	7/8/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	7/8/2025	Total Coliforms (counts)	0
M17 - TH Booster	7/22/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	7/22/2025	Total Coliforms (counts)	0
M17 - TH Booster	8/6/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	8/6/2025	Total Coliforms (counts)	0
M17 - TH Booster	8/19/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	8/19/2025	Total Coliforms (counts)	0
M17 - TH Booster	9/4/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	9/4/2025	Total Coliforms (counts)	0
M17 - TH Booster	9/16/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	9/16/2025	Total Coliforms (counts)	0
M17 - TH Booster	10/1/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	10/1/2025	Total Coliforms (counts)	0

M17 - TH Booster	10/15/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	10/15/2025	Total Coliforms (counts)	0
M17 - TH Booster	10/28/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	10/28/2025	Total Coliforms (counts)	0
M17 - TH Booster	11/10/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	11/10/2025	Total Coliforms (counts)	0
M17 - TH Booster	11/25/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	11/25/2025	Total Coliforms (counts)	0
M17 - TH Booster	12/9/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	12/9/2025	Total Coliforms (counts)	0
M17 - TH Booster	12/22/2025	Escherichia coli / E. coli (counts)	0
M17 - TH Booster	12/22/2025	Total Coliforms (counts)	0
M18 - Blueberry	1/7/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	1/7/2025	Total Coliforms (counts)	0
M18 - Blueberry	1/21/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	1/21/2025	Total Coliforms (counts)	0
M18 - Blueberry	2/4/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	2/4/2025	Total Coliforms (counts)	0
M18 - Blueberry	2/19/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	2/19/2025	Total Coliforms (counts)	0
M18 - Blueberry	3/4/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	3/4/2025	Total Coliforms (counts)	0
M18 - Blueberry	3/18/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	3/18/2025	Total Coliforms (counts)	0
M18 - Blueberry	4/1/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	4/1/2025	Total Coliforms (counts)	0
M18 - Blueberry	4/15/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	4/15/2025	Total Coliforms (counts)	0
M18 - Blueberry	4/29/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	4/29/2025	Total Coliforms (counts)	0
M18 - Blueberry	5/13/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	5/13/2025	Total Coliforms (counts)	0
M18 - Blueberry	5/27/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	5/27/2025	Total Coliforms (counts)	0
M18 - Blueberry	6/24/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	6/24/2025	Total Coliforms (counts)	0
M18 - Blueberry	7/8/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	7/8/2025	Total Coliforms (counts)	0
M18 - Blueberry	7/22/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	7/22/2025	Total Coliforms (counts)	0
M18 - Blueberry	8/6/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	8/6/2025	Total Coliforms (counts)	0
M18 - Blueberry	8/19/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	8/19/2025	Total Coliforms (counts)	0
M18 - Blueberry	9/4/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	9/4/2025	Total Coliforms (counts)	0
M18 - Blueberry	9/16/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	9/16/2025	Total Coliforms (counts)	0
M18 - Blueberry	10/1/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	10/1/2025	Total Coliforms (counts)	0
M18 - Blueberry	10/15/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	10/15/2025	Total Coliforms (counts)	0
M18 - Blueberry	10/28/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	10/28/2025	Total Coliforms (counts)	0
M18 - Blueberry	11/10/2025	Escherichia coli / E. coli (counts)	0

M18 - Blueberry	11/10/2025	Total Coliforms (counts)	0
M18 - Blueberry	11/25/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	11/25/2025	Total Coliforms (counts)	0
M18 - Blueberry	12/9/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	12/9/2025	Total Coliforms (counts)	0
M18 - Blueberry	12/22/2025	Escherichia coli / E. coli (counts)	0
M18 - Blueberry	12/22/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	1/14/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	1/14/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	1/28/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	1/28/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	2/11/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	2/11/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	2/25/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	2/25/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	3/11/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	3/11/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	3/25/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	3/25/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	4/8/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	4/8/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	4/23/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	4/23/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	5/6/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	5/6/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	5/21/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	5/21/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	6/3/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	6/3/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	6/17/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	6/17/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	7/2/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	7/2/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	7/15/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	7/15/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	7/29/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	7/29/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	8/12/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	8/12/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	9/9/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	9/9/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	9/23/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	9/23/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	10/7/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	10/7/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	10/21/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	10/21/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	11/4/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	11/4/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	11/18/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	11/18/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	12/2/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	12/2/2025	Total Coliforms (counts)	0
M19 - Ferndale @ Erikson	12/16/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	12/16/2025	Total Coliforms (counts)	0

M19 - Ferndale @ Erikson	12/29/2025	Escherichia coli / E. coli (counts)	0
M19 - Ferndale @ Erikson	12/29/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	1/7/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	1/7/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	1/21/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	1/21/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	2/4/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	2/4/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	2/19/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	2/19/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	3/4/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	3/4/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	3/18/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	3/18/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	4/1/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	4/1/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	4/15/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	4/15/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	4/29/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	4/29/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	5/13/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	5/13/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	5/27/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	5/27/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	6/10/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	6/10/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	6/24/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	6/24/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	7/8/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	7/8/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	7/22/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	7/22/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	8/6/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	8/6/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	8/19/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	8/19/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	9/4/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	9/4/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	9/16/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	9/16/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	10/1/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	10/1/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	10/15/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	10/15/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	10/28/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	10/28/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	11/10/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	11/10/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	11/25/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	11/25/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	12/9/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	12/9/2025	Total Coliforms (counts)	0
M20 - DTR & Cedar	12/22/2025	Escherichia coli / E. coli (counts)	0
M20 - DTR & Cedar	12/22/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	1/14/2025	Escherichia coli / E. coli (counts)	0

M21 - 11th & Dunsmuir	1/14/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	1/28/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	1/28/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	2/11/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	2/11/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	2/25/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	2/25/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	3/11/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	3/11/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	3/25/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	3/25/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	4/8/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	4/8/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	4/23/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	4/23/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	5/6/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	5/6/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	5/21/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	5/21/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	6/3/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	6/3/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	6/17/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	6/17/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	7/2/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	7/2/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	7/15/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	7/15/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	7/29/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	7/29/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	8/12/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	8/12/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	9/9/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	9/9/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	9/23/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	9/23/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	10/7/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	10/7/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	10/21/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	10/21/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	11/4/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	11/4/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	11/18/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	11/18/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	12/2/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	12/2/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	12/16/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	12/16/2025	Total Coliforms (counts)	0
M21 - 11th & Dunsmuir	12/29/2025	Escherichia coli / E. coli (counts)	0
M21 - 11th & Dunsmuir	12/29/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	1/14/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	1/14/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	1/28/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	1/28/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	2/11/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	2/11/2025	Total Coliforms (counts)	0

M22 - Tunbridge @ DTR	2/25/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	2/25/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	3/11/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	3/11/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	3/25/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	3/25/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	4/8/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	4/8/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	4/23/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	4/23/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	5/6/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	5/6/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	5/21/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	5/21/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	6/3/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	6/3/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	6/17/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	6/17/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	7/2/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	7/2/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	7/15/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	7/15/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	7/29/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	7/29/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	8/12/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	8/12/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	9/9/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	9/9/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	9/23/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	9/23/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	10/7/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	10/7/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	10/21/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	10/21/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	11/4/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	11/4/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	11/18/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	11/18/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	12/2/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	12/2/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	12/16/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	12/16/2025	Total Coliforms (counts)	0
M22 - Tunbridge @ DTR	12/29/2025	Escherichia coli / E. coli (counts)	0
M22 - Tunbridge @ DTR	12/29/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	1/14/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	1/14/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	1/28/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	1/28/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	2/11/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	2/11/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	2/25/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	2/25/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	3/11/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	3/11/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	3/25/2025	Escherichia coli / E. coli (counts)	0

M23 - 4th @ Alder	3/25/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	4/8/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	4/8/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	4/23/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	4/23/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	5/6/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	5/6/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	5/21/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	5/21/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	6/3/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	6/3/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	6/17/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	6/17/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	7/2/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	7/2/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	7/15/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	7/15/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	7/29/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	7/29/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	8/12/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	8/12/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	9/9/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	9/9/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	9/23/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	9/23/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	10/7/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	10/7/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	10/21/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	10/21/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	11/4/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	11/4/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	11/18/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	11/18/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	12/2/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	12/2/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	12/16/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	12/16/2025	Total Coliforms (counts)	0
M23 - 4th @ Alder	12/29/2025	Escherichia coli / E. coli (counts)	0
M23 - 4th @ Alder	12/29/2025	Total Coliforms (counts)	0
M24 - Moffat	1/14/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	1/14/2025	Total Coliforms (counts)	0
M24 - Moffat	1/28/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	1/28/2025	Total Coliforms (counts)	0
M24 - Moffat	2/11/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	2/11/2025	Total Coliforms (counts)	0
M24 - Moffat	2/25/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	2/25/2025	Total Coliforms (counts)	0
M24 - Moffat	3/11/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	3/11/2025	Total Coliforms (counts)	0
M24 - Moffat	3/25/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	3/25/2025	Total Coliforms (counts)	0
M24 - Moffat	4/8/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	4/8/2025	Total Coliforms (counts)	0
M24 - Moffat	4/23/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	4/23/2025	Total Coliforms (counts)	0

M24 - Moffat	5/6/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	5/6/2025	Total Coliforms (counts)	0
M24 - Moffat	5/21/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	5/21/2025	Total Coliforms (counts)	0
M24 - Moffat	6/3/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	6/3/2025	Total Coliforms (counts)	0
M24 - Moffat	6/17/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	6/17/2025	Total Coliforms (counts)	0
M24 - Moffat	7/2/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	7/2/2025	Total Coliforms (counts)	0
M24 - Moffat	7/15/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	7/15/2025	Total Coliforms (counts)	0
M24 - Moffat	7/29/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	7/29/2025	Total Coliforms (counts)	0
M24 - Moffat	8/12/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	8/12/2025	Total Coliforms (counts)	0
M24 - Moffat	9/9/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	9/9/2025	Total Coliforms (counts)	0
M24 - Moffat	9/23/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	9/23/2025	Total Coliforms (counts)	0
M24 - Moffat	10/7/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	10/7/2025	Total Coliforms (counts)	0
M24 - Moffat	10/21/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	10/21/2025	Total Coliforms (counts)	0
M24 - Moffat	11/4/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	11/4/2025	Total Coliforms (counts)	0
M24 - Moffat	11/18/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	11/18/2025	Total Coliforms (counts)	0
M24 - Moffat	12/2/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	12/2/2025	Total Coliforms (counts)	0
M24 - Moffat	12/16/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	12/16/2025	Total Coliforms (counts)	0
M24 - Moffat	12/29/2025	Escherichia coli / E. coli (counts)	0
M24 - Moffat	12/29/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	1/7/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	1/7/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	1/21/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	1/21/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	2/4/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	2/4/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	2/19/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	2/19/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	3/4/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	3/4/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	3/18/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	3/18/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	4/1/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	4/1/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	4/15/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	4/15/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	4/29/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	4/29/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	5/13/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	5/13/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	5/27/2025	Escherichia coli / E. coli (counts)	0

M25 - 11th & Grand	5/27/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	6/10/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	6/10/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	6/24/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	6/24/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	7/8/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	7/8/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	7/22/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	7/22/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	8/6/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	8/6/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	8/19/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	8/19/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	9/4/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	9/4/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	9/16/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	9/16/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	10/1/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	10/1/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	10/15/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	10/15/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	10/28/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	10/28/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	11/10/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	11/10/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	11/25/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	11/25/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	12/9/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	12/9/2025	Total Coliforms (counts)	0
M25 - 11th & Grand	12/22/2025	Escherichia coli / E. coli (counts)	0
M25 - 11th & Grand	12/22/2025	Total Coliforms (counts)	0
M26 - Fennel	1/13/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	1/13/2025	Total Coliforms (counts)	0
M26 - Fennel	1/14/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	1/14/2025	Total Coliforms (counts)	0
M26 - Fennel	1/28/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	1/28/2025	Total Coliforms (counts)	0
M26 - Fennel	2/11/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	2/11/2025	Total Coliforms (counts)	0
M26 - Fennel	2/25/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	2/25/2025	Total Coliforms (counts)	0
M26 - Fennel	3/11/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	3/11/2025	Total Coliforms (counts)	0
M26 - Fennel	3/25/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	3/25/2025	Total Coliforms (counts)	0
M26 - Fennel	4/8/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	4/8/2025	Total Coliforms (counts)	0
M26 - Fennel	4/23/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	4/23/2025	Total Coliforms (counts)	0
M26 - Fennel	5/6/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	5/6/2025	Total Coliforms (counts)	0
M26 - Fennel	5/21/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	5/21/2025	Total Coliforms (counts)	0
M26 - Fennel	6/3/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	6/3/2025	Total Coliforms (counts)	0

M26 - Fennel	6/17/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	6/17/2025	Total Coliforms (counts)	0
M26 - Fennel	7/2/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	7/2/2025	Total Coliforms (counts)	0
M26 - Fennel	7/15/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	7/15/2025	Total Coliforms (counts)	0
M26 - Fennel	7/29/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	7/29/2025	Total Coliforms (counts)	0
M26 - Fennel	8/12/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	8/12/2025	Total Coliforms (counts)	0
M26 - Fennel	9/9/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	9/9/2025	Total Coliforms (counts)	0
M26 - Fennel	9/23/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	9/23/2025	Total Coliforms (counts)	0
M26 - Fennel	10/7/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	10/7/2025	Total Coliforms (counts)	0
M26 - Fennel	10/21/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	10/21/2025	Total Coliforms (counts)	0
M26 - Fennel	11/4/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	11/4/2025	Total Coliforms (counts)	0
M26 - Fennel	11/18/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	11/18/2025	Total Coliforms (counts)	0
M26 - Fennel	12/2/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	12/2/2025	Total Coliforms (counts)	0
M26 - Fennel	12/16/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	12/16/2025	Total Coliforms (counts)	0
M26 - Fennel	12/29/2025	Escherichia coli / E. coli (counts)	0
M26 - Fennel	12/29/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	1/13/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	1/13/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	1/14/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	1/14/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	1/28/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	1/28/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	2/11/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	2/11/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	2/25/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	2/25/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	3/11/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	3/11/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	3/25/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	3/25/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	4/8/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	4/8/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	4/23/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	4/23/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	5/6/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	5/6/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	5/21/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	5/21/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	6/3/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	6/3/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	6/17/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	6/17/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	7/2/2025	Escherichia coli / E. coli (counts)	0

M27 - McRae & Hurd	7/2/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	7/15/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	7/15/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	7/29/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	7/29/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	8/12/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	8/12/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	9/9/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	9/9/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	9/23/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	9/23/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	10/7/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	10/7/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	10/21/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	10/21/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	11/4/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	11/4/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	11/18/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	11/18/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	12/2/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	12/2/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	12/16/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	12/16/2025	Total Coliforms (counts)	0
M27 - McRae & Hurd	12/29/2025	Escherichia coli / E. coli (counts)	0
M27 - McRae & Hurd	12/29/2025	Total Coliforms (counts)	0
W01 - 35041 Harris Road	1/7/2025	Escherichia coli / E. coli (counts)	0
W01 - 35041 Harris Road	1/7/2025	Total Coliforms (counts)	0
W01 - 35041 Harris Road	1/13/2025	Escherichia coli / E. coli (counts)	0
W01 - 35041 Harris Road	1/13/2025	Total Coliforms (counts)	0
W01 - 35041 Harris Road	1/21/2025	Escherichia coli / E. coli (counts)	0
W01 - 35041 Harris Road	1/21/2025	Total Coliforms (counts)	0
W01 - 35041 Harris Road	1/28/2025	Escherichia coli / E. coli (counts)	0
W01 - 35041 Harris Road	1/28/2025	Total Coliforms (counts)	0
W01 - 35041 Harris Road	2/4/2025	Escherichia coli / E. coli (counts)	0
W01 - 35041 Harris Road	2/4/2025	Total Coliforms (counts)	0
W01 - 35041 Harris Road	2/11/2025	Escherichia coli / E. coli (counts)	0
W01 - 35041 Harris Road	2/11/2025	Total Coliforms (counts)	0
W01 - 35041 Harris Road	2/19/2025	Escherichia coli / E. coli (counts)	0
W01 - 35041 Harris Road	2/19/2025	Total Coliforms (counts)	0
W01 - 35041 Harris Road	2/25/2025	Escherichia coli / E. coli (counts)	0
W01 - 35041 Harris Road	2/25/2025	Total Coliforms (counts)	0
W01 - 35041 Harris Road	3/18/2025	Escherichia coli / E. coli (counts)	0
W01 - 35041 Harris Road	3/18/2025	Total Coliforms (counts)	0
W01 - 35041 Harris Road	4/15/2025	Escherichia coli / E. coli (counts)	0
W01 - 35041 Harris Road	4/15/2025	Total Coliforms (counts)	0
W01 - 35041 Harris Road	5/13/2025	Escherichia coli / E. coli (counts)	0
W01 - 35041 Harris Road	5/13/2025	Total Coliforms (counts)	0
W01 - 35041 Harris Road	6/10/2025	Escherichia coli / E. coli (counts)	0
W01 - 35041 Harris Road	6/10/2025	Total Coliforms (counts)	0
W01 - 35041 Harris Road	7/8/2025	Escherichia coli / E. coli (counts)	0
W01 - 35041 Harris Road	7/8/2025	Total Coliforms (counts)	0
W01 - 35041 Harris Road	8/5/2025	Escherichia coli / E. coli (counts)	0
W01 - 35041 Harris Road	8/5/2025	Total Coliforms (counts)	0
W01 - 35041 Harris Road	9/2/2025	Escherichia coli / E. coli (counts)	0
W01 - 35041 Harris Road	9/2/2025	Total Coliforms (counts)	0

































W16 - 27875 Swensson Avenue	12/23/2025	Escherichia coli / E. coli (counts)	0
W16 - 27875 Swensson Avenue	12/23/2025	Total Coliforms (counts)	0
W16 - 27875 Swensson Avenue	12/29/2025	Escherichia coli / E. coli (counts)	0
W16 - 27875 Swensson Avenue	12/29/2025	Total Coliforms (counts)	0
W17 - 31792 Harris Rd.	3/11/2025	Escherichia coli / E. coli (counts)	0
W17 - 31792 Harris Rd.	3/11/2025	Total Coliforms (counts)	0
W17 - 31792 Harris Rd.	4/8/2025	Escherichia coli / E. coli (counts)	0
W17 - 31792 Harris Rd.	4/8/2025	Total Coliforms (counts)	0
W17 - 31792 Harris Rd.	5/6/2025	Escherichia coli / E. coli (counts)	0
W17 - 31792 Harris Rd.	5/6/2025	Total Coliforms (counts)	0
W17 - 31792 Harris Rd.	6/3/2025	Escherichia coli / E. coli (counts)	0
W17 - 31792 Harris Rd.	6/3/2025	Total Coliforms (counts)	0
W17 - 31792 Harris Rd.	7/2/2025	Escherichia coli / E. coli (counts)	0
W17 - 31792 Harris Rd.	7/2/2025	Total Coliforms (counts)	0
W17 - 31792 Harris Rd.	7/29/2025	Escherichia coli / E. coli (counts)	0
W17 - 31792 Harris Rd.	7/29/2025	Total Coliforms (counts)	0
W17 - 31792 Harris Rd.	9/23/2025	Escherichia coli / E. coli (counts)	0
W17 - 31792 Harris Rd.	9/23/2025	Total Coliforms (counts)	0
W17 - 31792 Harris Rd.	10/21/2025	Escherichia coli / E. coli (counts)	0
W17 - 31792 Harris Rd.	10/21/2025	Total Coliforms (counts)	0
W17 - 31792 Harris Rd.	11/18/2025	Escherichia coli / E. coli (counts)	0
W17 - 31792 Harris Rd.	11/18/2025	Total Coliforms (counts)	0
W17 - 31792 Harris Rd.	12/16/2025	Escherichia coli / E. coli (counts)	0
W17 - 31792 Harris Rd.	12/16/2025	Total Coliforms (counts)	0
W19 - 4945 Mt. Lehman Road	1/7/2025	Escherichia coli / E. coli (counts)	0
W19 - 4945 Mt. Lehman Road	1/7/2025	Total Coliforms (counts)	0
W19 - 4945 Mt. Lehman Road	1/13/2025	Escherichia coli / E. coli (counts)	0
W19 - 4945 Mt. Lehman Road	1/13/2025	Total Coliforms (counts)	0
W19 - 4945 Mt. Lehman Road	1/21/2025	Escherichia coli / E. coli (counts)	0
W19 - 4945 Mt. Lehman Road	1/21/2025	Total Coliforms (counts)	0
W19 - 4945 Mt. Lehman Road	1/28/2025	Escherichia coli / E. coli (counts)	0
W19 - 4945 Mt. Lehman Road	1/28/2025	Total Coliforms (counts)	0
W19 - 4945 Mt. Lehman Road	2/4/2025	Escherichia coli / E. coli (counts)	0
W19 - 4945 Mt. Lehman Road	2/4/2025	Total Coliforms (counts)	0
W19 - 4945 Mt. Lehman Road	2/11/2025	Escherichia coli / E. coli (counts)	0
W19 - 4945 Mt. Lehman Road	2/11/2025	Total Coliforms (counts)	0
W19 - 4945 Mt. Lehman Road	2/19/2025	Escherichia coli / E. coli (counts)	0
W19 - 4945 Mt. Lehman Road	2/19/2025	Total Coliforms (counts)	0
W19 - 4945 Mt. Lehman Road	2/25/2025	Escherichia coli / E. coli (counts)	0
W19 - 4945 Mt. Lehman Road	2/25/2025	Total Coliforms (counts)	0
W19 - 4945 Mt. Lehman Road	11/15/2025	Escherichia coli / E. coli (counts)	0
W19 - 4945 Mt. Lehman Road	11/15/2025	Total Coliforms (counts)	0
W20 - 33435 Hawthorne Ave.	3/4/2025	Escherichia coli / E. coli (counts)	0
W20 - 33435 Hawthorne Ave.	3/4/2025	Total Coliforms (counts)	0
W20 - 33435 Hawthorne Ave.	3/11/2025	Escherichia coli / E. coli (counts)	0
W20 - 33435 Hawthorne Ave.	3/11/2025	Total Coliforms (counts)	0
W20 - 33435 Hawthorne Ave.	3/18/2025	Escherichia coli / E. coli (counts)	0
W20 - 33435 Hawthorne Ave.	3/18/2025	Total Coliforms (counts)	0
W20 - 33435 Hawthorne Ave.	3/25/2025	Escherichia coli / E. coli (counts)	0
W20 - 33435 Hawthorne Ave.	3/25/2025	Total Coliforms (counts)	0
W20 - 33435 Hawthorne Ave.	4/1/2025	Escherichia coli / E. coli (counts)	0
W20 - 33435 Hawthorne Ave.	4/1/2025	Total Coliforms (counts)	0
W20 - 33435 Hawthorne Ave.	4/8/2025	Escherichia coli / E. coli (counts)	0
W20 - 33435 Hawthorne Ave.	4/8/2025	Total Coliforms (counts)	0
W20 - 33435 Hawthorne Ave.	4/15/2025	Escherichia coli / E. coli (counts)	0















W26 - 3119 Gardner Ave	10/7/2025	Escherichia coli / E. coli (counts)	0
W26 - 3119 Gardner Ave	10/7/2025	Total Coliforms (counts)	0
W26 - 3119 Gardner Ave	10/14/2025	Escherichia coli / E. coli (counts)	0
W26 - 3119 Gardner Ave	10/14/2025	Total Coliforms (counts)	0
W26 - 3119 Gardner Ave	10/21/2025	Escherichia coli / E. coli (counts)	0
W26 - 3119 Gardner Ave	10/21/2025	Total Coliforms (counts)	0
W26 - 3119 Gardner Ave	10/28/2025	Escherichia coli / E. coli (counts)	0
W26 - 3119 Gardner Ave	10/28/2025	Total Coliforms (counts)	0
W26 - 3119 Gardner Ave	11/4/2025	Escherichia coli / E. coli (counts)	0
W26 - 3119 Gardner Ave	11/4/2025	Total Coliforms (counts)	0
W26 - 3119 Gardner Ave	11/12/2025	Escherichia coli / E. coli (counts)	0
W26 - 3119 Gardner Ave	11/12/2025	Total Coliforms (counts)	0
W26 - 3119 Gardner Ave	11/18/2025	Escherichia coli / E. coli (counts)	0
W26 - 3119 Gardner Ave	11/18/2025	Total Coliforms (counts)	0
W26 - 3119 Gardner Ave	11/25/2025	Escherichia coli / E. coli (counts)	0
W26 - 3119 Gardner Ave	11/25/2025	Total Coliforms (counts)	0
W26 - 3119 Gardner Ave	12/2/2025	Escherichia coli / E. coli (counts)	0
W26 - 3119 Gardner Ave	12/2/2025	Total Coliforms (counts)	0
W26 - 3119 Gardner Ave	12/9/2025	Escherichia coli / E. coli (counts)	0
W26 - 3119 Gardner Ave	12/9/2025	Total Coliforms (counts)	0
W26 - 3119 Gardner Ave	12/16/2025	Escherichia coli / E. coli (counts)	0
W26 - 3119 Gardner Ave	12/16/2025	Total Coliforms (counts)	0
W26 - 3119 Gardner Ave	12/23/2025	Escherichia coli / E. coli (counts)	0
W26 - 3119 Gardner Ave	12/23/2025	Total Coliforms (counts)	0
W26 - 3119 Gardner Ave	12/29/2025	Escherichia coli / E. coli (counts)	0
W26 - 3119 Gardner Ave	12/29/2025	Total Coliforms (counts)	0
W27 - 33989 Townshipline Rd.	3/11/2025	Escherichia coli / E. coli (counts)	0
W27 - 33989 Townshipline Rd.	3/11/2025	Total Coliforms (counts)	0
W27 - 33989 Townshipline Rd.	4/8/2025	Escherichia coli / E. coli (counts)	0
W27 - 33989 Townshipline Rd.	4/8/2025	Total Coliforms (counts)	0
W27 - 33989 Townshipline Rd.	5/6/2025	Escherichia coli / E. coli (counts)	0
W27 - 33989 Townshipline Rd.	5/6/2025	Total Coliforms (counts)	0
W27 - 33989 Townshipline Rd.	6/3/2025	Escherichia coli / E. coli (counts)	0
W27 - 33989 Townshipline Rd.	6/3/2025	Total Coliforms (counts)	0
W27 - 33989 Townshipline Rd.	7/2/2025	Escherichia coli / E. coli (counts)	0
W27 - 33989 Townshipline Rd.	7/2/2025	Total Coliforms (counts)	0
W27 - 33989 Townshipline Rd.	7/29/2025	Escherichia coli / E. coli (counts)	0
W27 - 33989 Townshipline Rd.	7/29/2025	Total Coliforms (counts)	0
W27 - 33989 Townshipline Rd.	9/23/2025	Escherichia coli / E. coli (counts)	0
W27 - 33989 Townshipline Rd.	9/23/2025	Total Coliforms (counts)	0
W27 - 33989 Townshipline Rd.	10/21/2025	Escherichia coli / E. coli (counts)	0
W27 - 33989 Townshipline Rd.	10/21/2025	Total Coliforms (counts)	0
W27 - 33989 Townshipline Rd.	11/18/2025	Escherichia coli / E. coli (counts)	0
W27 - 33989 Townshipline Rd.	11/18/2025	Total Coliforms (counts)	0
W27 - 33989 Townshipline Rd.	12/16/2025	Escherichia coli / E. coli (counts)	0
W27 - 33989 Townshipline Rd.	12/16/2025	Total Coliforms (counts)	0
W28 - 2379 Chardonay Lane	3/25/2025	Escherichia coli / E. coli (counts)	0
W28 - 2379 Chardonay Lane	3/25/2025	Total Coliforms (counts)	0
W28 - 2379 Chardonay Lane	4/22/2025	Escherichia coli / E. coli (counts)	0
W28 - 2379 Chardonay Lane	4/22/2025	Total Coliforms (counts)	0
W28 - 2379 Chardonay Lane	5/20/2025	Escherichia coli / E. coli (counts)	0
W28 - 2379 Chardonay Lane	5/20/2025	Total Coliforms (counts)	0
W28 - 2379 Chardonay Lane	6/17/2025	Escherichia coli / E. coli (counts)	0
W28 - 2379 Chardonay Lane	6/17/2025	Total Coliforms (counts)	0
W28 - 2379 Chardonay Lane	7/15/2025	Escherichia coli / E. coli (counts)	0

W28 - 2379 Chardonnay Lane	7/15/2025	Total Coliforms (counts)	0
W28 - 2379 Chardonnay Lane	8/12/2025	Escherichia coli / E. coli (counts)	0
W28 - 2379 Chardonnay Lane	8/12/2025	Total Coliforms (counts)	0
W28 - 2379 Chardonnay Lane	9/9/2025	Escherichia coli / E. coli (counts)	0
W28 - 2379 Chardonnay Lane	9/9/2025	Total Coliforms (counts)	0
W28 - 2379 Chardonnay Lane	10/7/2025	Escherichia coli / E. coli (counts)	0
W28 - 2379 Chardonnay Lane	10/7/2025	Total Coliforms (counts)	0
W28 - 2379 Chardonnay Lane	11/4/2025	Escherichia coli / E. coli (counts)	0
W28 - 2379 Chardonnay Lane	11/4/2025	Total Coliforms (counts)	0
W28 - 2379 Chardonnay Lane	12/2/2025	Escherichia coli / E. coli (counts)	0
W28 - 2379 Chardonnay Lane	12/2/2025	Total Coliforms (counts)	0
W28 - 2379 Chardonnay Lane	12/29/2025	Escherichia coli / E. coli (counts)	0
W28 - 2379 Chardonnay Lane	12/29/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	1/7/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	1/7/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	1/13/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	1/13/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	1/21/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	1/21/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	1/28/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	1/28/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	2/4/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	2/4/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	2/11/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	2/11/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	2/19/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	2/19/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	2/25/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	2/25/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	3/4/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	3/4/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	4/1/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	4/1/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	4/29/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	4/29/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	5/27/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	5/27/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	6/24/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	6/24/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	7/22/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	7/22/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	8/19/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	8/19/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	9/16/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	9/16/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	10/14/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	10/14/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	11/12/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	11/12/2025	Total Coliforms (counts)	0
W34 - 926 Columbia Street	12/9/2025	Escherichia coli / E. coli (counts)	0
W34 - 926 Columbia Street	12/9/2025	Total Coliforms (counts)	0

## Appendix G – Pesticides and Herbicides - Raw Groundwater

Parameters Tested (All Results Below Detection Limit)		
2,3,4,6-Tetrachlorophenol	Bromoxynil	Dicrotophos
2,4,5-Trichlorophenoxyacetic acid / 2,4,5-T	Butylate	Dieldrin
2,4,6-Trichlorophenol	Captan	Dimethoate
2,4'-DDT and 4,4'-DDD	Carbaryl	Dinoseb
2,4-Dichlorophenol	Carbofuran	Dioxathion
2,4-Dichlorophenoxyacetic acid / 2,4-D	Carbophenothion - solids (wet wei	Diphenylamine
2-Methylnaphthalene	Chlorbenside	Disulfoton
4,4-DDE	Chlorfenson	Endosulfan I
4,4'-DDT (pp-DDT)	Chlorfenvinphos	Endosulfan II
4,4-Methoxychlor	Chlorfenvinphos (e)	Endosulfan sulfate
Acenaphthene	Chlormephos	Endrin
Acenaphthylene	Chlorothalonil	Endrin aldehyde
a-Chlordane	Chlorpropham	Endrin ketone
Acridine	Chlorpyrifos	EPN
Alachlor	Chlorpyrifos-methyl	Eptam
Aldicarb	Chlorthal-dimethyl (Dacthal)	Ethalfuralin
Aldrin	Chlorthiophos	Ethion
alpha-BHC	Chrysene	Fenchlorphos
Anthracene	Cyanazine	Fenitrothion
Aspon	Cyanophos	Fensulfothion
Atrazine	delta-BHC	Fenthion
Atrazine+Metabolites	Demeton-O	Fluoranthene
Atrazine-desethyl (DEA)	Demeton-S	Fluorene
Azinphos-ethyl	Desmetryn	Folpet
Azinphos-methyl	Diallate	Fonofos
Bendiocarb	Diallate Z	gamma-BHC
Benfluralin	Diazinon	Heptachlor
Benzo(a)anthracene	Dibenzo(a,h)anthracene	Heptachlor epoxide
Benzo(a)pyrene	Dicamba	Hexachlorobenzene
Benzo(b,j)fluoranthene	Dichlobenil	Hexazinone
Benzo(g,h,i)perylene	Dichlofenthion	Indeno(1,2,3-c,d)pyrene
Benzo(k)fluoranthene	Dichlofluanid	Iodofenphos
beta-BHC	Dichloran	Iprodione
Bromacil	Dichlorvos and Naled	Isofenphos
Bromophos	Diclofop-methyl	Lindane
Bromophos-ethyl	Dicofol	Malaoxon

Parameters Tested (All Results Below Detection Limit)		
Malathion	Phorate	Quinalphos
Metalaxyl	Phosalone	Quinoline
Methidathion	Phosmet	Simazine
Methyl parathion	Phosphamidon E	Sulfotep
Metolachlor	Phosphamidon Z	Tecnazene
Metribuzin	Picloram	Terbufos
Mevinphos	Pirimicarb	Terbutylazine
Mirex	Pirimiphos-ethyl	Terbutryn
Naphthalene	Pirimiphos-methyl	Tetrachlorvinphos (Stirophos)
Nitrofen	Procymidone	Tetradifon
o,p-DDD	Profenofos	Tolyfluanid
o,p-DDE	Profluralin	Total HMW PAH
Omethoate	Prometryn	Total LMW PAH
Parathion	Pronamide	Total PAH
Pentachloronitrobenzene / PCNB	Propazine	Triadimefon
Pentachlorophenol / PCP	Propiconazole	Triallate
Permethrin	Pyrazophos	Trifluralin
Phenanthrene	Pyrene	Vinclozolin

## Appendix H – Treated Water Quality Results – Metals (Distribution Systems)

**CITY OF ABBOTSFORD DISTRIBUTION**

Analyte	Units	GCDWQ	Guideline	Analyzed Concentrations				Remarks
				Minimum	Maximum	Average	Median	
Aluminum (total)	ug/L	2900	MAC	10.3	32.0	26.9	31.8	
Antimony (total)	ug/L	6	MAC	<0.5	<0.5	-	-	
Arsenic (total)	ug/L	10	MAC	0.14	4.0	0.67	0.27	
Barium (total)	ug/L	2000	MAC	4.6	18.6	7.6	4.9	
Beryllium (total)	ug/L			<0.1	<0.1	-	-	
Bismuth (total)	ug/L			<1.0	<1.0	-	-	
Boron (total)	ug/L	5000	MAC	<50	<50	-	-	
Cadmium (total)	ug/L	7	MAC	<0.01	<0.01	-	-	
Calcium (total)	mg/L			2.1	25.3	6.9	2.4	
Chromium (total)	ug/L	50	MAC	<1.0	<1.0	-	-	
Cobalt (total)	ug/L			<0.2	<0.2	-	-	
Copper (total)	ug/L	1000/2000	AO/MAC	0.48	13.1	4.6	2.0	
Iron (total)	ug/L	100	AO	<5.0	31.3	14.8	12.2	
Lead (total)	ug/L	5	MAC	<0.2	0.24	0.23	0.23	
Magnesium (total)	mg/L			0.23	6.2	1.5	0.33	
Manganese (total)	ug/L	20/120	AO/MAC	<1.0	59.7	14.0	4.2	1 sample > AO
Mercury (total)	ug/L	1	MAC	<0.0019	0.005	0.005	0.005	
Molybdenum (total)	ug/L			<1.0	<1.0	-	-	
Nickel (total)	ug/L			<1.0	<1.0	-	-	
Potassium (total)	mg/L			0.1	1.5	0.38	0.10	
Selenium (total)	ug/L	50	MAC	<0.1	0.19	0.19	0.19	
Silicon (total, as Si)	ug/L			2090	5120	2758	2110	
Silver (total)	ug/L			<0.02	<0.02	-	-	
Sodium (total)	mg/L	200	AO	1.1	6.7	2.3	1.2	
Strontium (total)	ug/L	7000	MAC	5.9	98.5	25.5	7.3	
Thallium (total)	ug/L			<0.01	<0.01	-	-	
Tin (total)	ug/L			<5.0	<5.0	-	-	
Titanium (total)	ug/L			<5.0	<5.0	-	-	
Uranium (total)	ug/L	20	MAC	<0.1	0.26	0.26	0.26	
Vanadium (total)	ug/L			<5.0	<5.0	-	-	
Zinc (total)	ug/L	5000	AO	<5.0	<5.0	-	-	
Zirconium (total)	ug/L			<0.1	<0.1	-	-	
<[value]: Below Detection Limit								

CITY OF MISSION DISTRIBUTION								
Analyte	Units	GCDWQ	Guideline	Analyzed Concentrations				Remarks
				Minimum	Maximum	Average	Median	
Aluminum (total)	ug/L	2900	MAC	8.9	42.3	18.6	12.6	
Antimony (total)	ug/L	6	MAC	<0.5	<0.5	-	-	
Arsenic (total)	ug/L	10	MAC	0.10	0.29	0.18	0.13	
Barium (total)	ug/L	2000	MAC	2.6	10.0	5.2	5.0	
Beryllium (total)	ug/L			<0.1	<0.1	-	-	
Bismuth (total)	ug/L			<1.0	<1.0	-	-	
Boron (total)	ug/L	5000	MAC	<50	<50	-	-	
Cadmium (total)	ug/L	7	MAC	<0.01	<0.01	-	-	
Calcium (total)	mg/L			1.5	2.7	2.0	1.8	
Chromium (total)	ug/L	50	MAC	<1.0	<1.0	-	-	
Cobalt (total)	ug/L			<0.2	<0.2	-	-	
Copper (total)	ug/L	1000/2000	AO/MAC	0.23	28.9	6.3	3.0	
Iron (total)	ug/L	100	AO	<5.0	44.6	15.9	12.0	
Lead (total)	ug/L	5	MAC	<0.2	<0.2	-	-	
Magnesium (total)	mg/L			0.12	0.29	0.20	0.18	
Manganese (total)	ug/L	20/120	AO/MAC	<1.0	3.1	2.1	2.1	
Mercury (total)	ug/L	1	MAC	<0.0019	<0.0019	-	-	
Molybdenum (total)	ug/L			<1.0	<1.0	-	-	
Nickel (total)	ug/L			<1.0	<1.0	-	-	
Potassium (total)	mg/L			0.06	0.11	0.08	0.07	
Selenium (total)	ug/L	50	MAC	<0.1	<0.1	-	-	
Silicon (total, as Si)	ug/L			1260	2630	1927	1760	
Silver (total)	ug/L			<0.02	<0.02	-	-	
Sodium (total)	mg/L	200	AO	0.6	4.3	2.2	1.7	
Strontium (total)	ug/L	7000	MAC	4.8	7.7	6.1	5.8	
Thallium (total)	ug/L			<0.01	<0.01	-	-	
Tin (total)	ug/L			<5.0	<5.0	-	-	
Titanium (total)	ug/L			<5.0	<5.0	-	-	
Uranium (total)	ug/L	20	MAC	<0.1	<0.1	-	-	
Vanadium (total)	ug/L			<5.0	<5.0	-	-	
Zinc (total)	ug/L	5000	AO	<5.0	<5.0	-	-	
Zirconium (total)	ug/L			<0.1	<0.1	-	-	
<[value]: Below Detection Limit								

## Appendix I – Disinfection By-Products (DBP) - Treated Water

Regional Water Supply System						
Sample Location	Analyte	Unit	Sample Date			GCDWQ Guidelines
			3/21/25	9/18/25	11/27/25	
T01a - Bell Road (pre-NH3)	Haloacetic acids 5 / HAA5	ug/L	16	<5.0	26	80 (MAC)
	N-Nitrosodimethylamine / NDMA	ng/L	<1.9	<1.9	<1.9	40 (MAC)
	Total Trihalomethanes / TTHM	ug/L	26	14	37	100 (MAC)
T03b - MacLure Reservoir Cell 1/2 outlet	Haloacetic acids 5 / HAA5	ug/L	15	5.6	24	80 (MAC)
	N-Nitrosodimethylamine / NDMA	ng/L	<1.9	<1.9	<1.9	40 (MAC)
	Total Trihalomethanes / TTHM	ug/L	12	8.1	15	100 (MAC)
T05a - Cannon's Pit 400 (pre-NH3)	Haloacetic acids 5 / HAA5	ug/L	15	17	17	80 (MAC)
	N-Nitrosodimethylamine / NDMA	ng/L	<1.9	<1.9	<1.9	40 (MAC)
	Total Trihalomethanes / TTHM	ug/L	27	23	25	100 (MAC)
City of Abbotsford Distribution						
Sample Location	Analyte	Unit	Sample Date			GCDWQ Guidelines
			3/4/25			
E07 - 6230 Tolmie Road	Haloacetic acids 5 / HAA5	ug/L	<5.0			80 (MAC)
	N-Nitrosodimethylamine / NDMA	ng/L	<2.0			40 (MAC)
	Total Trihalomethanes / TTHM	ug/L	<1.0			100 (MAC)
E17 - 2720 St. Moritz Way	Haloacetic acids 5 / HAA5	ug/L	20			80 (MAC)
	N-Nitrosodimethylamine / NDMA	ng/L	<2.0			40 (MAC)
	Total Trihalomethanes / TTHM	ug/L	15			100 (MAC)
W03 - 35944 McKee Road	Haloacetic acids 5 / HAA5	ug/L	24			80 (MAC)
	N-Nitrosodimethylamine / NDMA	ng/L	<2.0			40 (MAC)
	Total Trihalomethanes / TTHM	ug/L	18			100 (MAC)
W13 - 7942 Bradner Road	Haloacetic acids 5 / HAA5	ug/L	13			80 (MAC)
	N-Nitrosodimethylamine / NDMA	ng/L	<2.0			40 (MAC)
	Total Trihalomethanes / TTHM	ug/L	11			100 (MAC)
W16 - 27875 Swensson Avenue	Haloacetic acids 5 / HAA5	ug/L	12			80 (MAC)
	N-Nitrosodimethylamine / NDMA	ng/L	<2.0			40 (MAC)
	Total Trihalomethanes / TTHM	ug/L	9.3			100 (MAC)
City of Mission Distribution						
Sample Location	Analyte	Unit	Sample Date			GCDWQ Guidelines
			3/11/25	11/25/25		
M01 - Israel	Haloacetic acids 5 / HAA5	ug/L	5.3	32		80 (MAC)
	N-Nitrosodimethylamine / NDMA	ng/L	<2.0	<2.0		40 (MAC)
	Total Trihalomethanes / TTHM	ug/L	9.6	18		100 (MAC)
M03 - Penner	Haloacetic acids 5 / HAA5	ug/L	19	22		80 (MAC)
	N-Nitrosodimethylamine / NDMA	ng/L	<2.0	2.9		40 (MAC)
	Total Trihalomethanes / TTHM	ug/L	13	20		100 (MAC)
M09 - Shook	Haloacetic acids 5 / HAA5	ug/L	31	22		80 (MAC)
	N-Nitrosodimethylamine / NDMA	ng/L	<2.0	<2.0		40 (MAC)
	Total Trihalomethanes / TTHM	ug/L	17	15		100 (MAC)
M10 - Miller	Haloacetic acids 5 / HAA5	ug/L	19	20		80 (MAC)
	N-Nitrosodimethylamine / NDMA	ng/L	2.5	3.5		40 (MAC)
	Total Trihalomethanes / TTHM	ug/L	10	19		100 (MAC)

## Appendix J – PFAS Test Results

## Full PFAS Test Results for Bevan 1 Well

Bevan 1						
Compound	Abbreviation	MRL	Sample Date			
			9/25/2025	10/30/2025	11/6/2025	11/26/2025
<b>Perfluoroalkyl Carboxylic Acids</b>						
Perfluorobutanoic acid	PFBA	5	< 5	7.7	< 5	7.8
Perfluoropentanoic Acid	PFPeA	3	6.7	44	4.4	48
Perfluorohexanoic Acid	PFHxA	3	5.0	33	3.5	33
Perfluoroheptanoic acid	PFHpA	3	< 3	< 3	< 3	< 3
Perfluorooctanoic acid	PFOA	4	< 4	4.6	4.3	4.1
Perfluorononanoic acid	PFNA	4	< 4	< 4	< 4	< 4
Perfluorodecanoic acid	PFDA	3	< 3	< 3	< 3	< 3
Perfluoroundecanoic acid	PFUnA	2	< 2	< 2	< 2	< 2
Perfluorododecanoic acid	PFDoA	3	< 3	< 3	< 3	< 3
<b>Perfluoroalkane Sulfonic Acids</b>						
Perfluorobutane sulfonic acid	PFBS	3	< 3	5.5	6.3	5.2
Perfluoropentane sulfonic acid	PFPeS	4	< 4	< 4	< 4	< 4
Perfluorohexane sulfonic acid	PFHxS	3	< 3	3.2	< 3	3.1
Perfluoroheptane sulfonic acid	PFHpS	3	< 3	< 3	< 3	< 3
Perfluorooctane sulfonic acid	PFOS	4	< 4	< 4	< 4	< 4
<b>Fluorotelomer Sulfonic Acids</b>						
1H,1H, 2H, 2H-Perfluorohexane sulfonic acid	4:2 FTS	3	< 3	< 3	< 3	< 3
1H,1H,2H,2H-perfluorooctane sulfonic acid	6:2 FTS	5	< 5	< 5	< 5	< 5
1H,1H,2H,2H-perfluorodecane sulfonic acid	8:2 FTS	5	< 5	< 5	< 5	< 5
<b>Per- and Polyfluoroether Carboxylic Acids</b>						
Hexafluoropropylene oxide dimer acid	HFPO-DA	5	< 5	< 5	< 5	< 5
4,8-Dioxa-3H-perfluorononanoic acid	ADONA	3	< 3	< 3	< 3	< 3
Perfluoro-3-methoxypropanoic acid	PFMPA	4	< 4	< 4	< 4	< 4
Perfluoro-4-methoxybutanoic acid	PFMBA	3	< 3	< 3	< 3	< 3
Nonafluoro-3,6-dioxaheptanoic acid	NFDHA	20	< 20	< 20	< 20	< 20
<b>Ether Sulfonic Acids</b>						
9-Chlorohexadecafluoro-3-oxanonane-1-sulfonic acid	9Cl-PF3ONS	2	< 2	< 2	< 2	< 2
11-Chloroeicosafluoro-3-oxaundecane-1-sulfonic acid	11Cl-PF3OUdS	5	< 5	< 5	< 5	< 5
Perfluoro(2-ethoxyethane)sulfonic acid	PFEEESA	3	< 3	< 3	< 3	< 3
<b>Sum (25 parameters above MRLs)</b>			12	98	19	101

\*Note that the Minimum Reporting Level (MRL) values are those of the UCMR5 MRL as described in the analytical method of the USEPA Method 533.

## Full PFAS Test Results for Bevan 2 Well

Bevan 2						
Compound	Abbreviation	MRL	Sample Date			
			9/25/2025	10/30/2025	11/6/2025	11/26/2025
<b>Perfluoroalkyl Carboxylic Acids</b>						
Perfluorobutanoic acid	PFBA	5	< 5	6.5	< 5	< 5
Perfluoropentanoic Acid	PFPeA	3	4.1	35	6.2	4.8
Perfluorohexanoic Acid	PFHxA	3	3.5	26	5.0	3.6
Perfluoroheptanoic acid	PFHpA	3	< 2	< 3	< 3	< 3
Perfluorooctanoic acid	PFOA	4	< 4	4.3	< 4	< 4
Perfluorononanoic acid	PFNA	4	< 4	< 4	< 4	< 4
Perfluorodecanoic acid	PFDA	3	< 3	< 3	< 3	< 3
Perfluoroundecanoic acid	PFUnA	2	< 2	< 2	< 2	< 2
Perfluorododecanoic acid	PFDoA	3	< 3	< 3	< 3	< 3
<b>Perfluoroalkane Sulfonic Acids</b>						
Perfluorobutane sulfonic acid	PFBS	3	4.1	5.7	6.0	4.1
Perfluoropentane sulfonic acid	PFPeS	4	< 4	< 4	< 4	< 4
Perfluorohexane sulfonic acid	PFHxS	3	< 3	3.6	< 3	< 3
Perfluoroheptane sulfonic acid	PFHpS	3	< 3	< 3	< 3	< 3
Perfluorooctane sulfonic acid	PFOS	4	< 4	< 4	< 4	< 4
<b>Fluorotelomer Sulfonic Acids</b>						
1H,1H, 2H, 2H-Perfluorohexane sulfonic acid	4:2 FTS	3	< 3	< 3	< 3	< 3
1H,1H,2H,2H-perfluorooctane sulfonic acid	6:2 FTS	5	< 5	< 5	< 5	< 5
1H,1H,2H,2H-perfluorodecane sulfonic acid	8:2 FTS	5	< 5	< 5	< 5	< 5
<b>Per- and Polyfluoroether Carboxylic Acids</b>						
Hexafluoropropylene oxide dimer acid	HFPO-DA	5	< 5	< 5	< 5	< 5
4,8-Dioxa-3H-perfluorononanoic acid	ADONA	3	< 3	< 3	< 3	< 3
Perfluoro-3-methoxypropanoic acid	PFMPA	4	< 4	< 4	< 4	< 4
Perfluoro-4-methoxybutanoic acid	PFMBA	3	< 3	< 3	< 3	< 3
Nonafluoro-3,6-dioxaheptanoic acid	NFDHA	20	< 20	< 20	< 20	< 20
<b>Ether Sulfonic Acids</b>						
9-Chlorohexadecafluoro-3-oxanonane-1-sulfonic acid	9CI-PF3ONS	2	< 2	< 2	< 2	< 2
11-Chloroeicosafluoro-3-oxaundecane-1-sulfonic acid	11CI-PF3OUdS	5	< 5	< 5	< 5	< 5
Perfluoro(2-ethoxyethane)sulfonic acid	PFEESA	3	< 3	< 3	< 3	< 3
<b>Sum (25 parameters above MRLs)</b>			12	81	17	13

\*Note that the Minimum Reporting Level (MRL) values are those of the UCMR5 MRL as described in the analytical method of the USEPA Method 533.

## Full PFAS Test Results for Bevan 3 Well

Bevan 3						
Compound	Abbreviation	MRL	Sample Date			
			9/25/2025	10/30/2025	11/6/2025	11/26/2025
<b>Perfluoroalkyl Carboxylic Acids</b>						
Perfluorobutanoic acid	PFBA	5	< 5	< 5	< 5	< 5
Perfluoropentanoic Acid	PFPeA	3	5.8	7.6	4.7	6.4
Perfluorohexanoic Acid	PFHxA	3	4.2	6.2	3.8	4.8
Perfluoroheptanoic acid	PFHpA	3	< 3	< 3	< 3	< 3
Perfluorooctanoic acid	PFOA	4	< 4	< 4	< 4	< 4
Perfluorononanoic acid	PFNA	4	< 4	< 4	< 4	< 4
Perfluorodecanoic acid	PFDA	3	< 3	< 3	< 3	< 3
Perfluoroundecanoic acid	PFUnA	2	< 2	< 2	< 2	< 2
Perfluorododecanoic acid	PFDoA	3	< 3	< 3	< 3	< 3
<b>Perfluoroalkane Sulfonic Acids</b>						
Perfluorobutane sulfonic acid	PFBS	3	5.3	6.6	4.0	6.3
Perfluoropentane sulfonic acid	PFPeS	4	< 4	< 4	< 4	< 4
Perfluorohexane sulfonic acid	PFHxS	3	< 3	3.0	< 3	< 3
Perfluoroheptane sulfonic acid	PFHpS	3	< 3	< 3	< 3	< 3
Perfluorooctane sulfonic acid	PFOS	4	< 4	< 4	< 4	< 4
<b>Fluorotelomer Sulfonic Acids</b>						
1H,1H, 2H, 2H-Perfluorohexane sulfonic acid	4:2 FTS	3	< 3	< 3	< 3	< 3
1H,1H,2H,2H-perfluorooctane sulfonic acid	6:2 FTS	5	< 5	< 5	< 5	< 5
1H,1H,2H,2H-perfluorodecane sulfonic acid	8:2 FTS	5	< 5	< 5	< 5	< 5
<b>Per- and Polyfluoroether Carboxylic Acids</b>						
Hexafluoropropylene oxide dimer acid	HFPO-DA	5	< 5	< 5	< 5	< 5
4,8-Dioxa-3H-perfluorononanoic acid	ADONA	3	< 3	< 3	< 3	< 3
Perfluoro-3-methoxypropanoic acid	PFMPA	4	< 4	< 4	< 4	< 4
Perfluoro-4-methoxybutanoic acid	PFMBA	3	< 3	< 3	< 3	< 3
Nonafluoro-3,6-dioxaheptanoic acid	NFDHA	20	< 20	< 20	< 20	< 20
<b>Ether Sulfonic Acids</b>						
9-Chlorohexadecafluoro-3-oxanonane-1-sulfonic acid	9CI-PF3ONS	2	< 2	< 2	< 2	< 2
11-Chloroeicosafluoro-3-oxaundecane-1-sulfonic acid	11CI-PF3OUdS	5	< 5	< 5	< 5	< 5
Perfluoro(2-ethoxyethane)sulfonic acid	PFEESA	3	< 3	< 3	< 3	< 3
<b>Sum (25 parameters above MRLs)</b>			15	23	13	18

\*Note that the Minimum Reporting Level (MRL) values are those of the UCMR5 MRL as described in the analytical method of the USEPA Method 533.

## Full PFAS Test Results for Bevan 4 Well

Bevan 4						
Compound	Abbreviation	MRL	Sample Date			
			9/25/2025	10/30/2025	11/6/2025	11/26/2025
<b>Perfluoroalkyl Carboxylic Acids</b>						
Perfluorobutanoic acid	PFBA	5	< 5	< 5	6.8	< 5
Perfluoropentanoic Acid	PFPeA	3	4.2	5.2	38	4.5
Perfluorohexanoic Acid	PFHxA	3	3.3	4.1	28	3.3
Perfluoroheptanoic acid	PFHpA	3	< 3	< 3	< 3	< 3
Perfluorooctanoic acid	PFOA	4	< 4	< 4	4.1	< 4
Perfluorononanoic acid	PFNA	4	< 4	< 4	< 4	< 4
Perfluorodecanoic acid	PFDA	3	< 3	< 3	< 3	< 3
Perfluoroundecanoic acid	PFUnA	2	< 2	< 2	< 2	< 2
Perfluorododecanoic acid	PFDoA	3	< 3	< 3	< 3	< 3
<b>Perfluoroalkane Sulfonic Acids</b>						
Perfluorobutane sulfonic acid	PFBS	3	5.7	7.0	4.7	6.9
Perfluoropentane sulfonic acid	PFPeS	4	< 4	< 4	< 4	< 4
Perfluorohexane sulfonic acid	PFHxS	3	< 3	3.3	3.1	< 3
Perfluoroheptane sulfonic acid	PFHpS	3	< 3	< 3	< 3	< 3
Perfluorooctane sulfonic acid	PFOS	4	< 4	< 4	< 4	< 4
<b>Fluorotelomer Sulfonic Acids</b>						
1H,1H, 2H, 2H-Perfluorohexane sulfonic acid	4:2 FTS	3	< 3	< 3	< 3	< 3
1H,1H,2H,2H-perfluorooctane sulfonic acid	6:2 FTS	5	< 5	< 5	< 5	< 5
1H,1H,2H,2H-perfluorodecane sulfonic acid	8:2 FTS	5	< 5	< 5	< 5	< 5
<b>Per- and Polyfluoroether Carboxylic Acids</b>						
Hexafluoropropylene oxide dimer acid	HFPO-DA	5	< 5	< 5	< 5	< 5
4,8-Dioxa-3H-perfluorononanoic acid	ADONA	3	< 3	< 3	< 3	< 3
Perfluoro-3-methoxypropanoic acid	PFMPA	4	< 4	< 4	< 4	< 4
Perfluoro-4-methoxybutanoic acid	PFMBA	3	< 3	< 3	< 3	< 3
Nonafluoro-3,6-dioxaheptanoic acid	NFDHA	20	< 20	< 20	< 20	< 20
<b>Ether Sulfonic Acids</b>						
9-Chlorohexadecafluoro-3-oxanonane-1-sulfonic acid	9CI-PF3ONS	2	< 2	< 2	< 2	< 2
11-Chloroeicosafluoro-3-oxaundecane-1-sulfonic acid	11CI-PF3OUdS	5	< 5	< 5	< 5	< 5
Perfluoro(2-ethoxyethane)sulfonic acid	PFEESA	3	< 3	< 3	< 3	< 3
<b>Sum (25 parameters above MRLs)</b>			13	20	85	15

\*Note that the Minimum Reporting Level (MRL) values are those of the UCMR5 MRL as described in the analytical method of the USEPA Method 533.

## Full PFAS Test Results for Townline 2 Well

Townline 2						
Compound	Abbreviation	MRL	Sample Date			
			9/25/2025	10/30/2025	11/6/2025	11/26/2025
<b>Perfluoroalkyl Carboxylic Acids</b>						
Perfluorobutanoic acid	PFBA	5	< 5	5.0	< 5	5.2
Perfluoropentanoic Acid	PFPeA	3	6.7	10.0	9.0	11
Perfluorohexanoic Acid	PFHxA	3	4.4	6.0	5.4	6.3
Perfluoroheptanoic acid	PFHpA	3	< 3	3.5	3.2	3.8
Perfluorooctanoic acid	PFOA	4	< 4	4.8	4.1	4.6
Perfluorononanoic acid	PFNA	4	< 4	< 4	< 4	< 4
Perfluorodecanoic acid	PFDA	3	< 3	< 3	< 3	< 3
Perfluoroundecanoic acid	PFUnA	2	< 2	< 2	< 2	< 2
Perfluorododecanoic acid	PFDoA	3	< 3	< 3	< 3	< 3
<b>Perfluoroalkane Sulfonic Acids</b>						
Perfluorobutane sulfonic acid	PFBS	3	< 3	< 3	< 3	< 3
Perfluoropentane sulfonic acid	PFPeS	4	< 4	< 4	< 4	< 4
Perfluorohexane sulfonic acid	PFHxS	3	< 3	< 3	3.0	< 3
Perfluoroheptane sulfonic acid	PFHpS	3	< 3	< 3	< 3	< 3
Perfluorooctane sulfonic acid	PFOS	4	< 4	< 4	< 4	< 4
<b>Fluorotelomer Sulfonic Acids</b>						
1H,1H, 2H, 2H-Perfluorohexane sulfonic acid	4:2 FTS	3	< 3	< 3	< 3	< 3
1H,1H,2H,2H-perfluorooctane sulfonic acid	6:2 FTS	5	< 5	< 5	< 5	< 5
1H,1H,2H,2H-perfluorodecane sulfonic acid	8:2 FTS	5	< 5	< 5	< 5	< 5
<b>Per- and Polyfluoroether Carboxylic Acids</b>						
Hexafluoropropylene oxide dimer acid	HFPO-DA	5	< 5	< 5	< 5	< 5
4,8-Dioxa-3H-perfluorononanoic acid	ADONA	3	< 3	< 3	< 3	< 3
Perfluoro-3-methoxypropanoic acid	PFMPA	4	< 4	< 4	< 4	< 4
Perfluoro-4-methoxybutanoic acid	PFMBA	3	< 3	< 3	< 3	< 3
Nonafluoro-3,6-dioxaheptanoic acid	NFDHA	20	< 20	< 20	< 20	< 20
<b>Ether Sulfonic Acids</b>						
9-Chlorohexadecafluoro-3-oxanonane-1-sulfonic acid	9Cl-PF3ONS	2	< 2	< 2	< 2	< 2
11-Chloroeicosafluoro-3-oxaundecane-1-sulfonic acid	11Cl-PF3OUdS	5	< 5	< 5	< 5	< 5
Perfluoro(2-ethoxyethane)sulfonic acid	PFEESA	3	< 3	< 3	< 3	< 3
<b>Sum (25 parameters above MRLs)</b>			11	29	25	31

\*Note that the Minimum Reporting Level (MRL) values are those of the UCMR5 MRL as described in the analytical method of the USEPA Method 533.